


230/208-60-3
Per Nameplate

L1 L2 L3
Hi Voltage Field Connection
Hi Voltage Field Connection
Hi Voltage Field Connection

For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

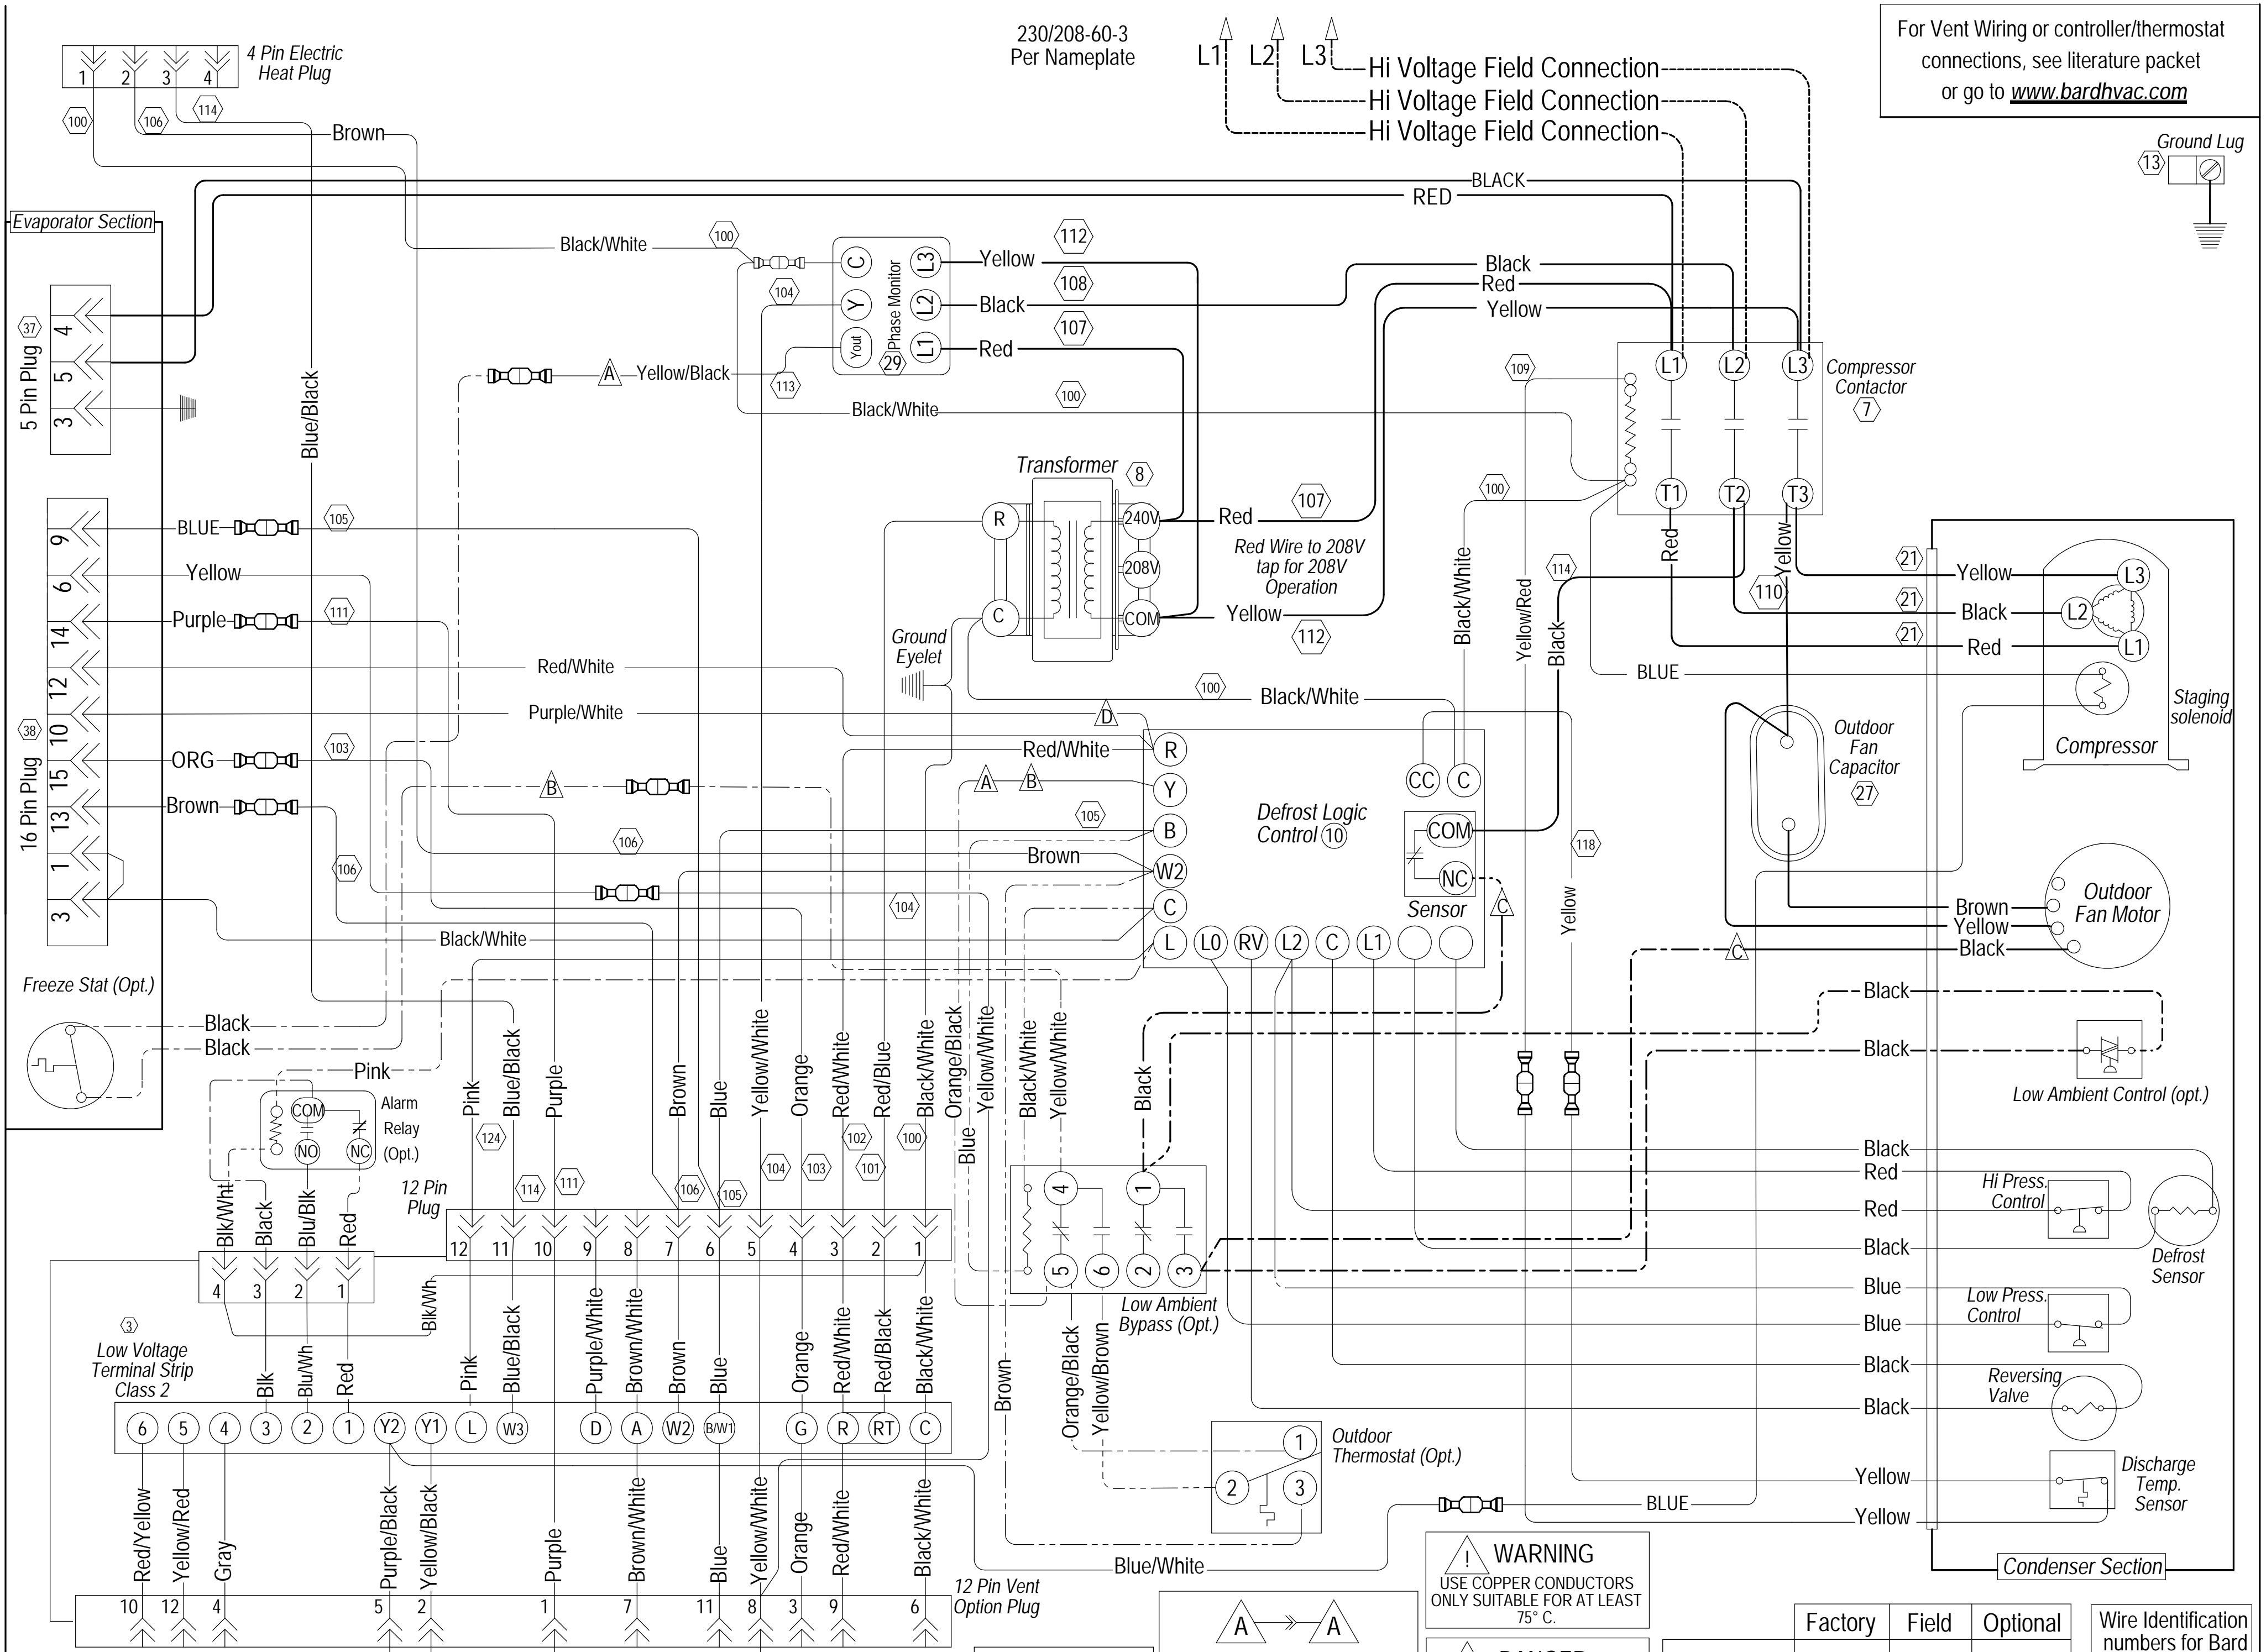

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

D
Remove wire for (-)10%
Airflow Full & Part Loads

A → **A**
Same Letter Designated
Wires Connect if Option Not Used
"A" No Control Option
"B" & "C" Only LAC Option

WARNING
USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

DANGER
"ELECTRICAL SHOCK HAZARD"
"DISCONNECT POWER BEFORE
SERVICING."

	Factory	Field	Optional
High Voltage			
Low Voltage			

Wire Identification
numbers for Bard
use only.
4096-285 A