
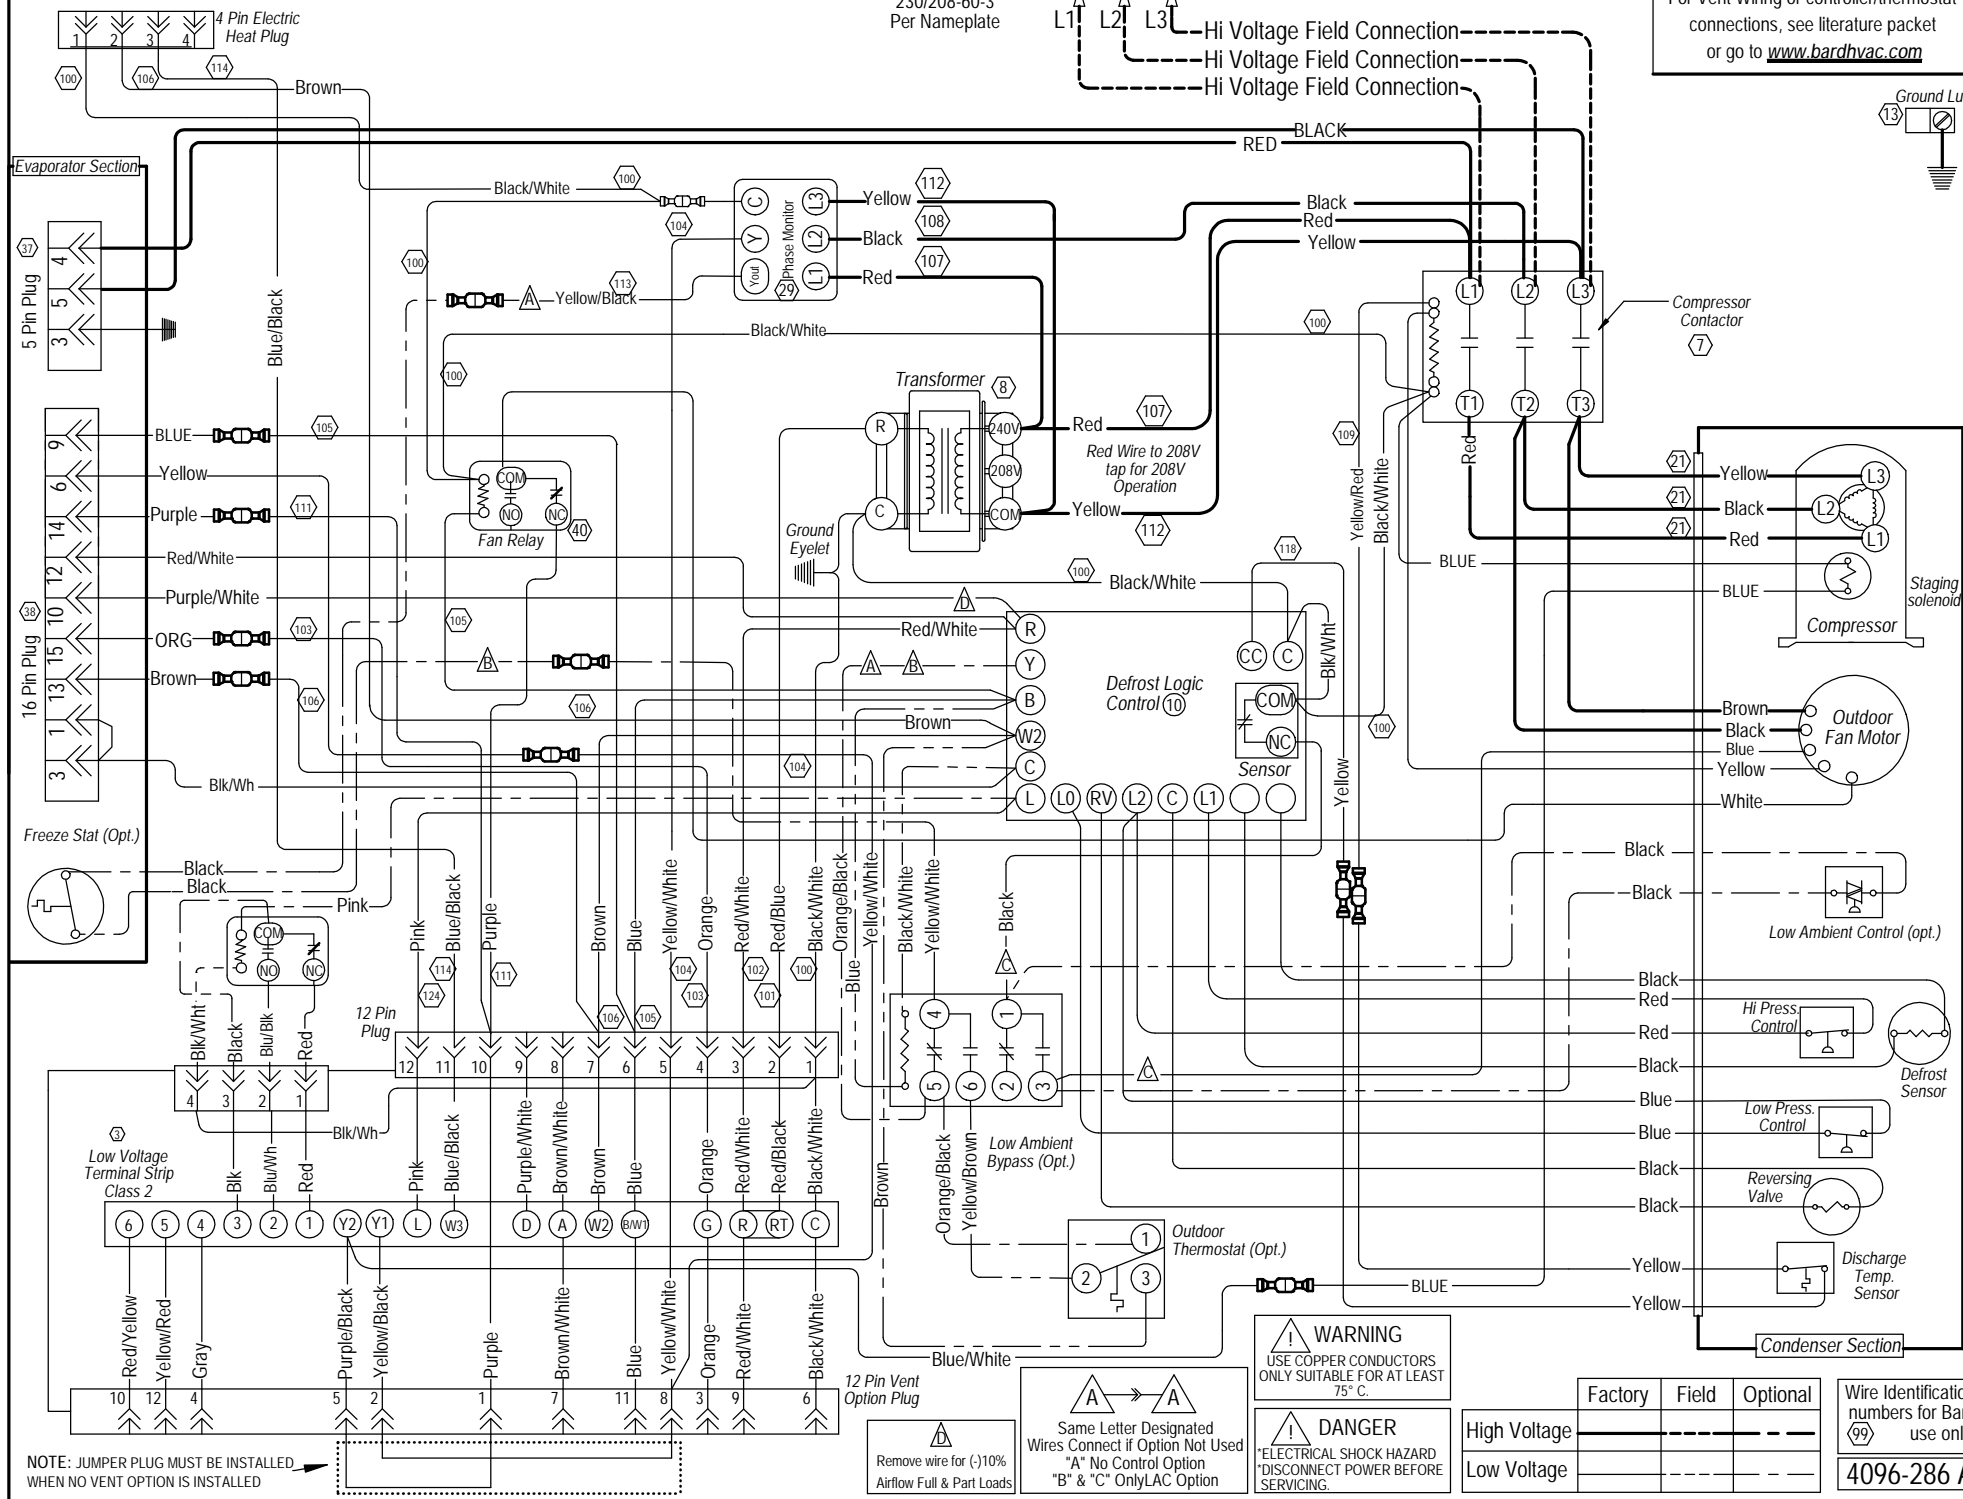


230/208-60-3
Per Nameplate

L1 L2 L3
-Hi Voltage Field Connection
-Hi Voltage Field Connection
-Hi Voltage Field Connection

For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com



NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

Remove wire for (-10% Airflow Full & Part Loads)

Same Letter Designated Wires Connect if Option Not Used
"A" No Control Option
"B" & "C" Only LAC Option

WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.

DANGER
ELECTRICAL SHOCK HAZARD
DISCONNECT POWER BEFORE SERVICING.

High Voltage	Factory	Field	Optional
Low Voltage			

Wire Identification numbers for Bard use only.
4096-286 A