


Use 8403-012 (T872R1164) thermostat and 8404-007 (Q672L1185) subbase combination or 8403-015 (T872N1036) thermostat and 8404-008 (Q672F1299) subbase combination. Consult installation manual for further details.

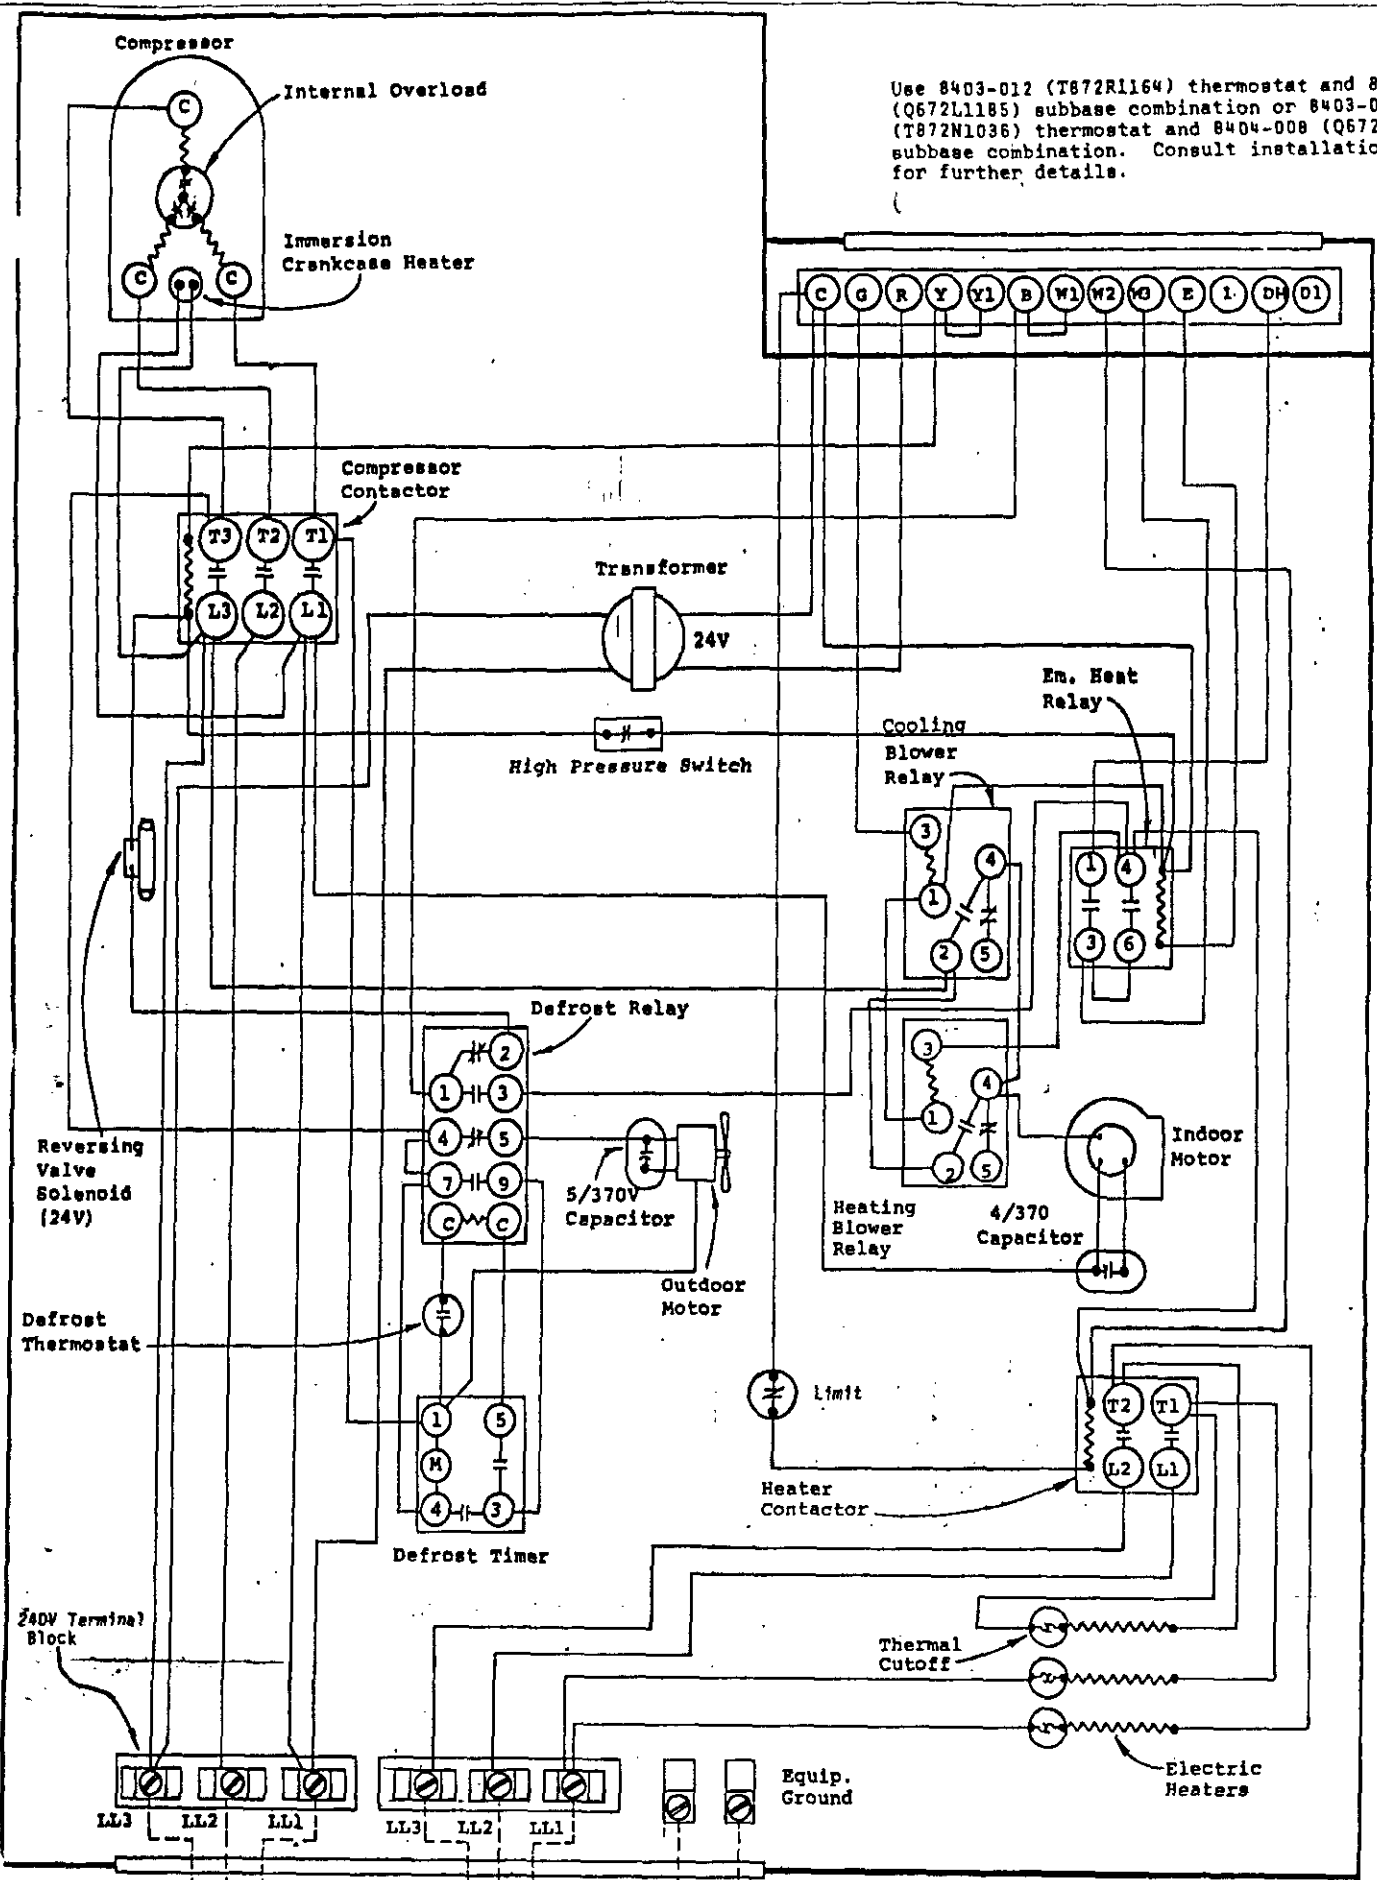

24V Terminal Block

Fused Disconnect Switch

Fused Disconnect Switch

Equip. Ground

Factory Wiring ———
Field Wiring - - - -

USE COPPER OR ALUMINUM WIRE

PH36-2 Heat Pump w/12, 15kw