


Use 8403-017 (T877F11E4) thermostat and 8404-007 (G672L1165) subbase combination or 8403-015 (T872N1036) thermostat and 8404-008 (G672F1299) subbase combination. Consult installation manual for further details.

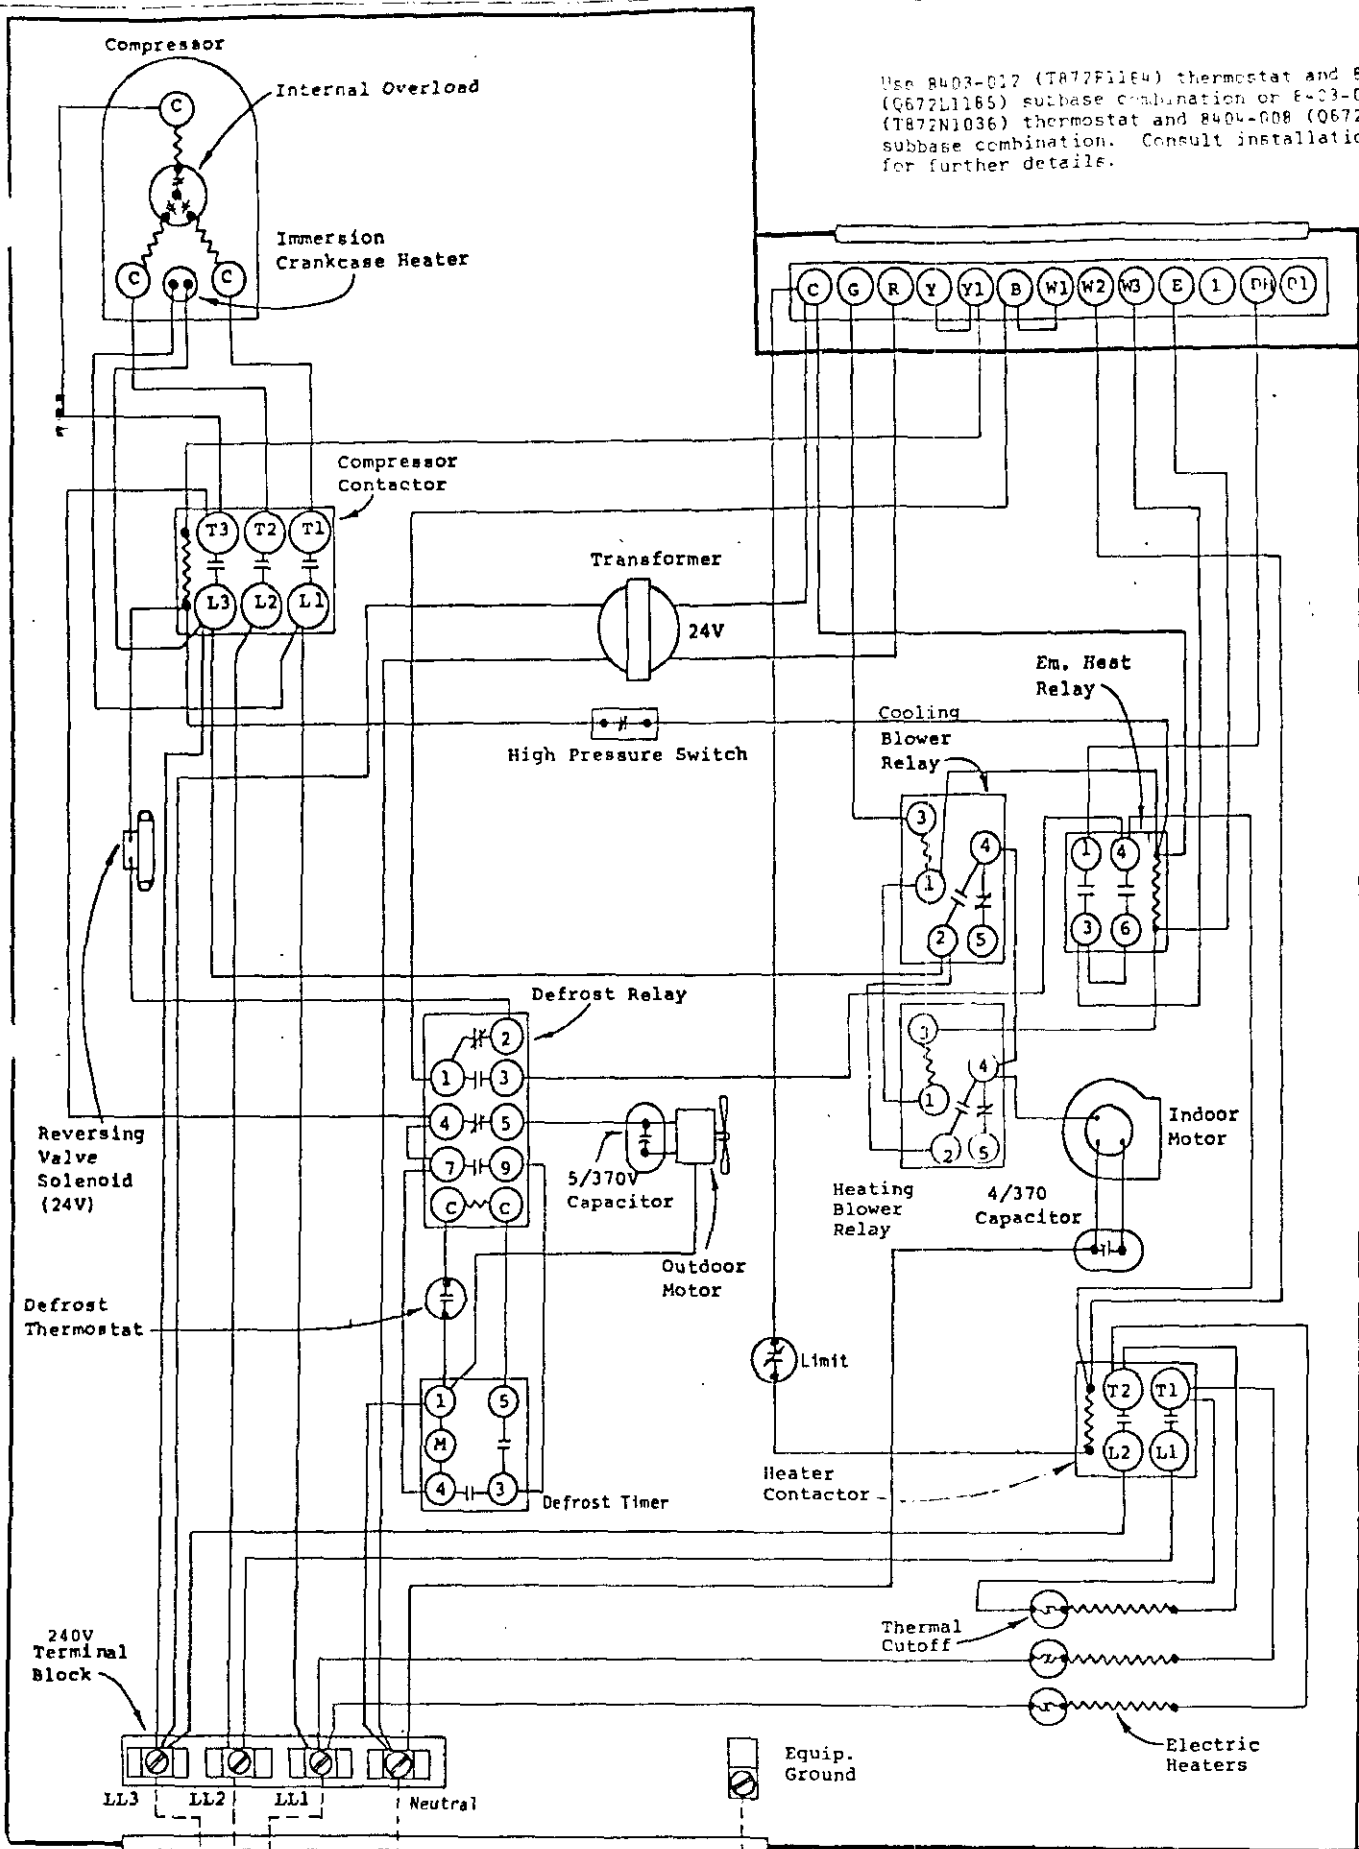

24V Terminal Block

240V Terminal Block

LL3 LL2 LL1 Neutral

Equip. Ground

Factory Wiring ———
Field Wiring - - - -

Fused Disconnect Switch

USE COPPER OR ALUMINUM WIRE

PH36-2 Heat Pump w/6.75,9,11.25 Kw