


T872N1036/Q672F1299 or Q672F1299

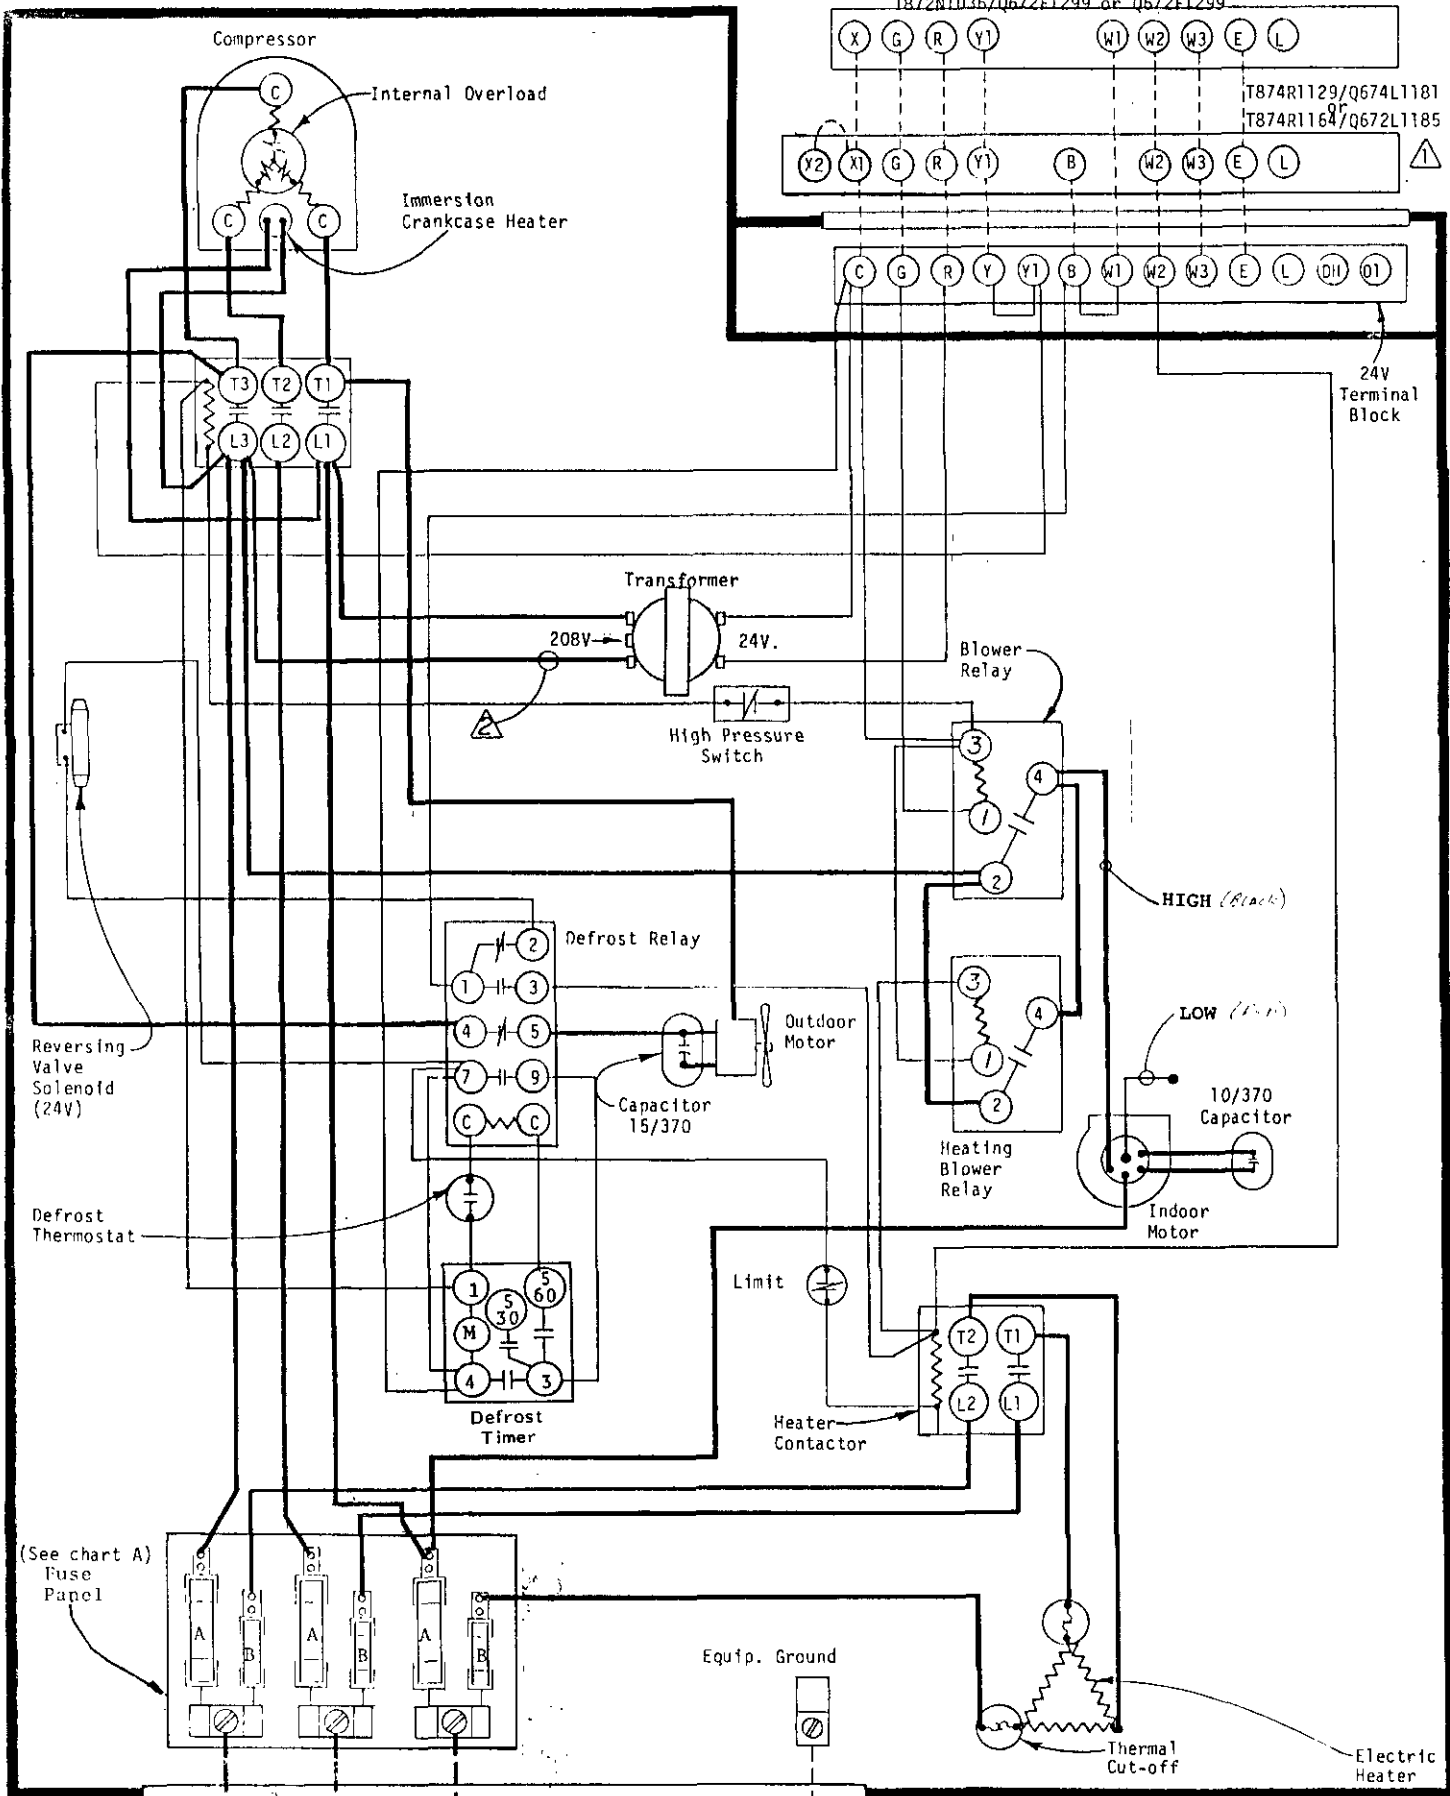

24V Terminal Block

Reversing Valve Solenoid (24V)

Defrost Thermostat

(See chart A) Fuse Panel

Equip. Ground

Thermal Cut-off

Electric Heater

CHART A	
42WH-3	48WH5-3
Fuse A 40A T.D.	45A T.D.
Fuse B 30A Standard	

ALL FUSES CLASS K5

FACTORY WIRING	FIELD WIRING
Low Voltage ———	-----
High Voltage ———	-----

⚠ If there is an X1 and X2 terminal on Q674L1181, jumper them together and connect from C to either one.

⚠ For 208V operation move this wire to 208V transformer tap.

USE COPPER OR ALUMINUM WIRE

230/208-60-3