


TR72N1036/067211,09  
or  
T874N1024/0674F1261

T872R1164/0672L1185  
or  
T874R1129/0674L1181

24V Terminal Block

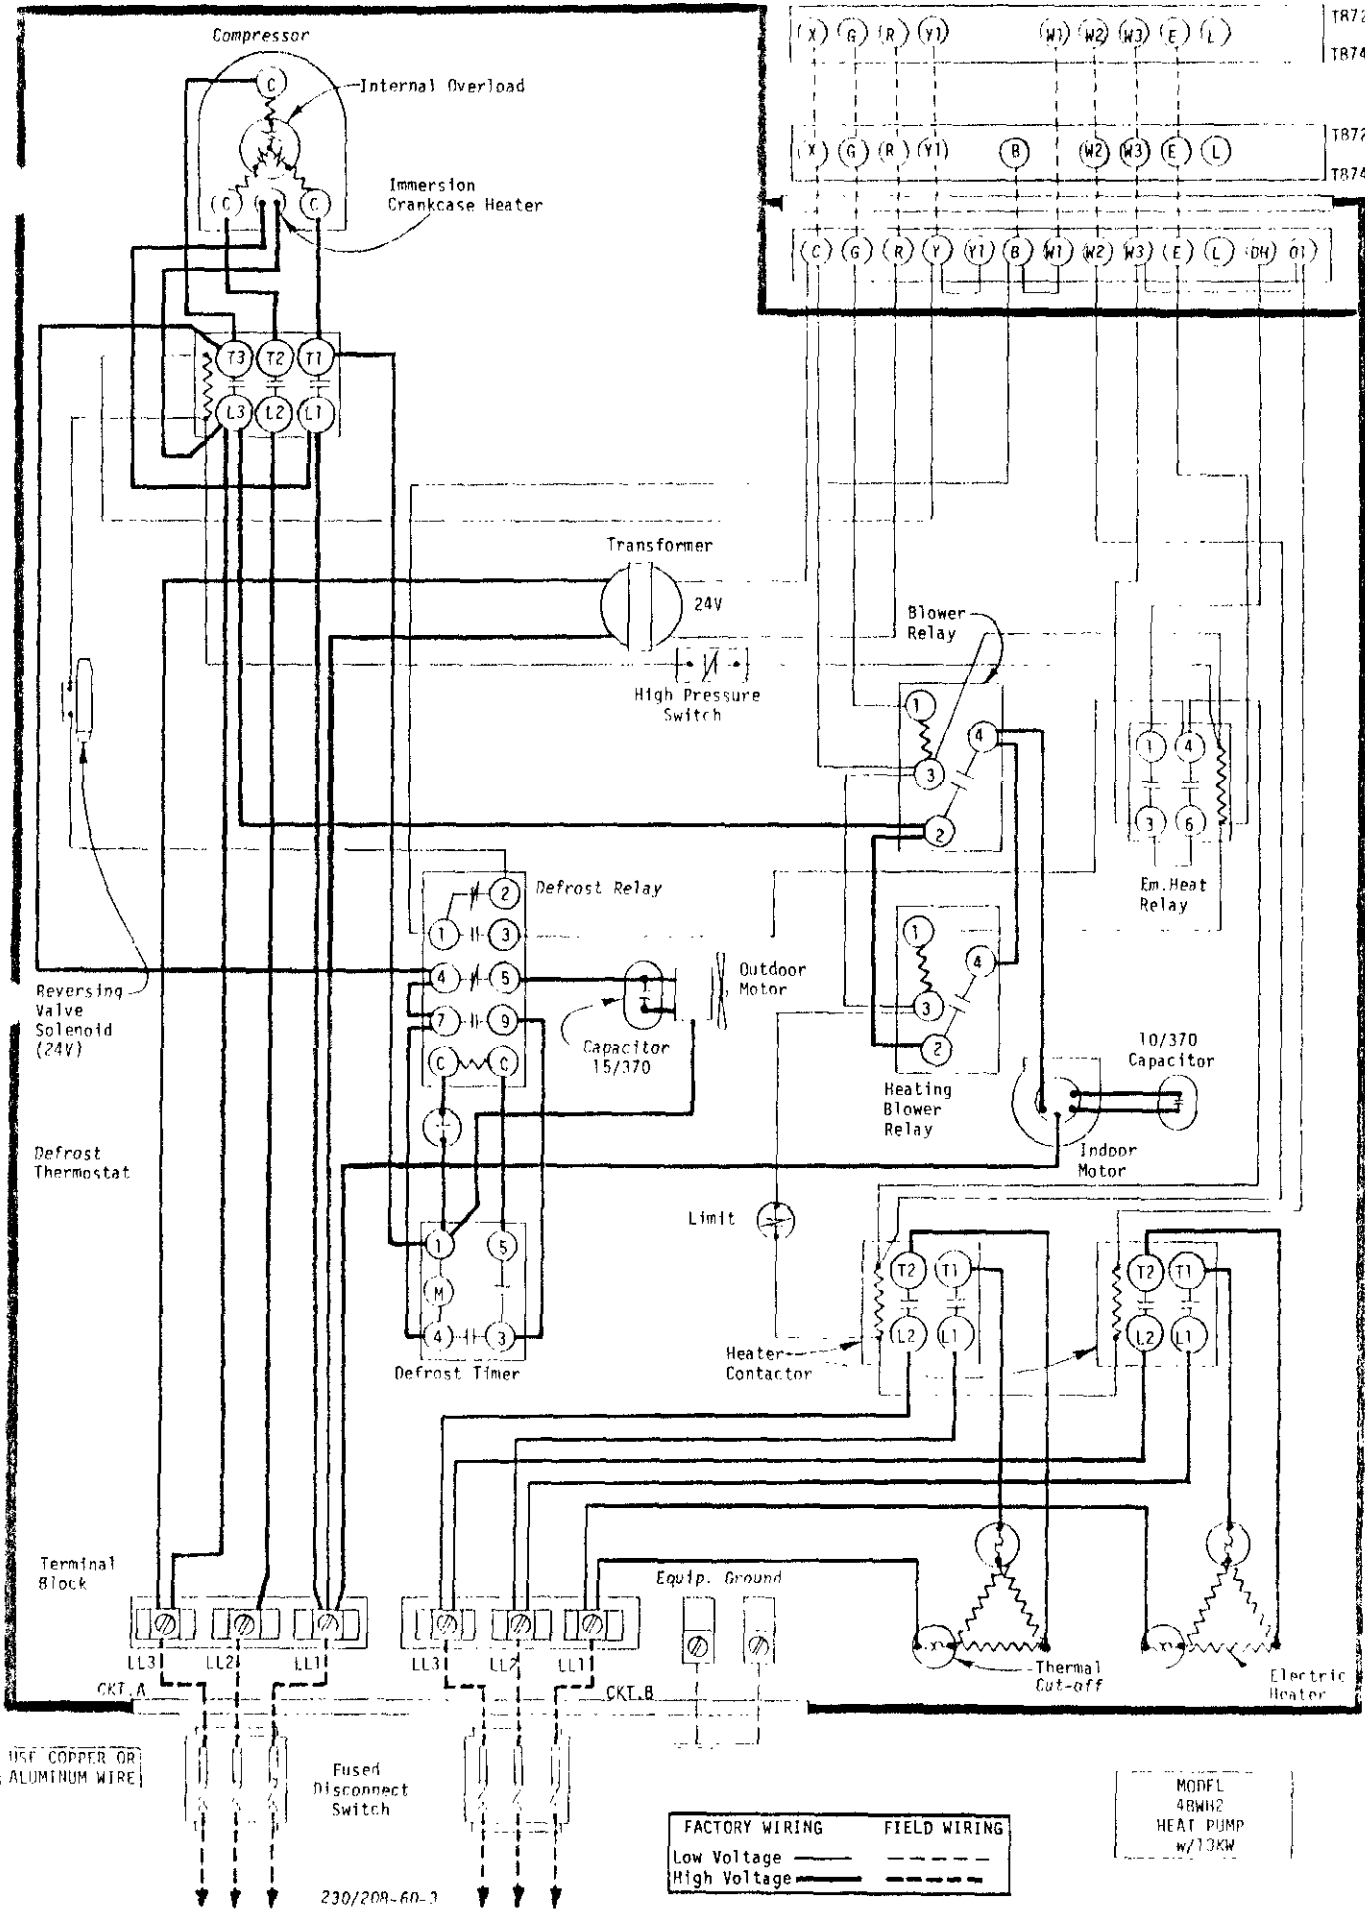

USE COPPER OR ALUMINUM WIRE

230/208-60-3

MODFL  
48WH2  
HEAT PUMP  
w/10KW