


T872n1036/0672F1299 or T874N1024/0674F1261

T872R1164/0672L1185  
T874R1128/0674L1181

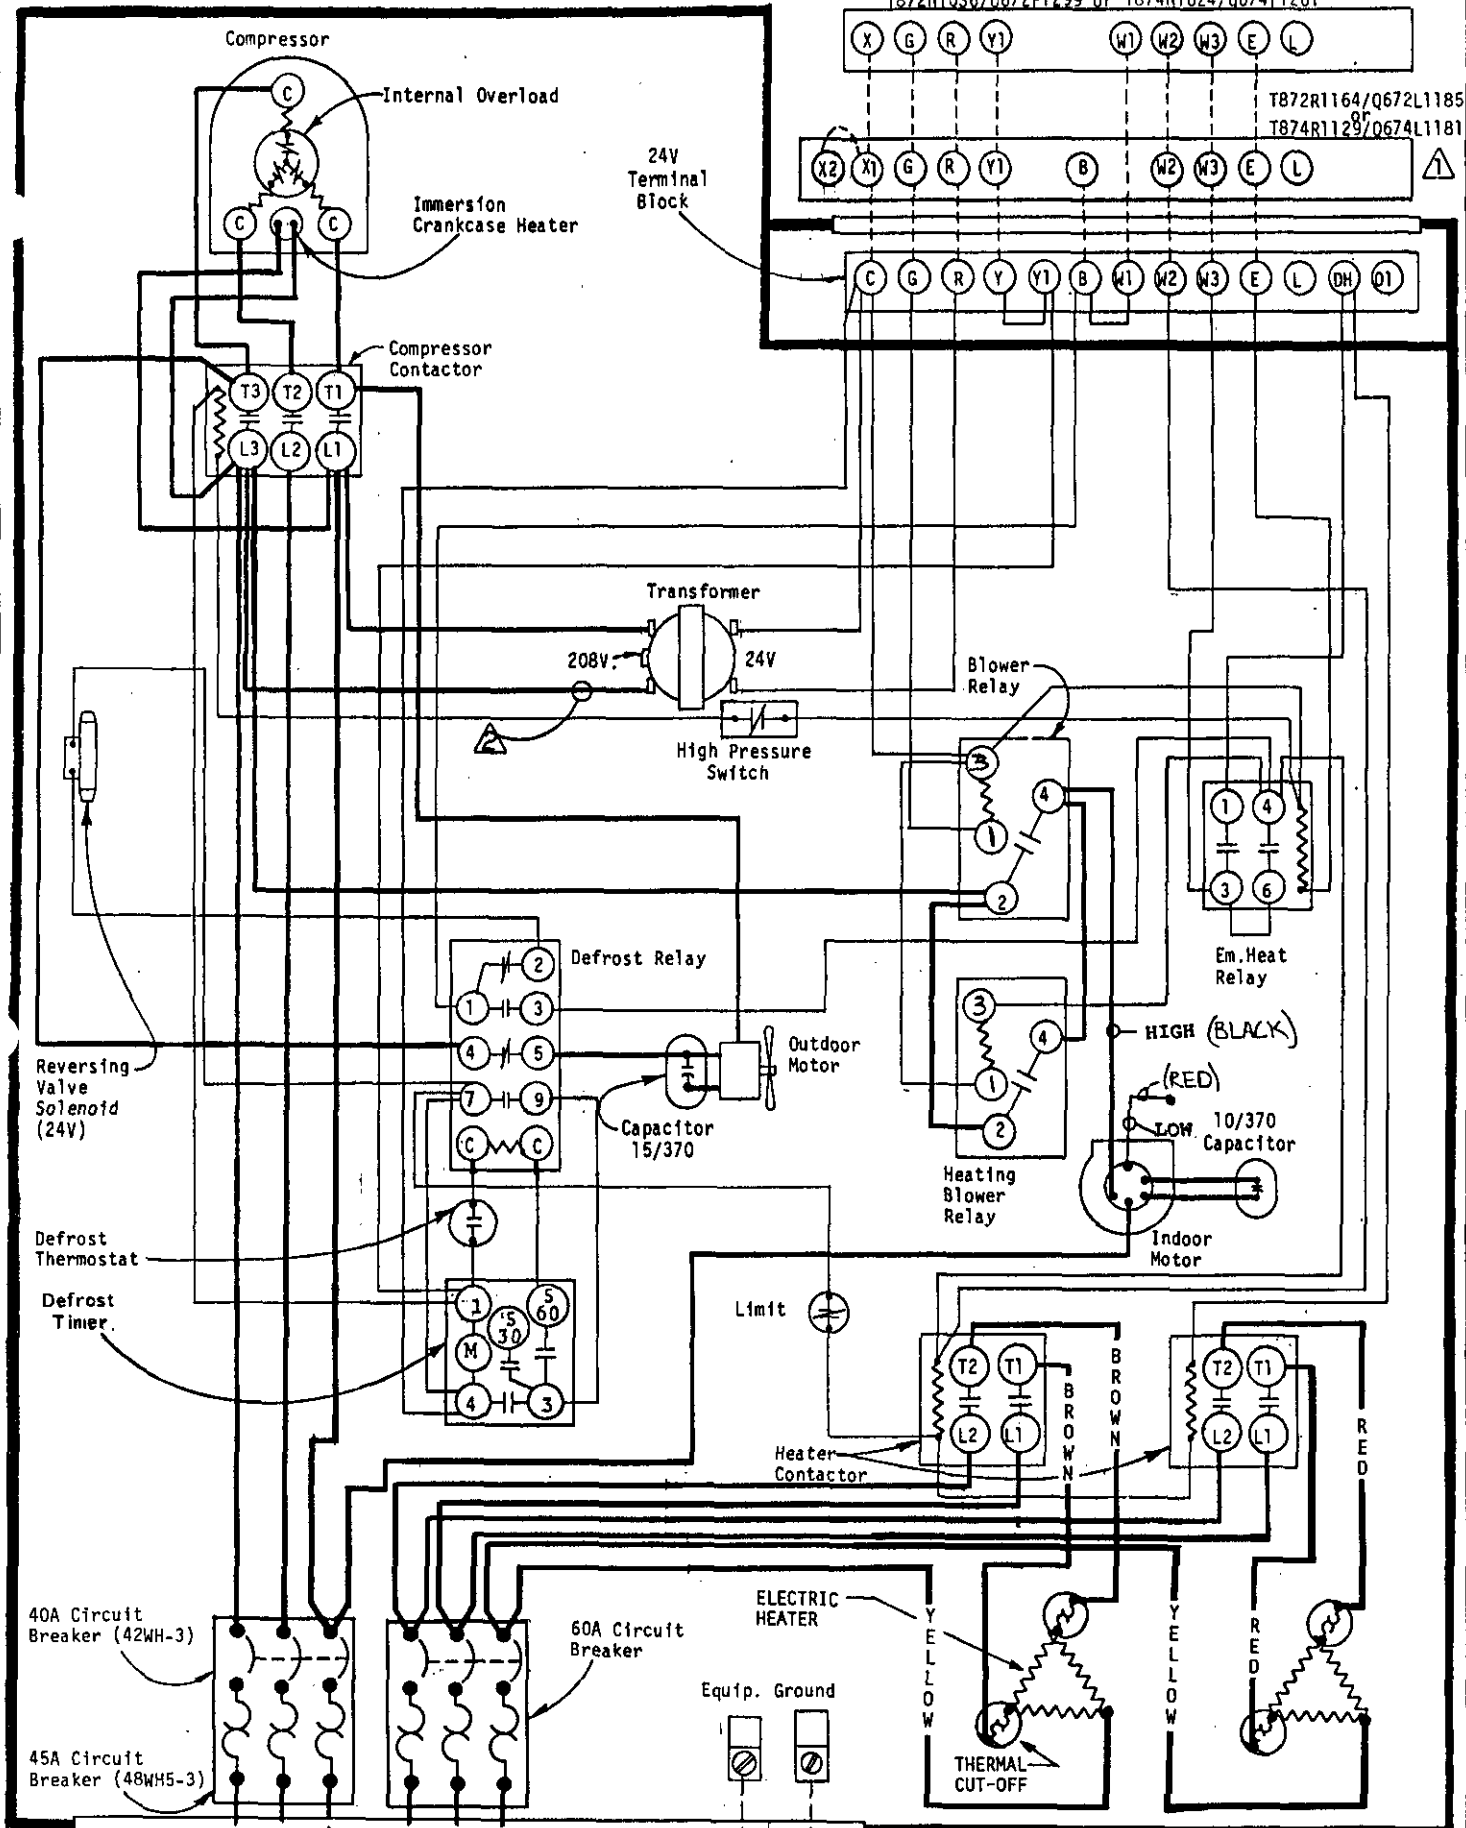

40A Circuit Breaker (42WH-3)

60A Circuit Breaker

45A Circuit Breaker (48WH5-3)

CKT. A

CKT. B

230/208-60-3

USE COPPER OR ALUMINUM WIRE

Equip. Ground

⚠ If there is an X1 and X2 terminal on 0674L1181, jumper them together and connect from C to either one.

|              | FACTORY WIRING | FIELD WIRING |
|--------------|----------------|--------------|
| Low Voltage  | ————           | -----        |
| High Voltage | ————           | -----        |

⚠ For 208V operation move this wire to 208V transformer tap.

4014-241H