


⚠ If there is an X1 and X2 terminal on Q674L1181 jumper them together and connect from C to either one.

TB72R1036/Q672F1239  
or  
TB74R1024/Q674F1261

TB72R1164/Q672L1185  
or  
TB74R1129/Q674L1181

24V  
Terminal  
Block

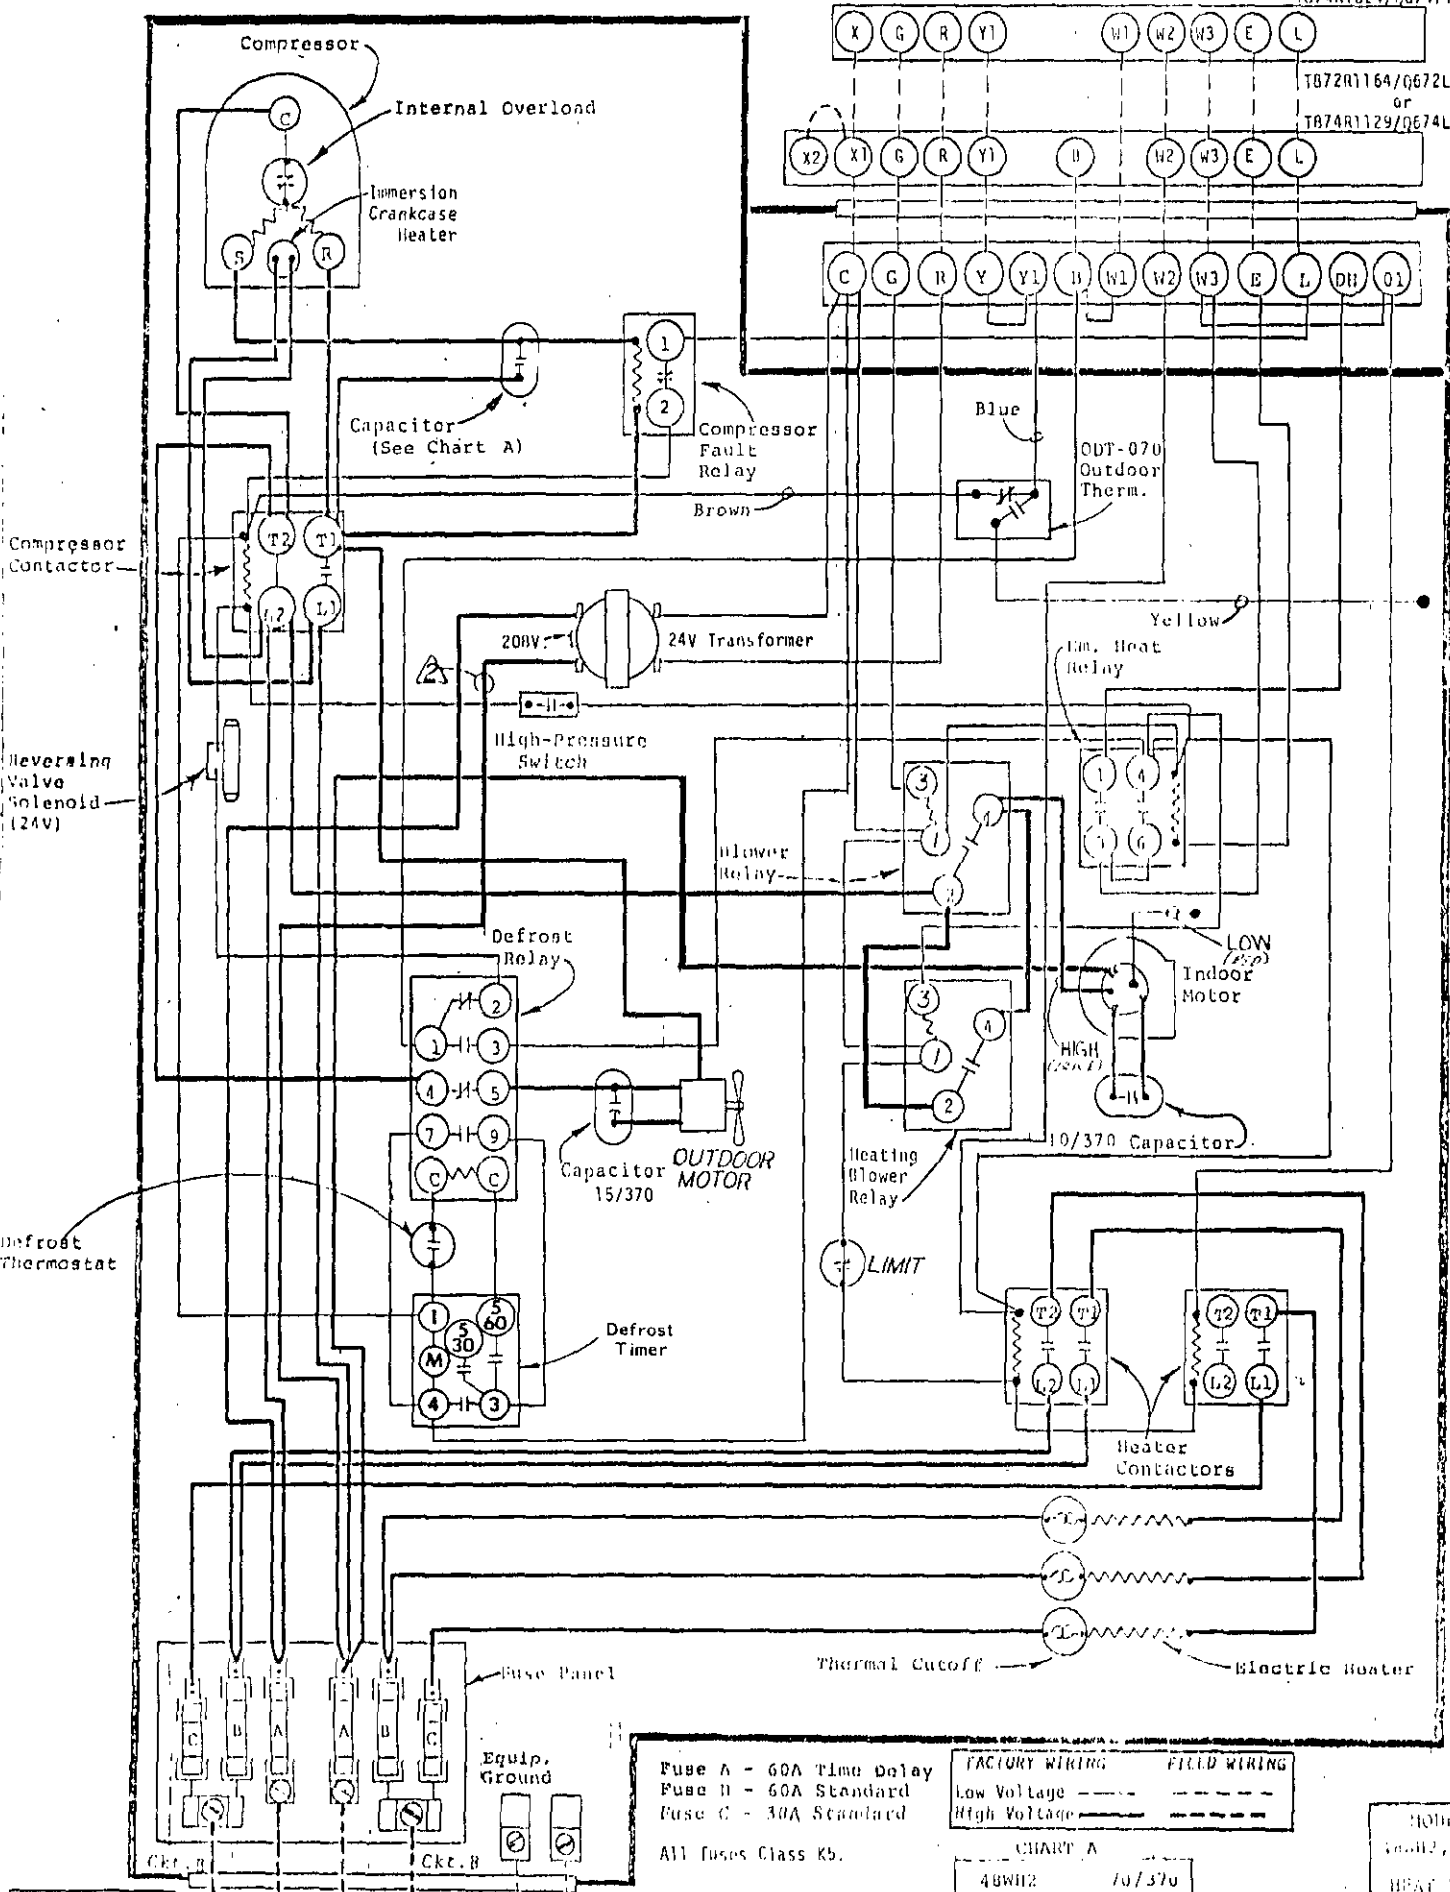

Fuse A - 60A Time Delay  
Fuse B - 60A Standard  
Fuse C - 30A Standard

FACTORY WIRING	FIELD WIRING
Low Voltage	-----
High Voltage	-----

All fuses Class Kb.

CHART A	
48WH2	10/370
49WH5	40/440

MODEL  
4014-801 D  
HEAT PUMP  
15 SW

USE COPPER OR ALUMINUM WIRE

230/208-60-1

⚠ For 208V operation move this wire to 208V transformer tap.

4014-801 D