


⚠ If there is an X1 and X2 terminal on Q674L1181, jumper them together and connect from C to either one.

⚠ For 208V operation move this wire to 208V transformer tap.

⚠ Outdoor Thermostat # 1 factory set at 50 degrees

⚠ Outdoor Thermostat # 2 factory set at 40 Degrees.

T872N1036/Q672F1299
or
T874N1024/Q674F1261

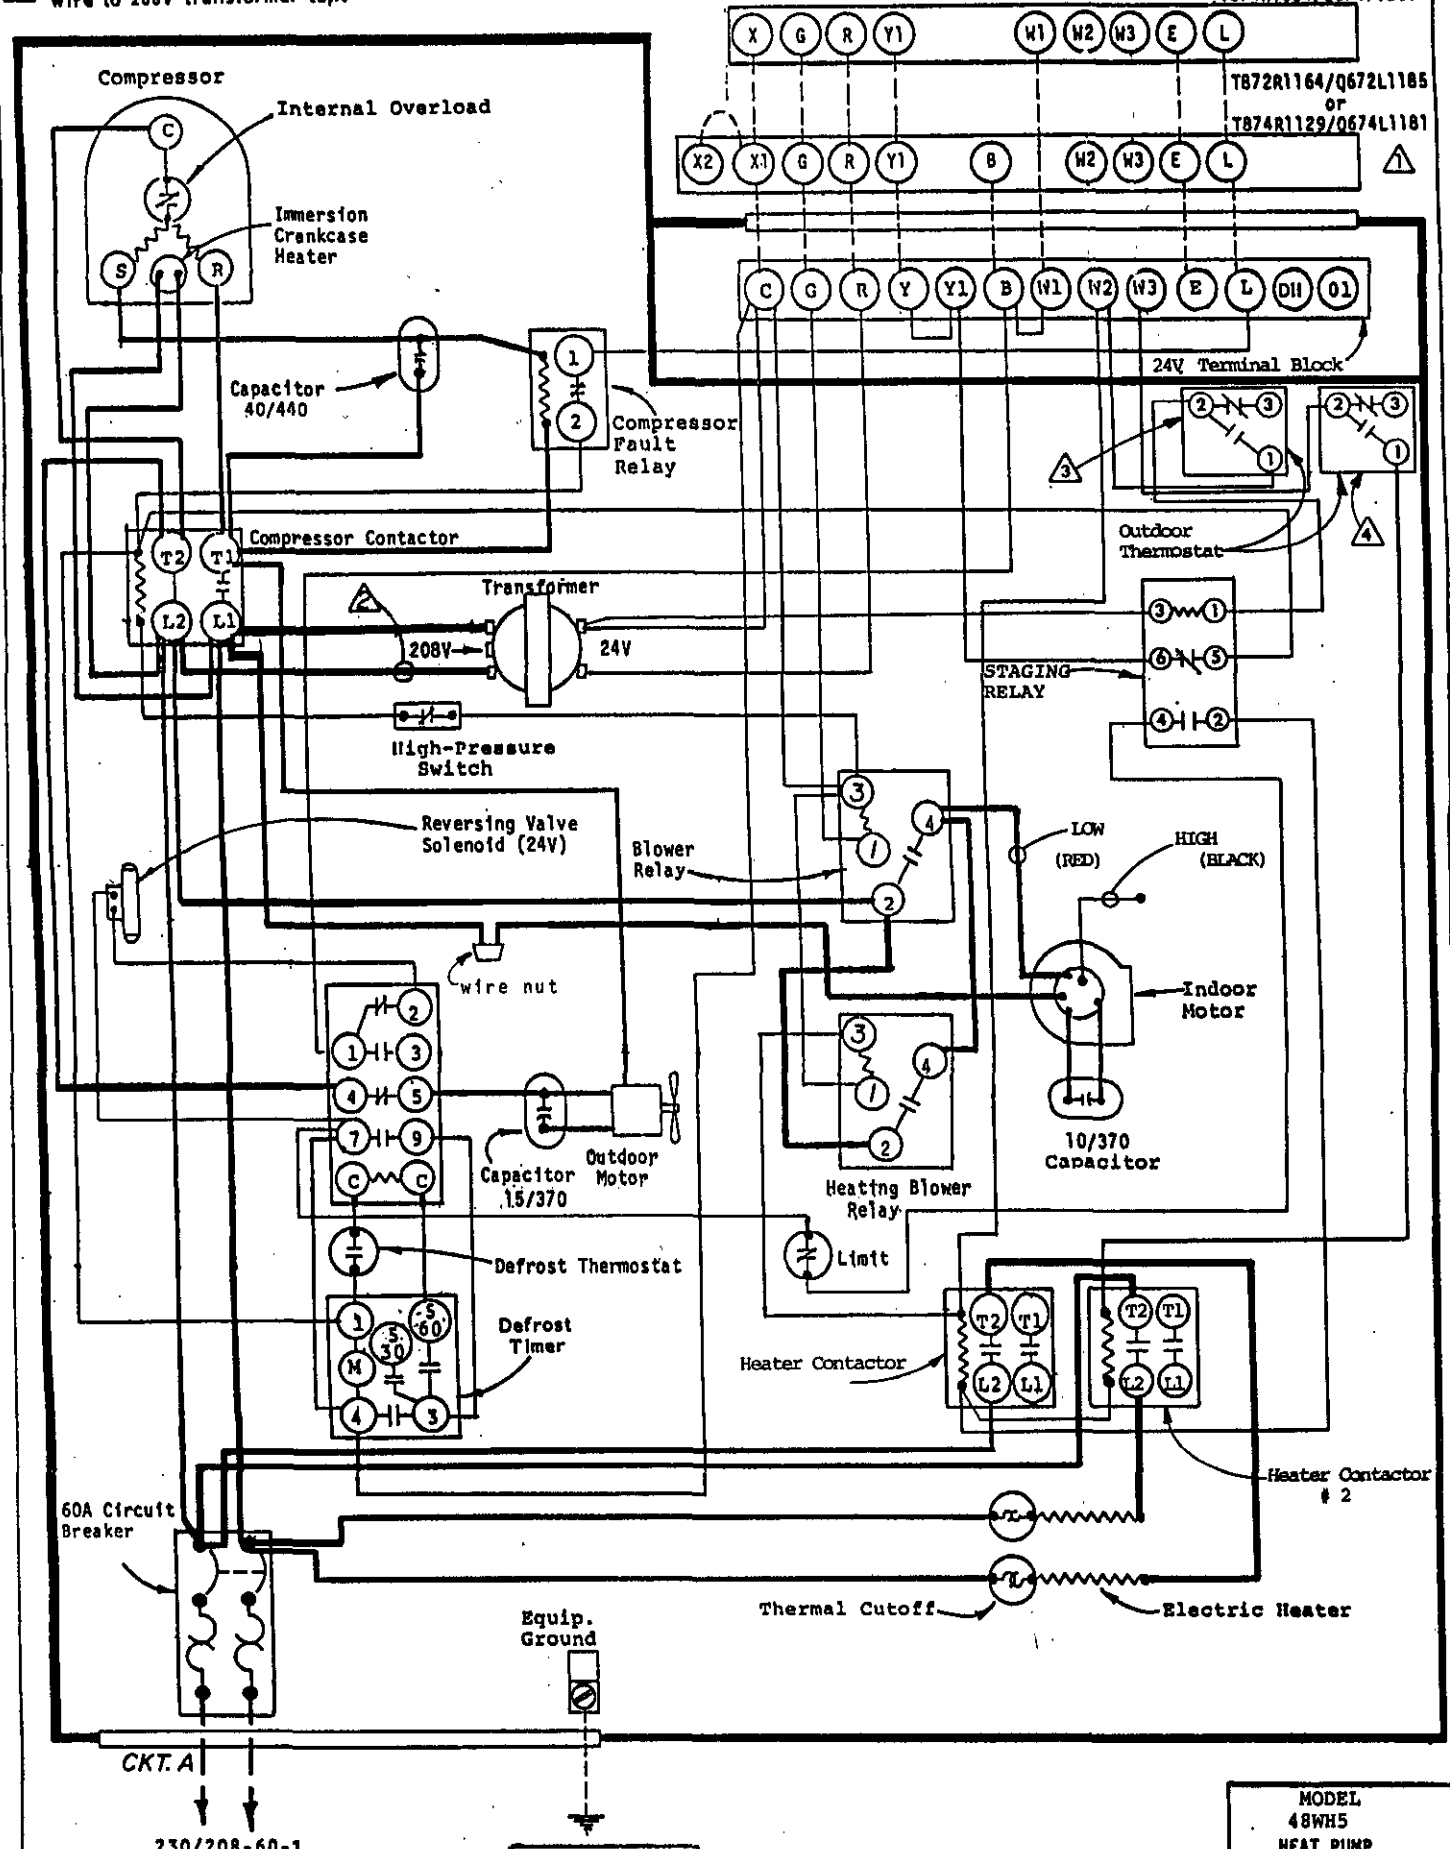

CKT. A
230/208-60-1

USE COPPER OR ALUMINUM WIRE

	FACTORY WIRING	FIELD WIRING
Low Voltage	_____	-----
High Voltage	_____	-----

CAT. no. 10A5A/OLA

MODEL
48WH5
HEAT PUMP
10 Kw

4014-821 E