


⚠ If there is an X1 and X2 terminal on Q674L1181, jumper them together and connect from C to either one.

⚠ Outdoor thermostat factory set at 25°

⚠ For 208V operation move this wire to 208V transformer tap.

T874N1024/Q674F1261

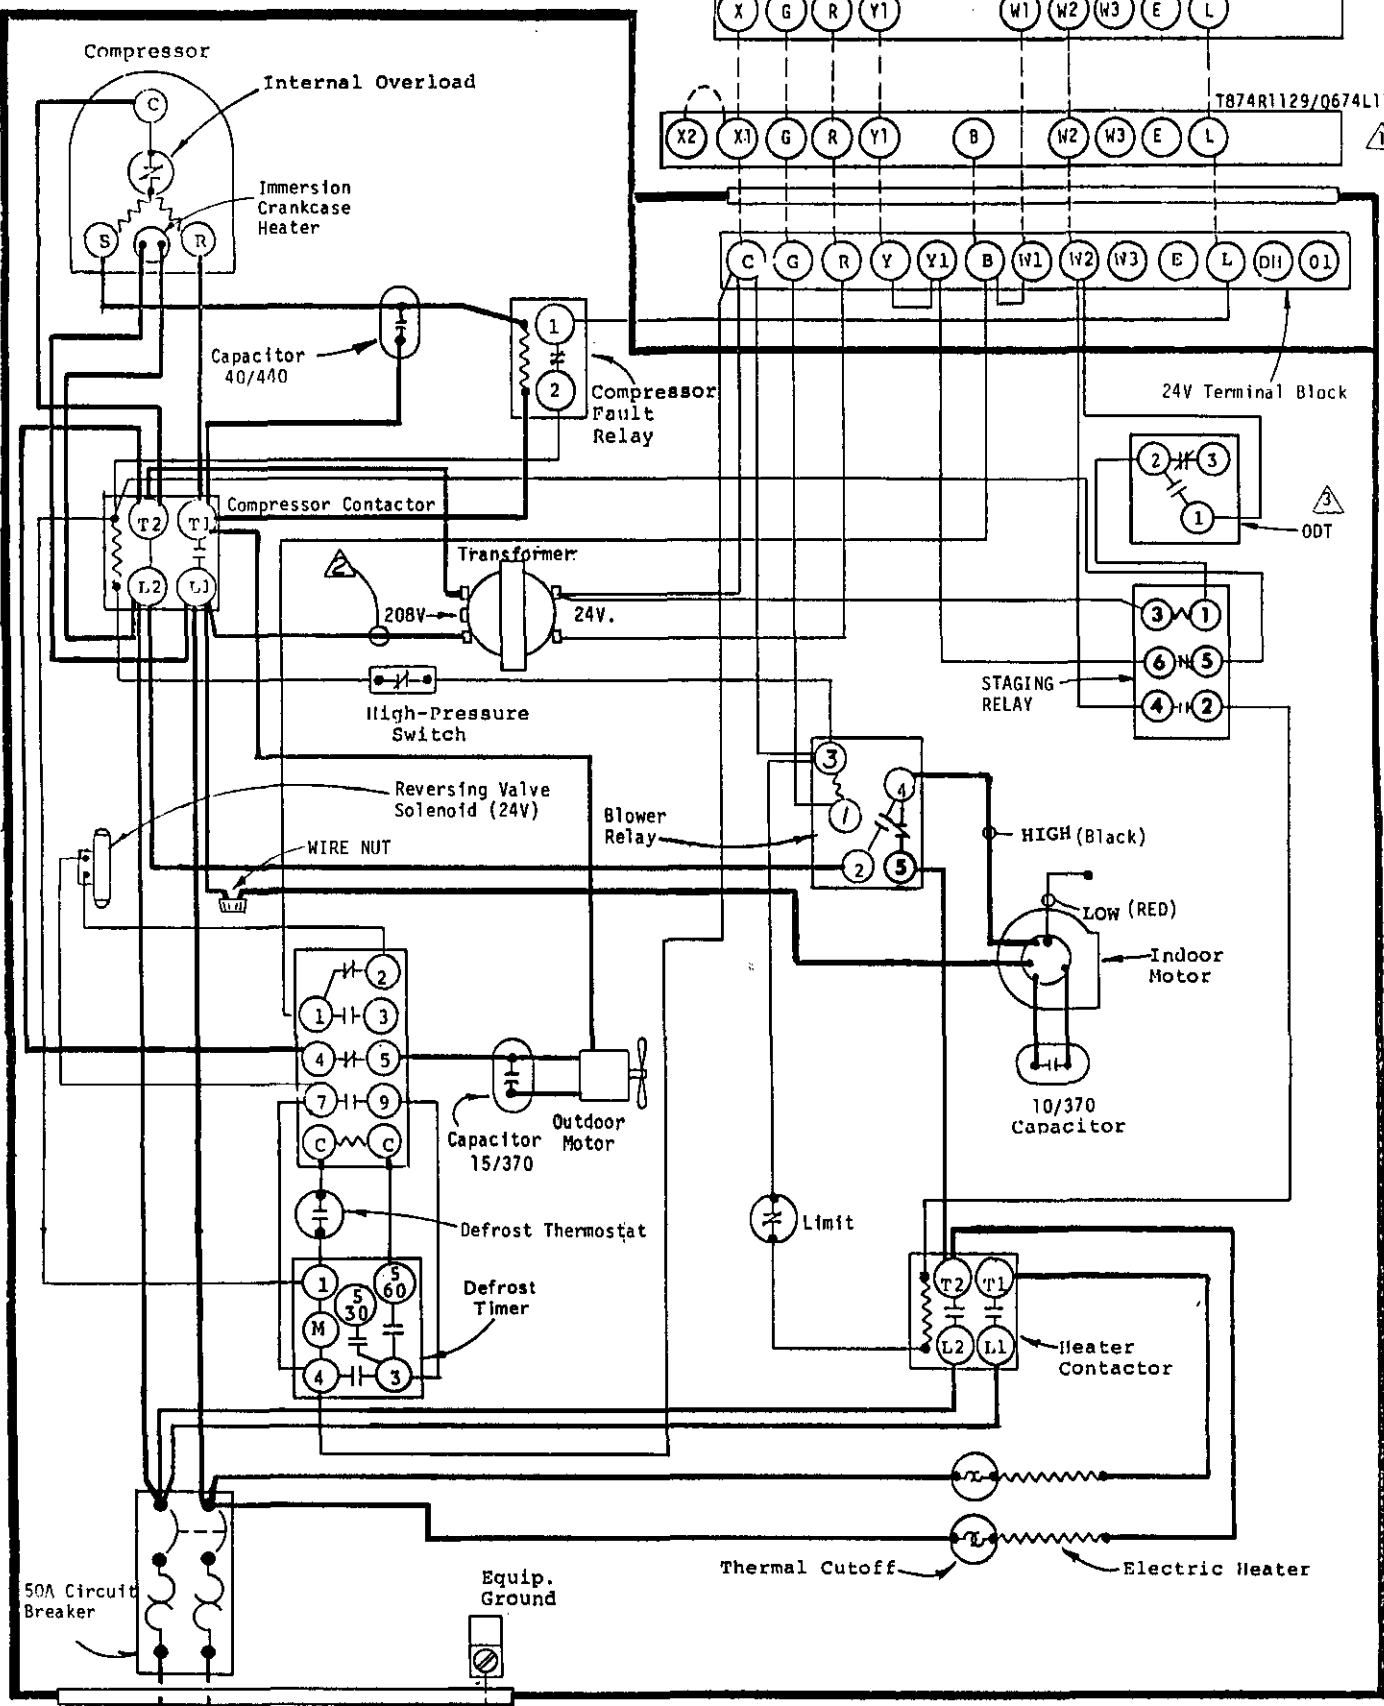

230/208-60-1

Equip. Ground

USE COPPER OR ALUMINUM WIRE

	FACTORY WIRING	FIELD WIRING
Low Voltage	————	-----
High Voltage	————	-----