


SPLIT SYSTEM AIR CONDITIONERS
36ECQ4
230V 60 Hz 1-Ph

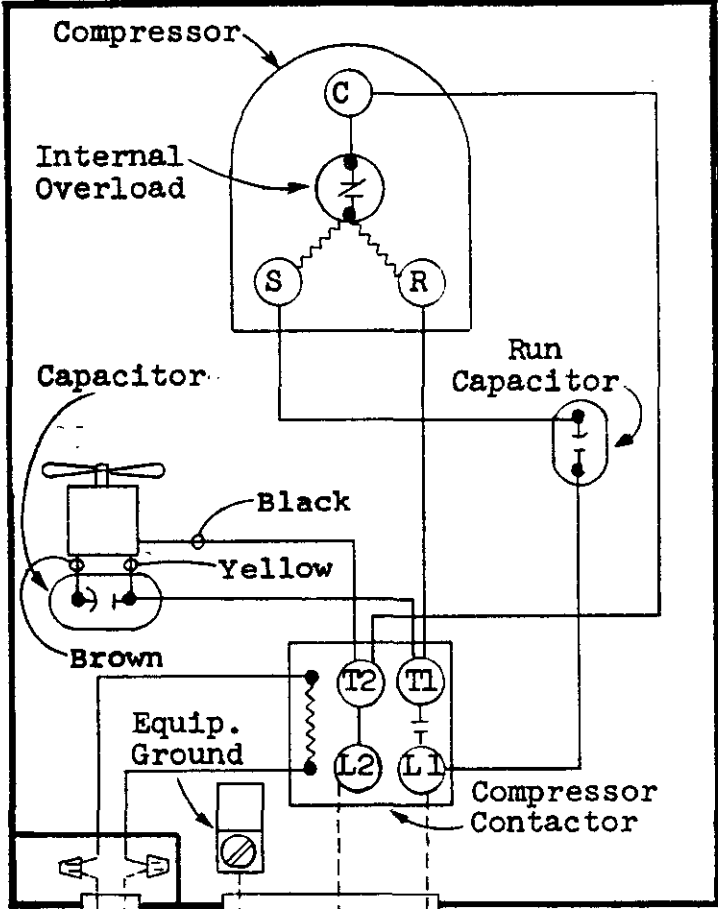

Use Minimum
Transformer
Rating of 40VA

C Y
24V

Factory Wiring

Field Wiring

Use Copper
Conductors
Only

Fused
Disconnect
Switch

230-60-1

4023-110A

6471