


SPLIT SYSTEM AIR CONDITIONERS
 36ECQ4 & 42ECQ
 415/240V 50Hz 3PH

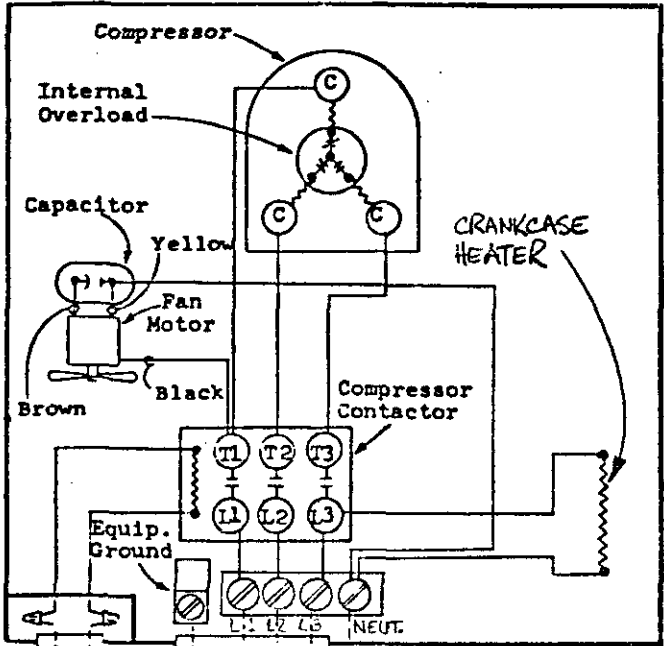

Use Minimum
 Transformer
 Rating of 40VA

C Y
 24V

Factory Wiring

Field Wiring

Use Copper
 Conductors
 Only

Fused
 Disconnect
 Switch

415/240V 50Hz 3ph

4023-610