



REFER TO INSTALLATION INSTRUCTIONS FOR CONTROL CIRCUIT WIRING.

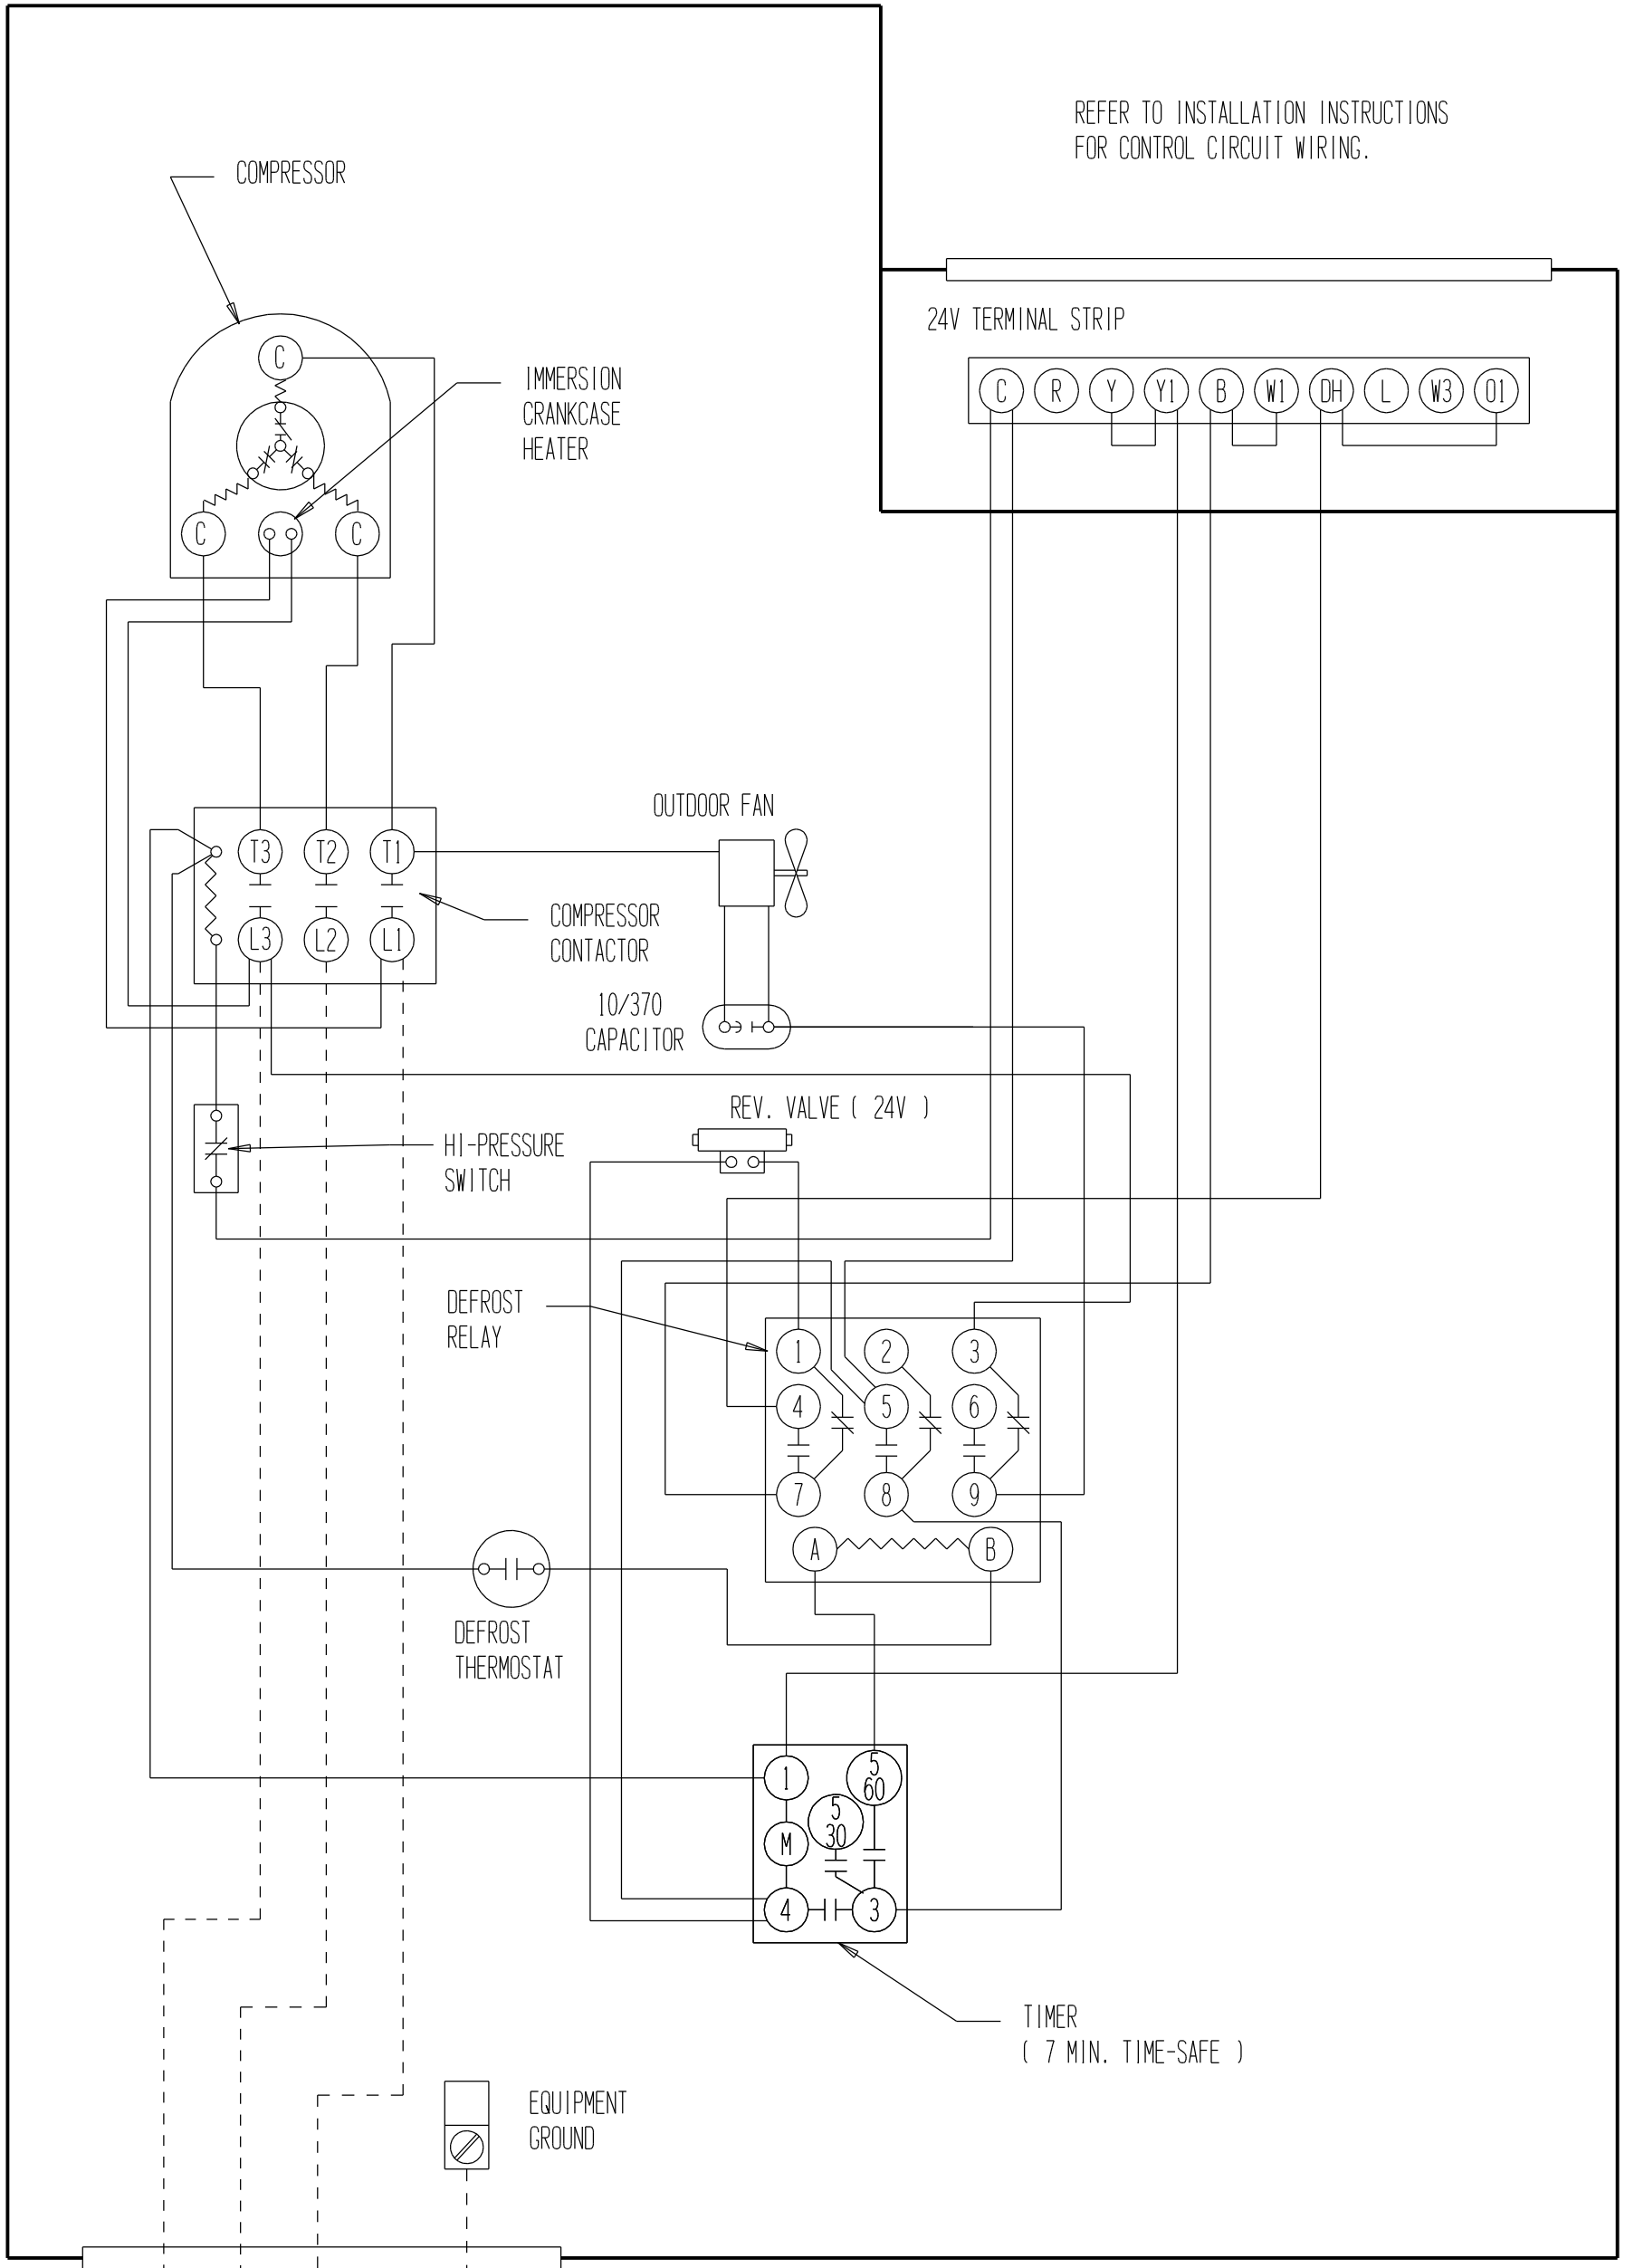

24V TERMINAL STRIP



OUTDOOR FAN

COMPRESSOR CONTACTOR

10/370 CAPACITOR

REV. VALVE ( 24V )

HI-PRESSURE SWITCH


DEFROST RELAY

DEFROST THERMOSTAT

TIMER ( 7 MIN. TIME-SAFE )

EQUIPMENT GROUND

FUSIBLE DISCONNECT SWITCH



USE COPPER CONDUCTORS ONLY

	FACTORY WIRING	FIELD WIRING
Low Voltage	—	- - - -
High Voltage	—	- - - -