


REFER TO CONTROL CIRCUIT WIRING ON CONTROL PANEL COVER AND INSTALLATION INSTRUCTIONS FOR HOOK-UP OF OPTIONAL DUCT HEATER

SOLENOID VALVE (OPTIONAL)  
KBR246P1-24VAC

CHECK LIGHT

SET HEAT ANTICIPATOR AT  
.45A FOR EITHER TYPE OF  
WALL THERMOSTAT

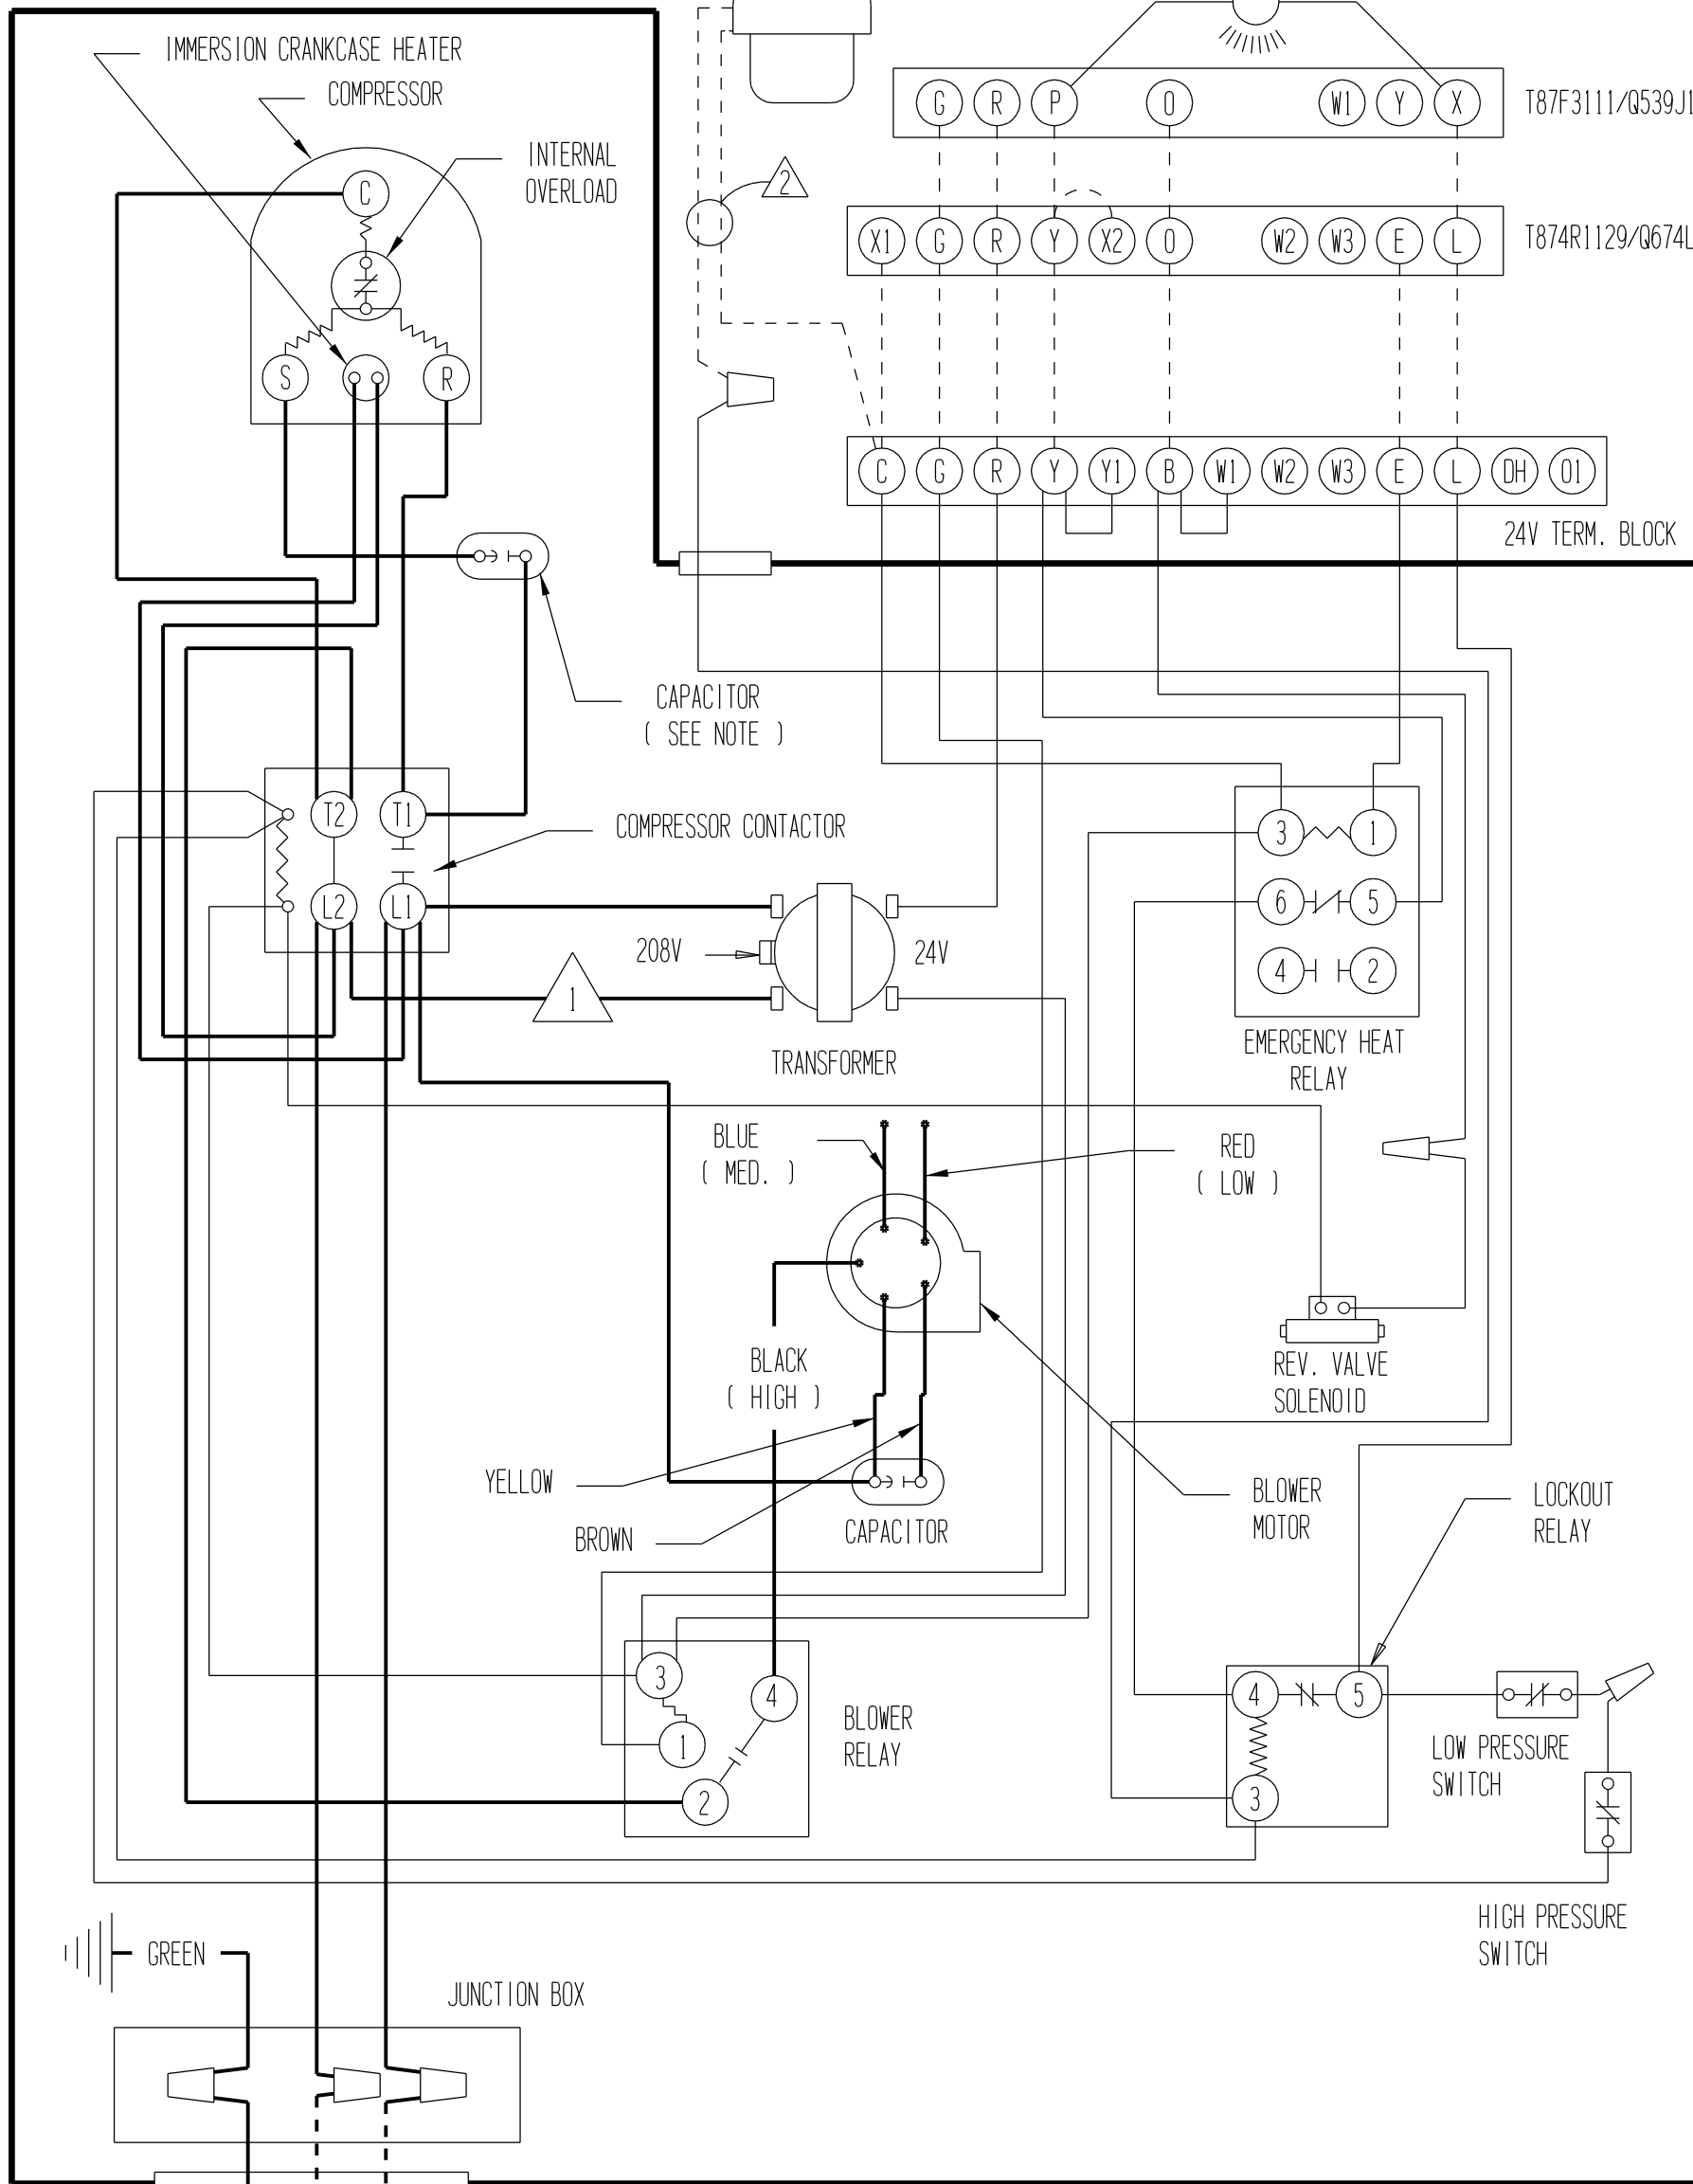

- ▲ FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP
- ▲ USE WIRING RATED FOR USE IN NEC CLASS 1 SYSTEM

230/208 - 60 - 1

USE COPPER  
CONDUCTORS ONLY

	FACTORY WIRING	FIELD WIRING
Low Voltage	—	- - - -
High Voltage	—	- - - -

CAPACITOR RATINGS		
MODEL	COMPRESSOR	BLOWER
WPV53B	40/440	7.5/370
WPV62B	45/440	7.5/370