


REFER TO CONTROL CIRCUIT WIRING ON CONTROL PANEL COVER AND INSTALLATION INSTRUCTIONS FOR HOOK-UP OF OPTIONAL DUCT HEATER

SOLENOID VALVE (OPTIONAL)

CHECK LIGHT

SET HEAT ANTICIPATOR AT .45A FOR EITHER TYPE OF WALL THERMOSTAT

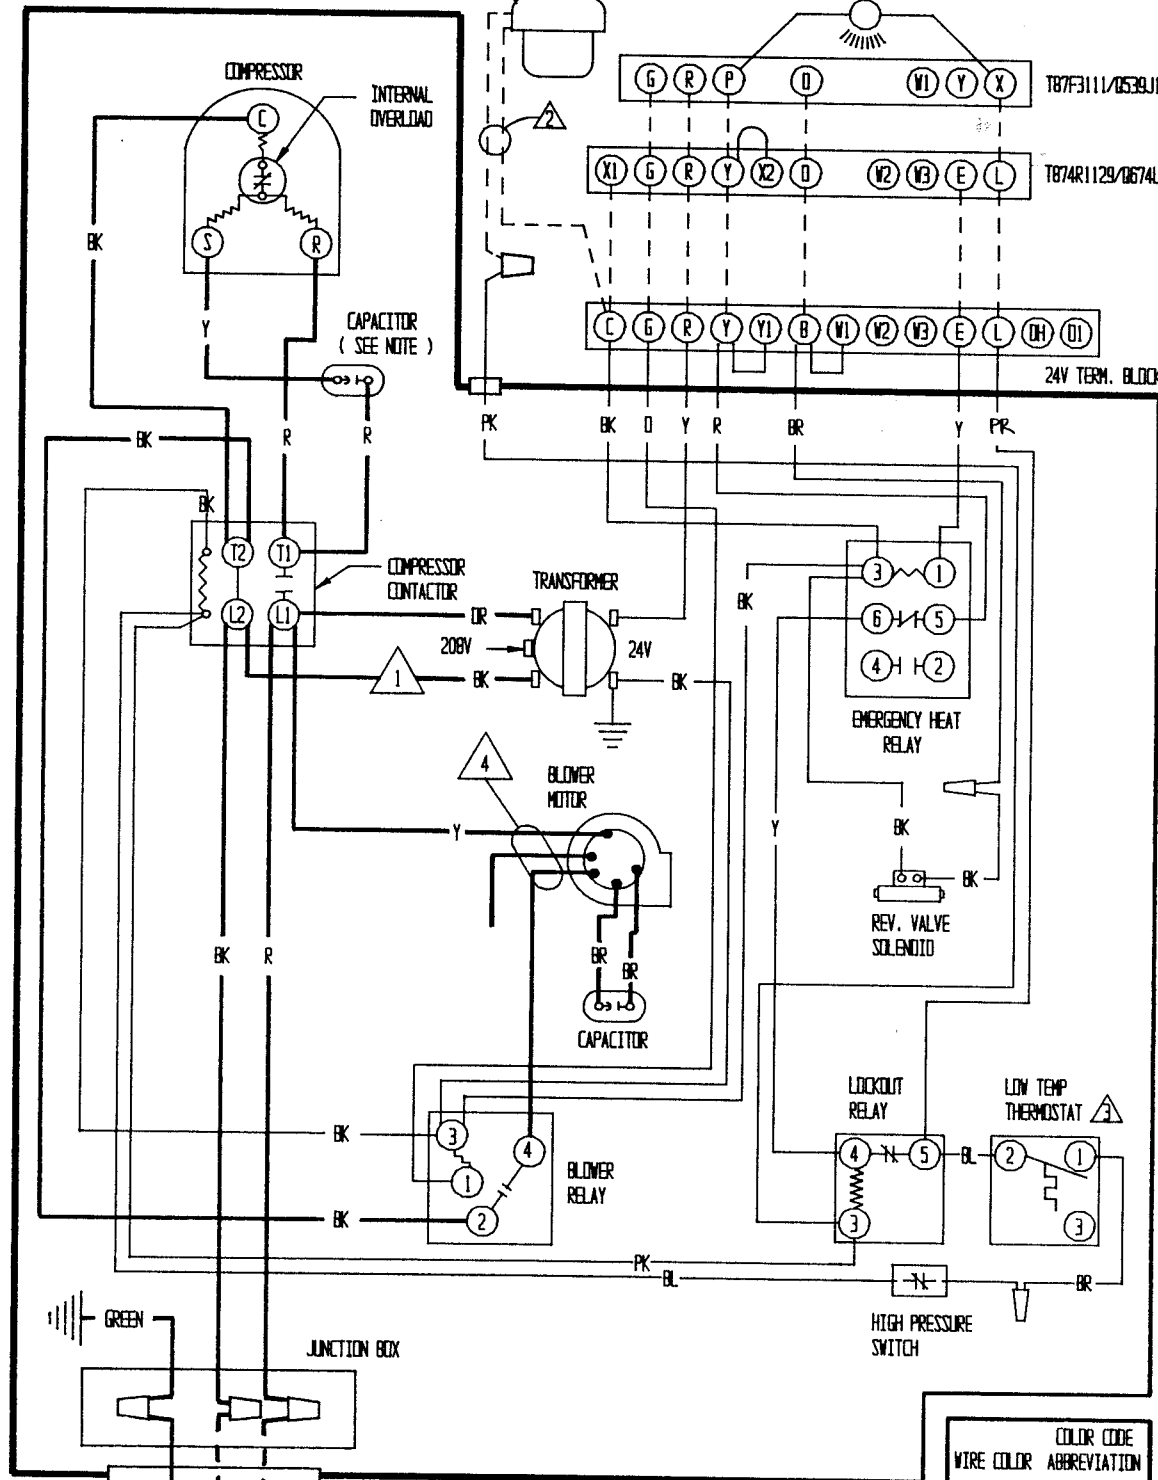

T87F3111/0539J1089

T874R1129/0674L1181

24V TERM. BLOCK

USE COPPER CONDUCTORS RATED FOR MINIMUM OF 75° C ONLY

230/208 - 60 - 1

**⚠** FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP

**⚠** USE WIRING RATED FOR USE IN NEC CLASS 1 SYSTEM

**⚠** FACTORY SET AT 35° FOR OPEN LOOP APPLICATION  
RESET TO 15°F FOR CLOSED LOOP APPLICATIONS

	FACTORY WIRING	FIELD WIRING
	Low Voltage	_____
High Voltage	_____	_____

COLOR CODE	
WIRE COLOR	ABBREVIATION
BLACK	BK
BROWN	BR
RED	R
ORANGE	O
YELLOW	Y
GREEN	G
BLUE	BL
VIOLET(PURPLE)	V(PR)
GRAY(SLATE)	GY(S)
WHITE	W
TAN	T
PINK	PK
LAVENDER	L

MODEL	BLOWER SPEED	CAPACITOR RATINGS	
		COMPRESSOR	BLOWER
WPV30C	LOW	40/370	5/370
WPV36C	HIGH	45/370	5/370

WIRE COLOR	MOTOR SPEED
YELLOW	COMMON
BLACK	HIGH
RED	LOW

4054-114 C