


CONNECTION DIAGRAM

**DANGER: ELECTRICAL SHOCK HAZARD,
DISCONNECT POWER BEFORE SERVICING**

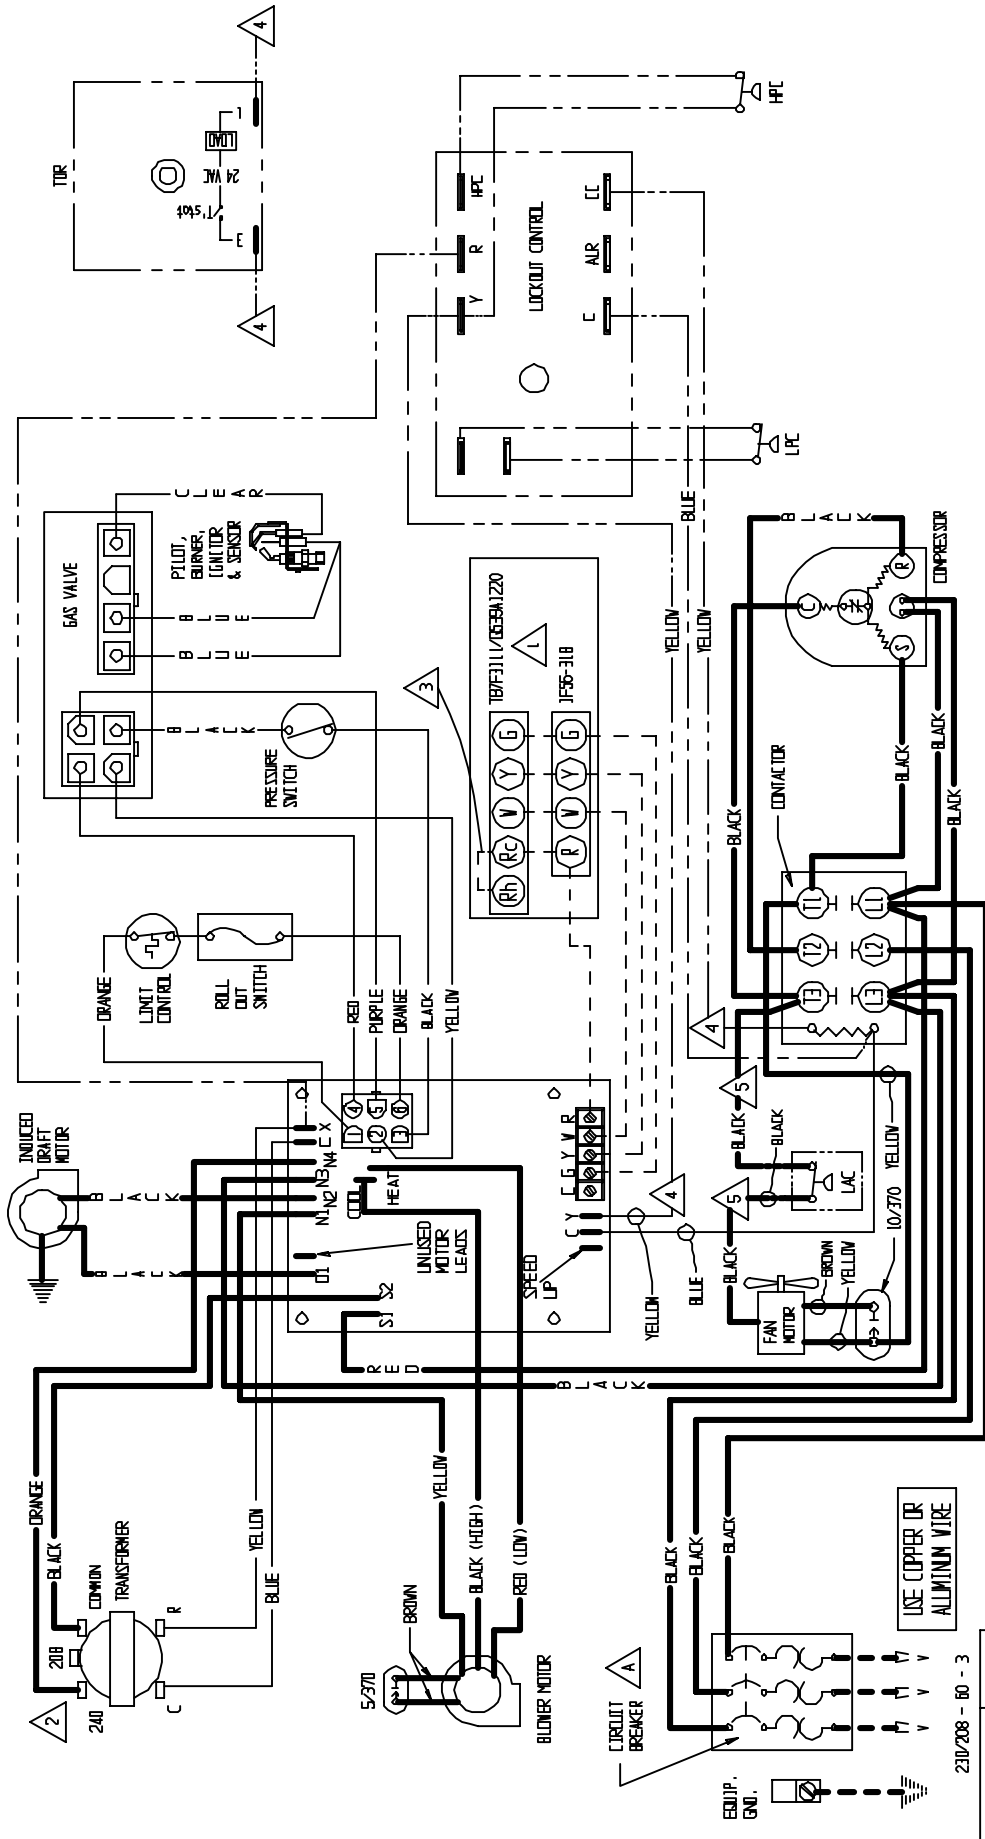

2310208 - 60 - 3

NOTE	CIRCUIT BREAKER
VIC3RD-HEAT	30A
VIC4RD-HEAT	30A

FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE	---	---
LOW VOLTAGE	---	---
ACCESSORY	---	---

- 1 SET HEAT ANTICIPATOR AT .6 A
- 2 FOR 208V OPERATION MOVE THIS WIRE TO 208V TRANSFORMER TAP
- 3 ADD JUMPER RE - R#
- 4 L- LABELED WIRES CONNECT IF NO OPTIONS USED
- 5

IF ANY OF THE ORIGINAL WIRE AS SUPPLIED WITH THE APPLIANCE MUST BE REPLACED, IT MUST BE REPLACED WITH WIRING MATERIAL HAVING A TEMPERATURE RATING OF AT LEAST 105°C EXCEPT THE IGNITION CABLE WHICH IS 250°C HIGH VOLTAGE CABLE.