


USE COPPER CONDUCTORS  
ONLY SUITABLE FOR AT  
LEAST 75° C

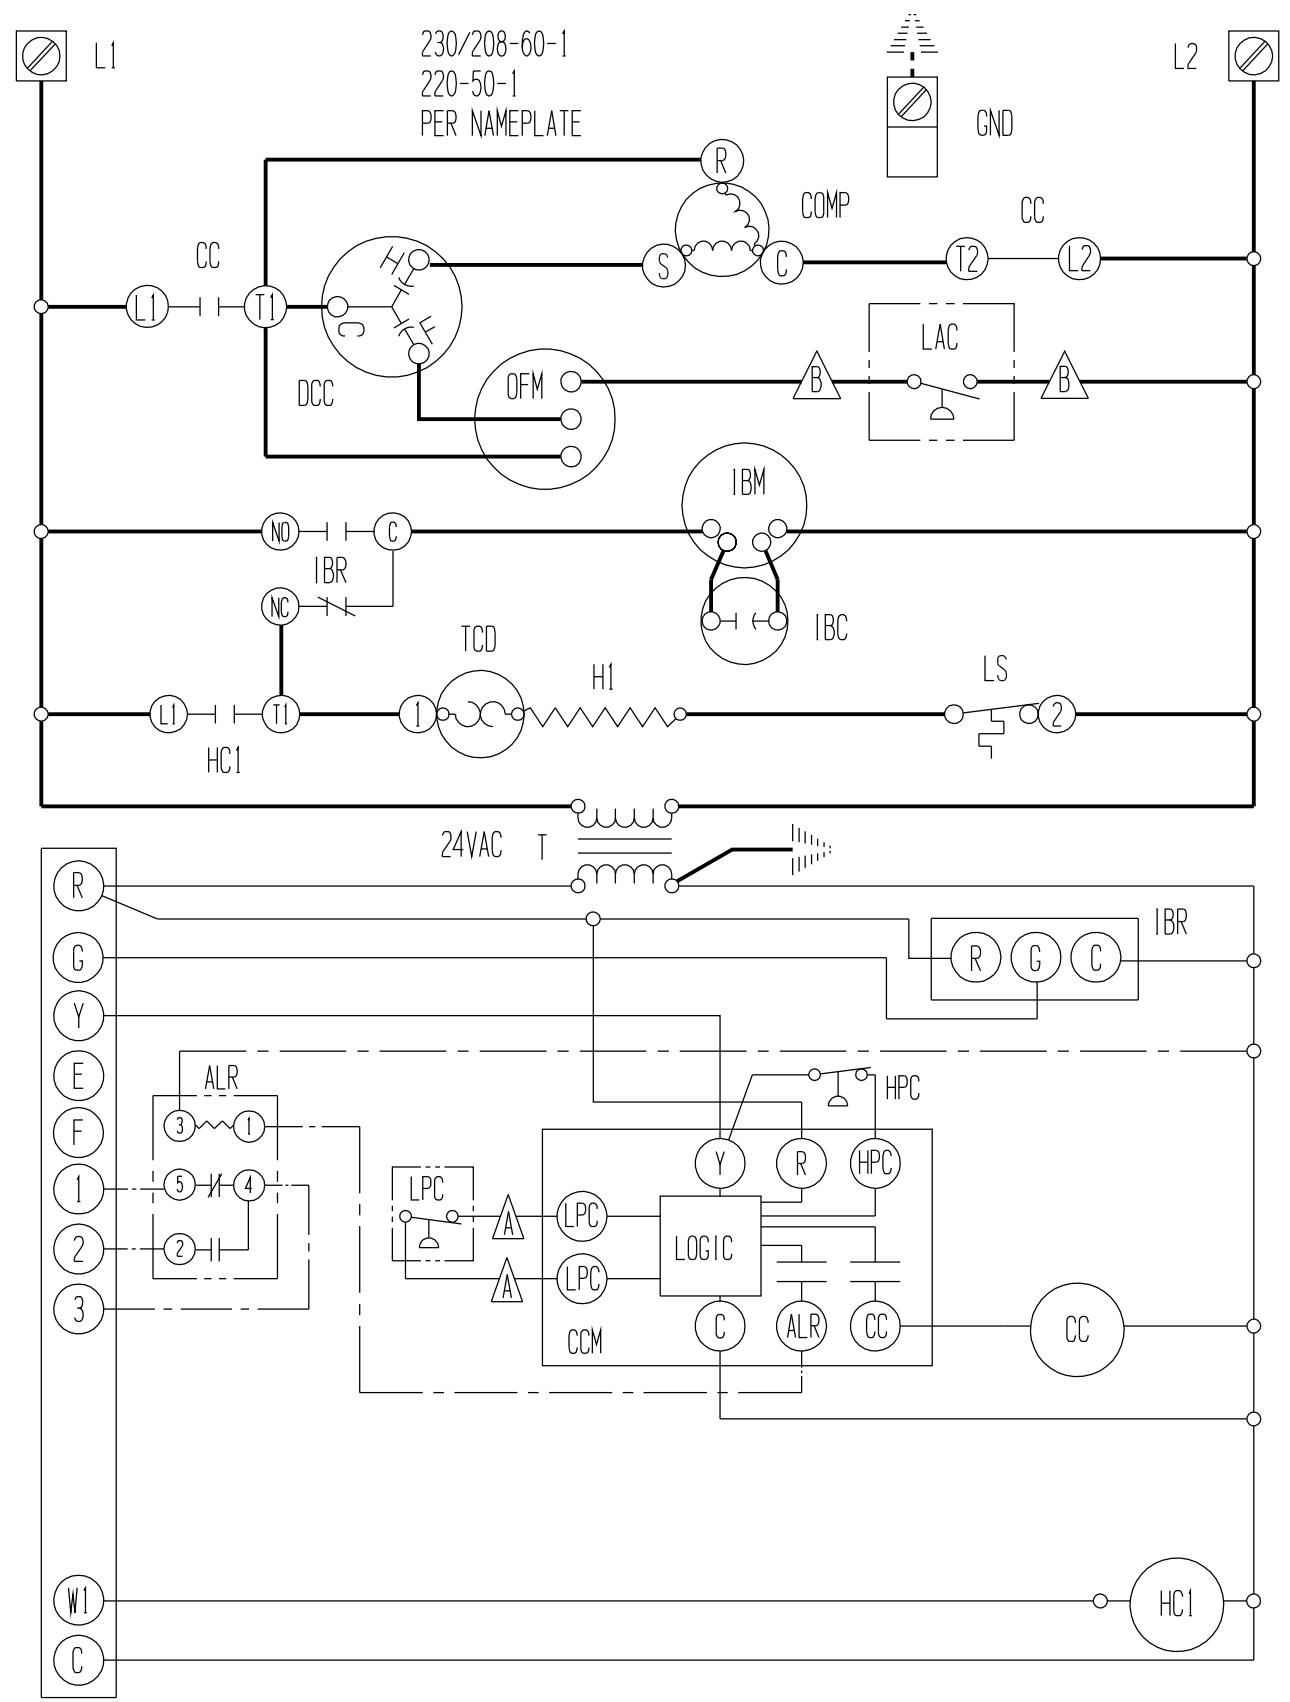

**A** **B** LABELED WIRES CONNECT IF NO OPTIONS USED. **C** MOVE RED WIRE TO 208V TAP FOR 208V OPERATION

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE			
LOW VOLTAGE			
ACCESSORY			

COLOR CODE							
BK	BLACK	Y	YELLOW	V	VIOLET	T	TAN
BR	BROWN	G	GREEN	(PR)	PURPLE	PK	PINK
R	RED	BL	BLUE	GY	GRAY	L	LAVENDER
O	ORANGE	W	WHITE	(S)	SLATE		

**BARD MFG. CO.**  
4095-114 E

COMPONENT CODE			
ALR	ALARM RELAY (OPT.)	LAC	LOW AMBIENT CONTROL (OPT.)
CC	COMPRESSOR CONTACTOR	LPC	LOW PRESSURE CONTROL (OPT.)
CCM	COMPRESSOR CONTROL MODULE	LS	LIMIT SWITCH
COMP	COMPRESSOR	OFM	OUTDOOR FAN MOTOR
DCC	DUAL CAN CAPACITOR	T	TRANSFORMER
GND	EQUIPMENT GROUND	TB	TERMINAL BLOCK
H1	HEAT STRIP #1	TB2	TERMINAL BLOCK 2 (OPT.)
HC1	HEATER CONTACTOR #1	TBL	LOW VOLTAGE TERMINAL BLOCK
HPC	HIGH PRESSURE CONTROL	TCO	THERMAL CUTOFF
IBC	INDOOR BLOWER CAPACITOR		
IBM	INDOOR BLOWER MOTOR		
IBR	INDOOR BLOWER RELAY		