


USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT
LEAST 75° C

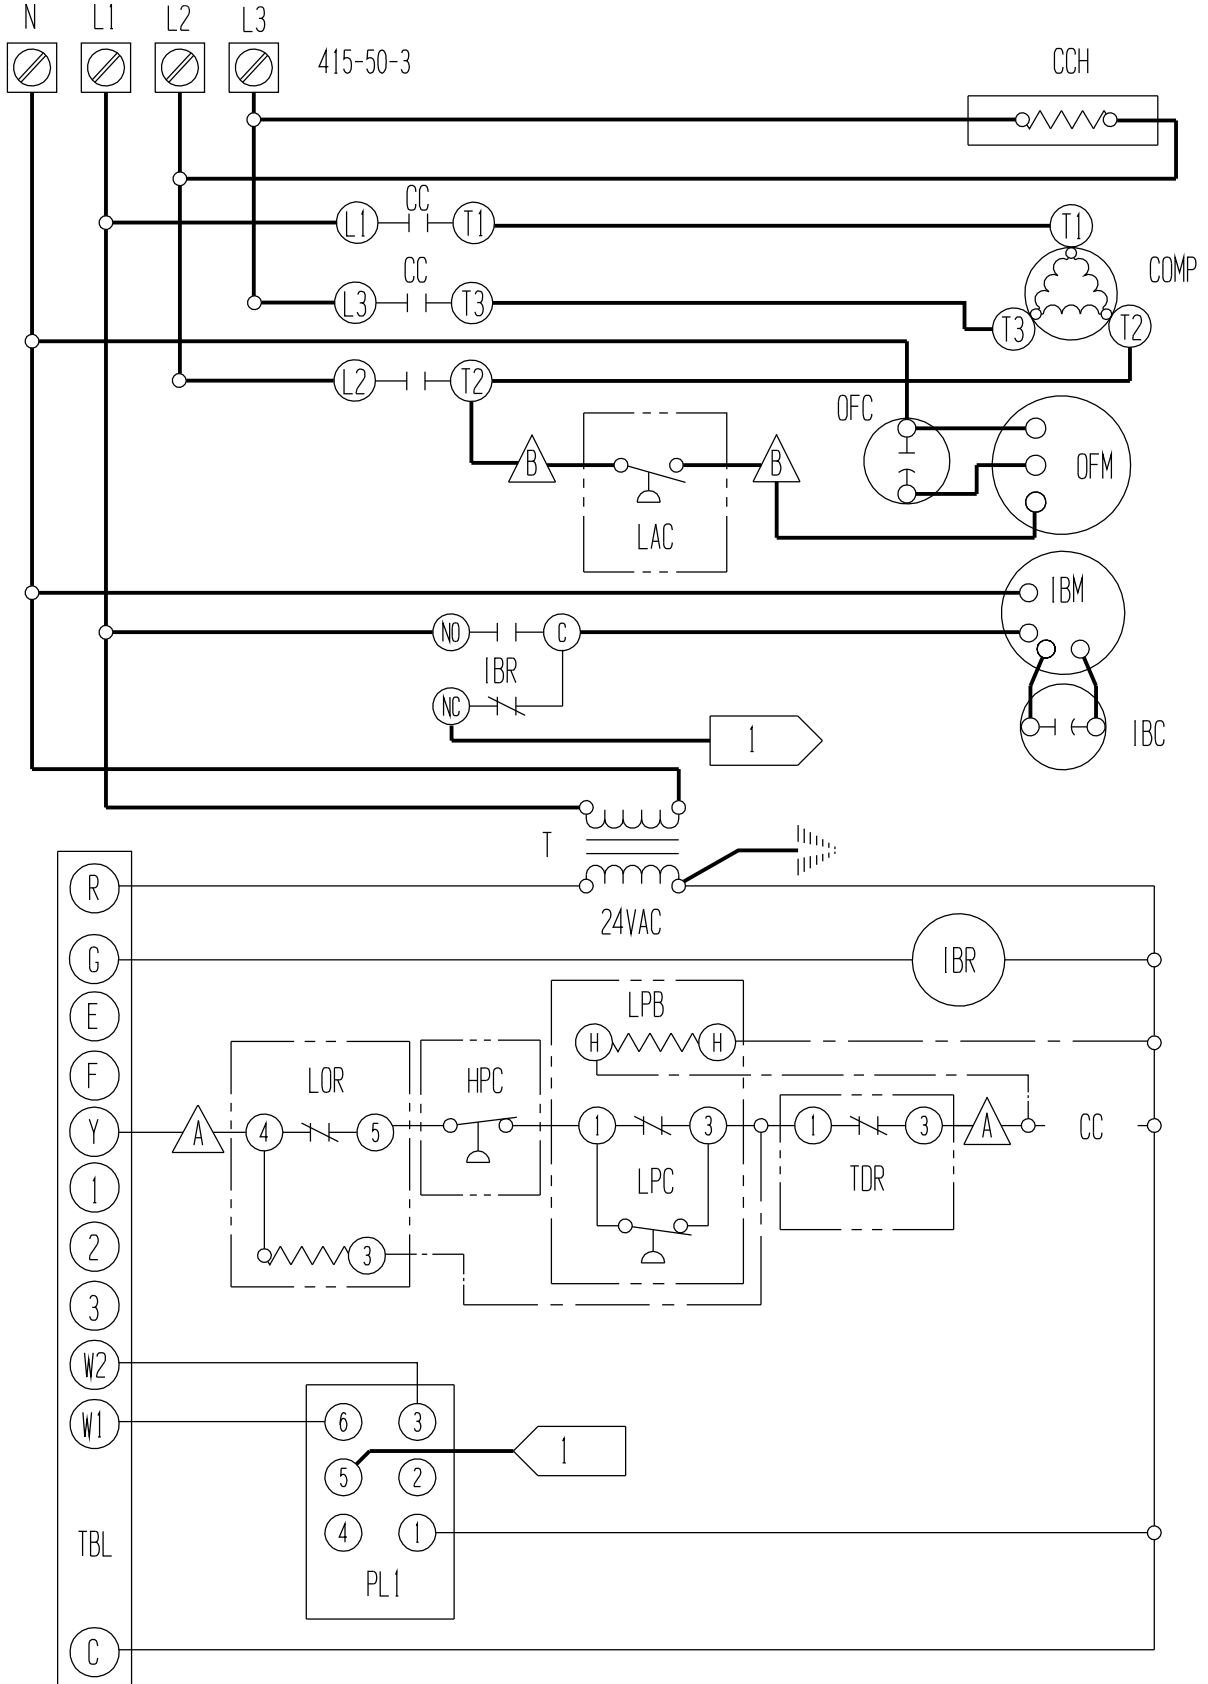

COMPONENT CODE			
CC	COMPRESSOR CONTACTOR	LPB	LOW PRESSURE BYPASS
CCH	COMPRESSOR CRANKCASE HEATER	LPC	LOW PRESSURE CONTROL
COMP	COMPRESSOR	LS	LIMIT SWITCH
GND	EQUIPMENT GROUND	OFC	OUTDOOR FAN CAPACITOR
H1	HEAT STRIP #1	OFM	OUTDOOR FAN MOTOR
H2	HEAT STRIP #2	OFR	OUTDOOR FAN RELAY
HC1	HEATER CONTACTOR #1	PD	PULL DISCONNECT
HC2	HEATER CONTACTOR #2	PL1	PLUG #1
HPC	HIGH PRESSURE CONTROL	T	TRANSFORMER
IBC	INDOOR BLOWER CAPACITOR	TB	TERMINAL BLOCK
IBM	INDOOR BLOWER MOTOR	TBL	LOW VOLTAGE TERMINAL BLOCK
IBR	INDOOR BLOWER RELAY	TCO	THERMAL CUTOFF
LAC	LOW AMBIENT CONTROL	TDR	TIME DELAY RELAY
LOR	LOCK OUT RELAY		

LABELED WIRES CONNECT IF NO OPTIONS USED.

MOVE RED WIRE TO 208V
TAP FOR 380V OPERATION

	FACTORY STD.	FIELD	OPTIONAL	COLOR CODE							
HIGH VOLTAGE				BK	BLACK	Y	YELLOW	V	VIOLET	T	TAN
LOW VOLTAGE				BR	BROWN	G	GREEN	(PR)	PURPLE	PK	PINK
ACCESSORY				R	RED	BL	BLUE	GY	GRAY	L	LAVENDER
				O	ORANGE	W	WHITE	(S)	SLATE		

BARD MFG. CO.
4095-617 A