
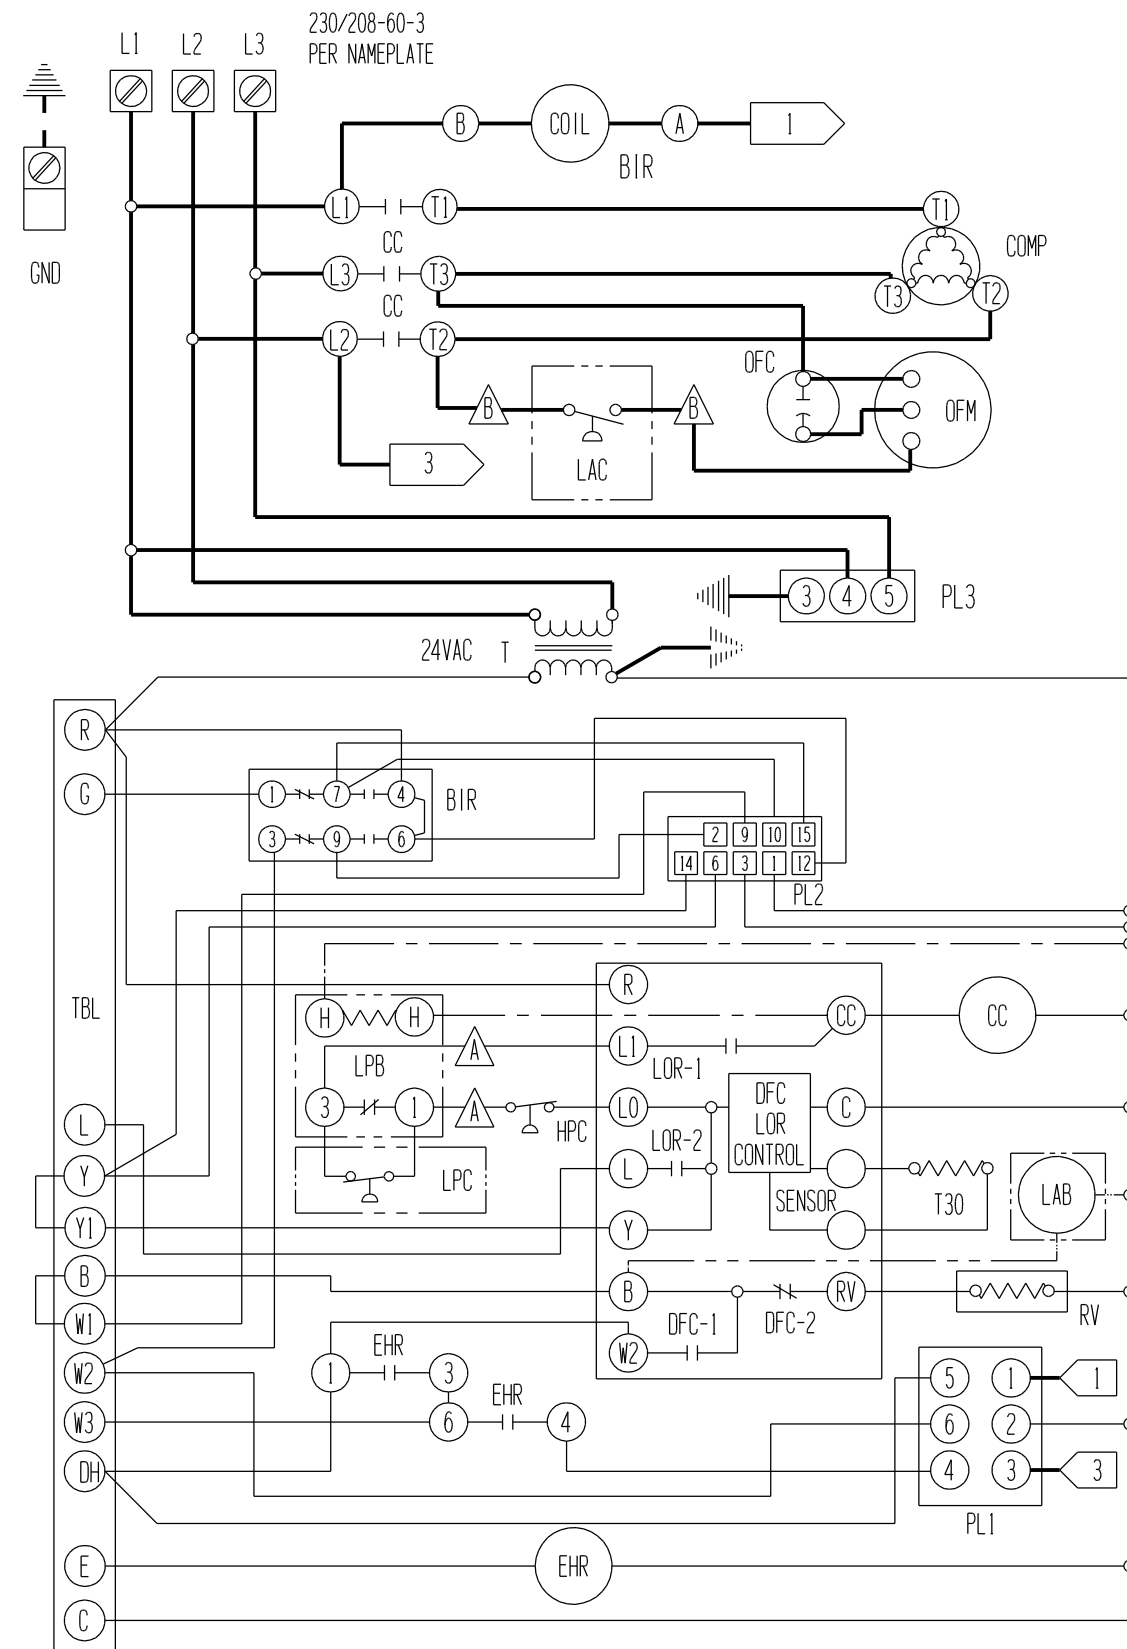


USE COPPER CONDUCTORS ONLY  
SUITABLE FOR AT LEAST 75° C

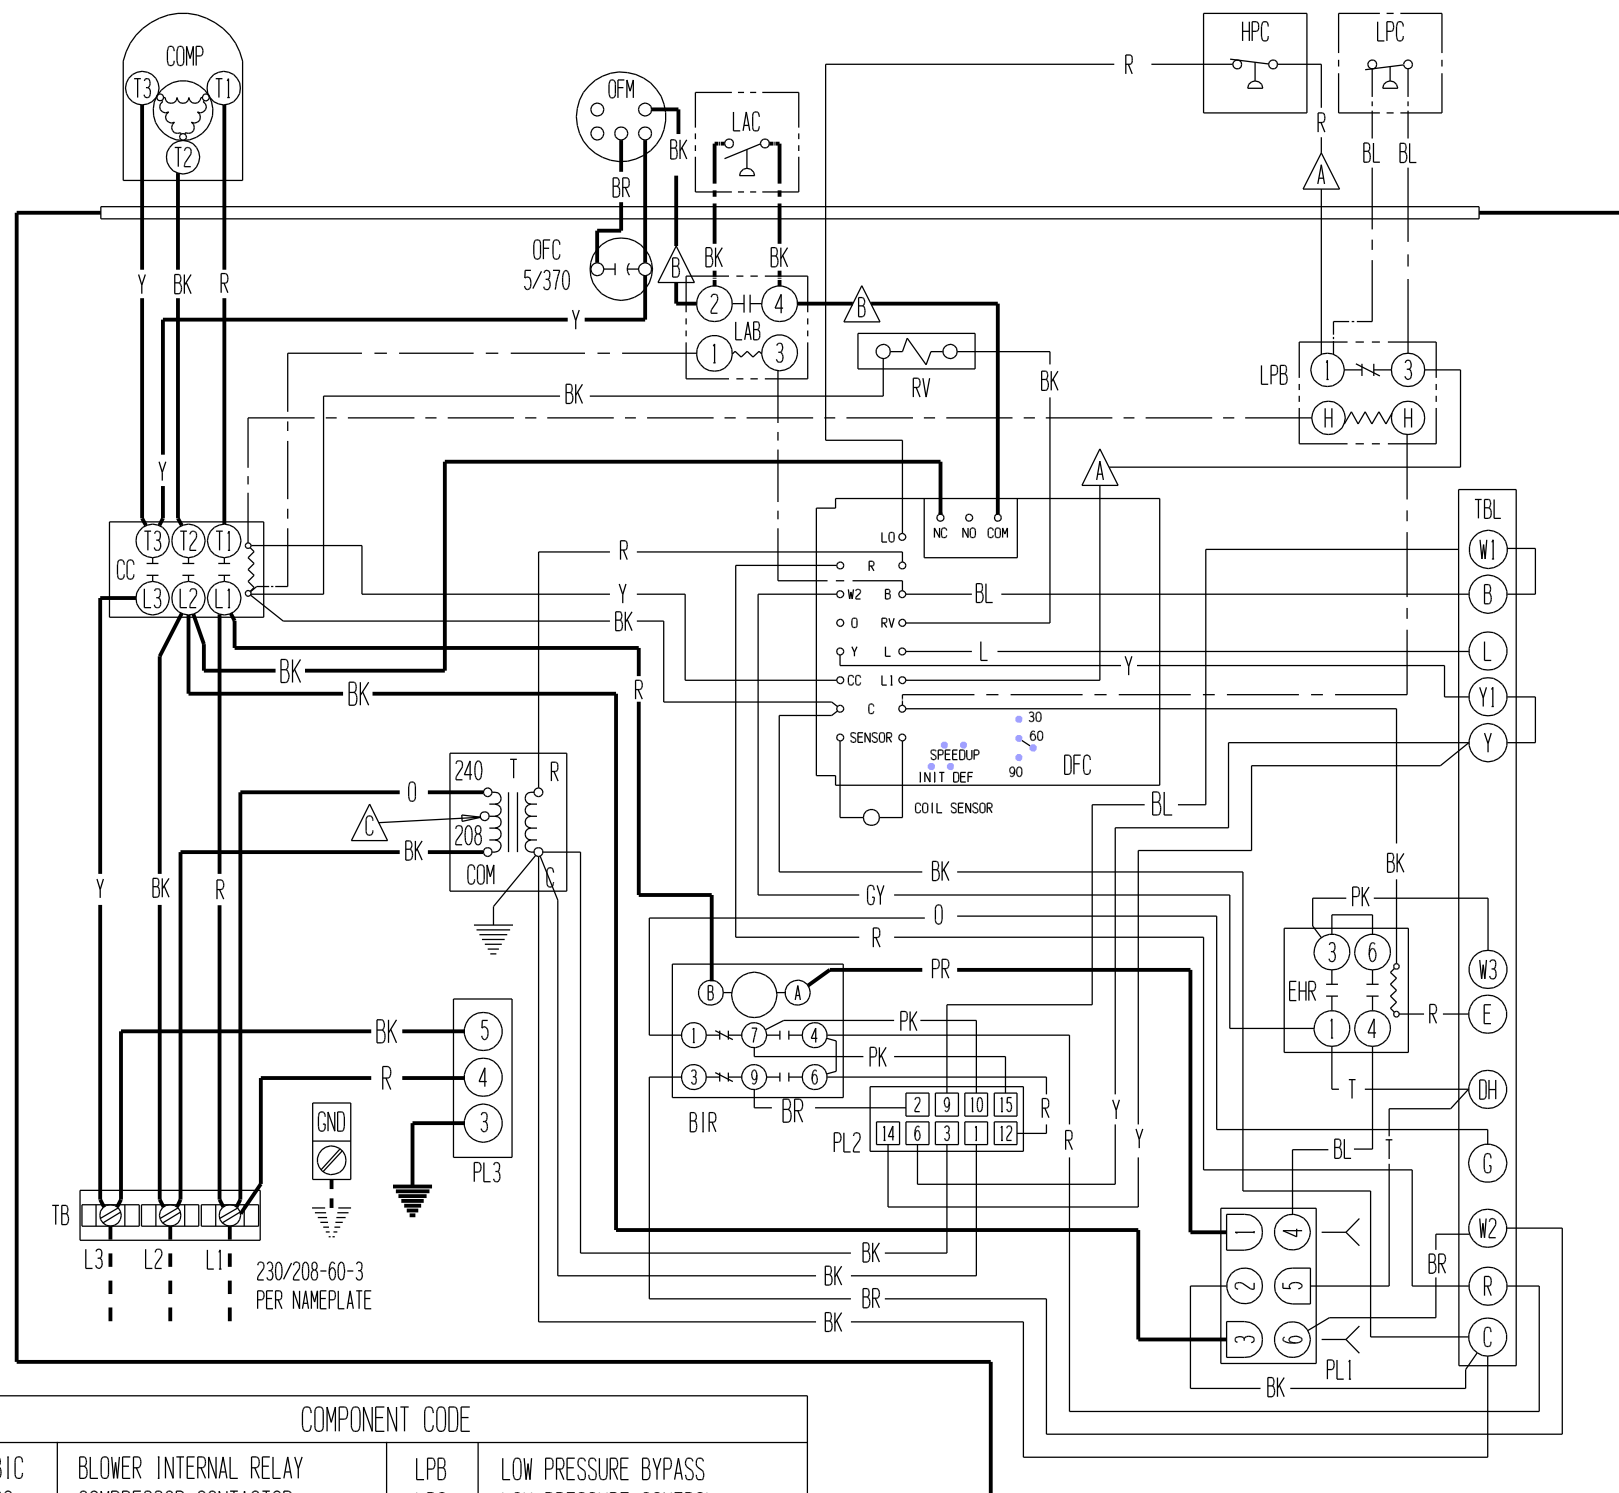

COMPONENT CODE			
BIC	BLOWER INTERNAL RELAY	LPB	LOW PRESSURE BYPASS
CC	COMPRESSOR CONTACTOR	LPC	LOW PRESSURE CONTROL
COMP	COMPRESSOR	OFM	OUTDOOR FAN MOTOR
DFC	DEFROST CONTROL	PL1	PLUG #1
EHR	EMERGENCY HEAT RELAY	PL2	PLUG #2
GND	EQUIPMENT GROUND	PL3	PLUG #3
HPC	HIGH PRESSURE CONTROL	RV	REV. VALVE SOLINOID
IBC	INDOOR BLOWER CAPACITOR	TCT	TOP CAP THERMOSTAT
IBM	INDOOR BLOWER MOTOR	T	TRANSFORMER
IBR	INDOOR BLOWER RELAY	TB	TERMINAL BLOCK
LAB	LOW AMBIENT BYPASS CONTROL	TBL	LOW VOLTAGE TERMINAL BLOCK
LAC	LOW AMBIENT CONTROL	OFC	OUTDOOR FAN CAPACITOR

A , B LABELED WIRES CONNECT IF NO OPTIONS USED. C MOVE RED WIRE TO 208V TAP FOR 208V OPERATION

		COLOR CODE			
	FACTORY STD.	FIELD	OPTIONAL		
HIGH VOLTAGE				BK	BLACK
LOW VOLTAGE				BR	BROWN
ACCESSORY				R	RED
				O	ORANGE
				Y	YELLOW
				G	GREEN
				BL	BLUE
				W	WHITE
				V	VIOLET
				(PR)	PURPLE
				GY	GRAY
				(S)	SLATE
				T	TAN
				PK	PINK
				L	LAVENDER

**BARD MFG. CO.**  
4098-211