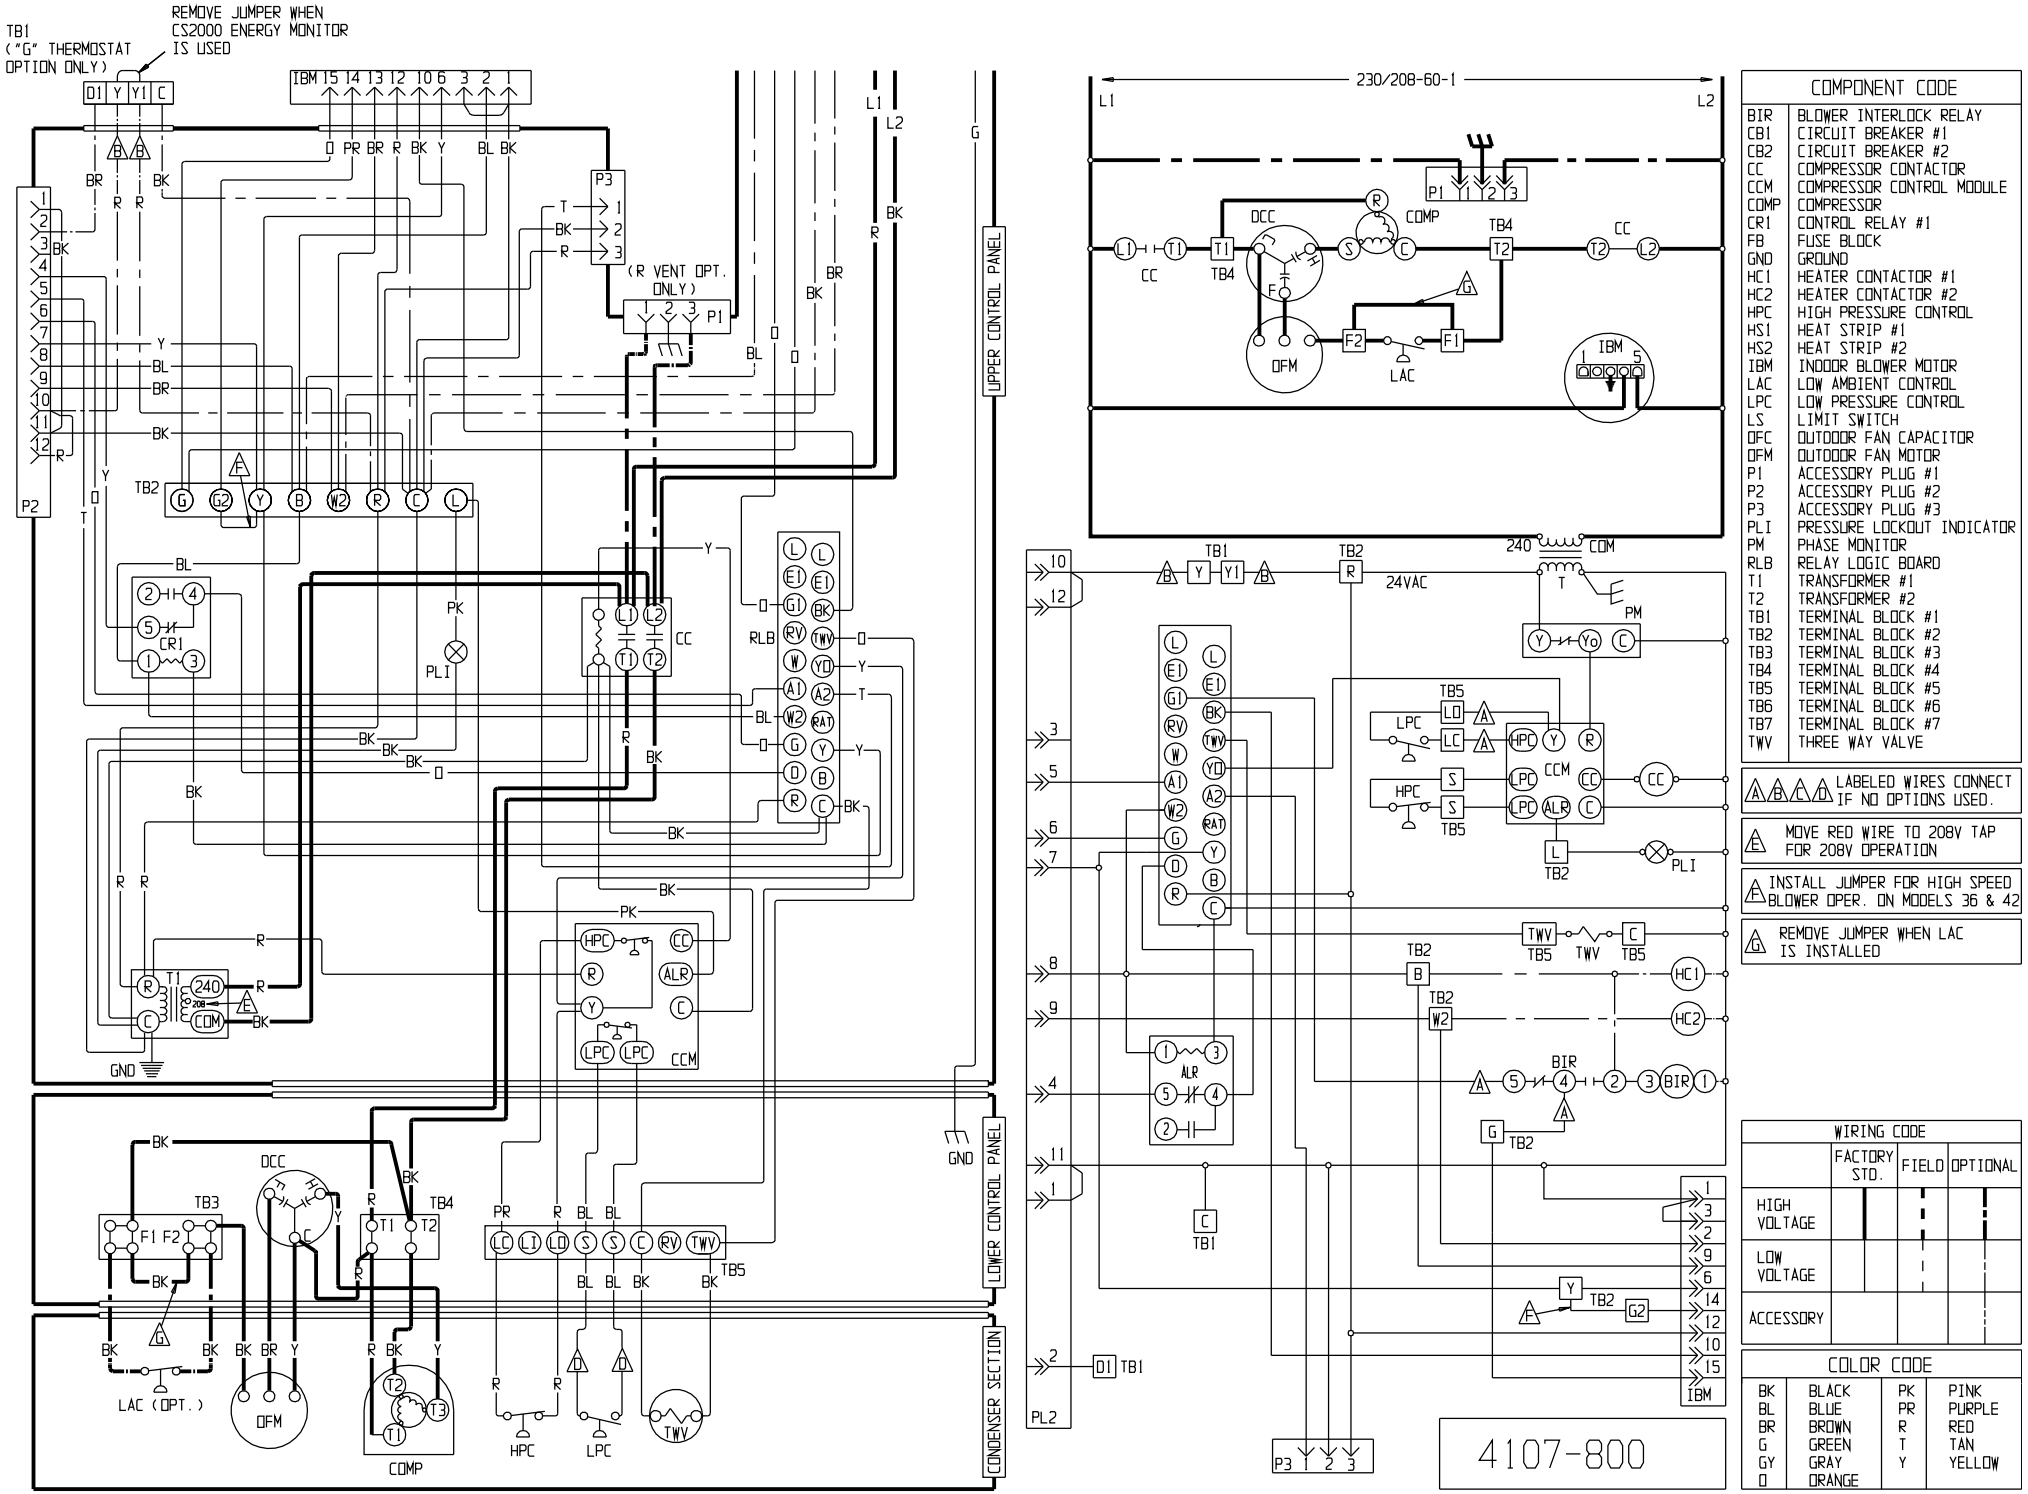


| COMPONENT CODE | |
|---|---|
| BIR | BLOWER INTERLOCK RELAY |
| CB1 | CIRCUIT BREAKER #1 |
| CB2 | CIRCUIT BREAKER #2 |
| CC | COMPRESSOR CONTACTOR |
| CCM | COMPRESSOR CONTROL MODULE |
| COMP | COMPRESSOR |
| CR1 | CONTROL RELAY #1 |
| FB | FUSE BLOCK |
| GND | GROUND |
| HC1 | HEATER CONTACTOR #1 |
| HC2 | HEATER CONTACTOR #2 |
| HPC | HIGH PRESSURE CONTROL |
| HS1 | HEAT STRIP #1 |
| HS2 | HEAT STRIP #2 |
| IBM | INDOOR BLOWER MOTOR |
| LAC | LOW AMBIENT CONTROL |
| LPC | LOW PRESSURE CONTROL |
| LS | LIMIT SWITCH |
| OFC | OUTDOOR FAN CAPACITOR |
| OFM | OUTDOOR FAN MOTOR |
| P1 | ACCESSORY PLUG #1 |
| P2 | ACCESSORY PLUG #2 |
| P3 | ACCESSORY PLUG #3 |
| PLI | PRESSURE LOCKOUT INDICATOR |
| PM | PHASE MONITOR |
| RLB | RELAY LOGIC BOARD |
| T1 | TRANSFORMER #1 |
| T2 | TRANSFORMER #2 |
| TB1 | TERMINAL BLOCK #1 |
| TB2 | TERMINAL BLOCK #2 |
| TB3 | TERMINAL BLOCK #3 |
| TB4 | TERMINAL BLOCK #4 |
| TB5 | TERMINAL BLOCK #5 |
| TB6 | TERMINAL BLOCK #6 |
| TB7 | TERMINAL BLOCK #7 |
| TWV | THREE WAY VALVE |

A B C D LABELED WIRES CONNECT IF NO OPTIONS USED.

E MOVE RED WIRE TO 208V TAP FOR 208V OPERATION

F INSTALL JUMPER FOR HIGH SPEED BLOWER OPER. ON MODELS 36 & 42

G REMOVE JUMPER WHEN LAC IS INSTALLED

| WIRING CODE | FACTORY STD. | FIELD | OPTIONAL |
|---|---|---|---|
| HIGH VOLTAGE | | | |
| LOW VOLTAGE | | | |
| ACCESSORY | | | |

| COLOR CODE | | | |
|---|---|---|---|
| BK | BLACK | PK | PINK |
| BL | BLUE | PR | PURPLE |
| BR | BROWN | R | RED |
| G | GREEN | T | TAN |
| GY | GRAY | Y | YELLOW |
| O | ORANGE | | |