

**SPLIT SYSTEM HEAT PUMP  
COIL ONLY INDOOR SECTION**

**INSTALLATION INSTRUCTIONS**

**FOR USE WITH:  
OIL  
GAS  
ELECTRIC  
FURNACES**

## GENERAL

The add-on heat pump coil-only indoor sections were designed for use with certain outdoor heat pump units. The selection of the matching outdoor unit should be primarily based on the cooling capacity required for the application, as is standard practice when sizing a heat pump system. Reference should be made to the specification sheets for performance values of the following approved matching combinations:

|                     | Compressor Unit | Indoor Coil Section |
|---------------------|-----------------|---------------------|
| <u>Air Source</u>   | 18HPQ5          | H18QS1              |
|                     | 18HPQ5          | H24QS1              |
|                     | 24HPQ5          | H18QS1              |
|                     | 24HPQ5          | H24QS1              |
|                     | 30HPQ6          | H3AQ1               |
|                     | 36HPQ7          | H3AQ1               |
|                     | 42HPQ4          | H4AQ1               |
|                     | 48HPQ5          | H4AQ1               |
|                     | 60HPQ5          | H5AQ1               |
| <u>Water Source</u> | WQ530, WQSD30   | H3AQ1               |
|                     | WQ536, WQSD36   | H3AQ1               |
|                     | WQ550, WQSD50   | H4AQ1               |

NOTE: ONLY the above combinations are approved for use. DO NOT attempt to mix and match to build up a special system.


The heat pump add-on coils were initially designed to be used with EFC-Series electric furnace for counterflow applications. It can also be utilized as an add-on heat pump system to existing electric furnace installations to reduce operating costs.

Another increasingly popular concept is to use a heat pump system in conjunction with natural gas, manufactured gas, or fuel oil furnaces. The theme here is to take advantage of the heat pump efficiency during the large number of days when the outdoor temperature is in the mid 40° range or higher, and heating is required as dictated by the indoor wall thermostat. The fossil fuel furnaces are tremendously oversized for the 40° and higher outdoor temperature conditions, and utilization of the heat pump during this temperature range provides a very practical and economical heating system, while also offering the advantages of cooling operation during the summer months.

Each of the above applications demands special installation and control circuit wiring considerations. The instructions contained in this manual pertaining to indoor coil location with respect to the type of heating system should be adhered to when matching with either the air source or water source compressor sections. Briefly, the rule is that the coil is located downstream (outlet or supply air side) on gas and oil; and upstream (inlet or return air side) on electric furnace. More details on the importance of this are contained later in the manual under those specific types of furnace applications. Specific wiring information for the WQS series water source compressor units is contained in the installation instructions packaged with the WQS units. Specific wiring information for the HPQ series air source compressor units is located later in this manual.

### AIRFLOW DIRECTION--Models H18QS1, H24QS1


Models H18QS1 and H24QS1 are a slant-coil design, and can be used in all three installation positions with respect to airflow: Upflow, downflow and horizontal. The following illustrations show the correct airflow directions across the coil.

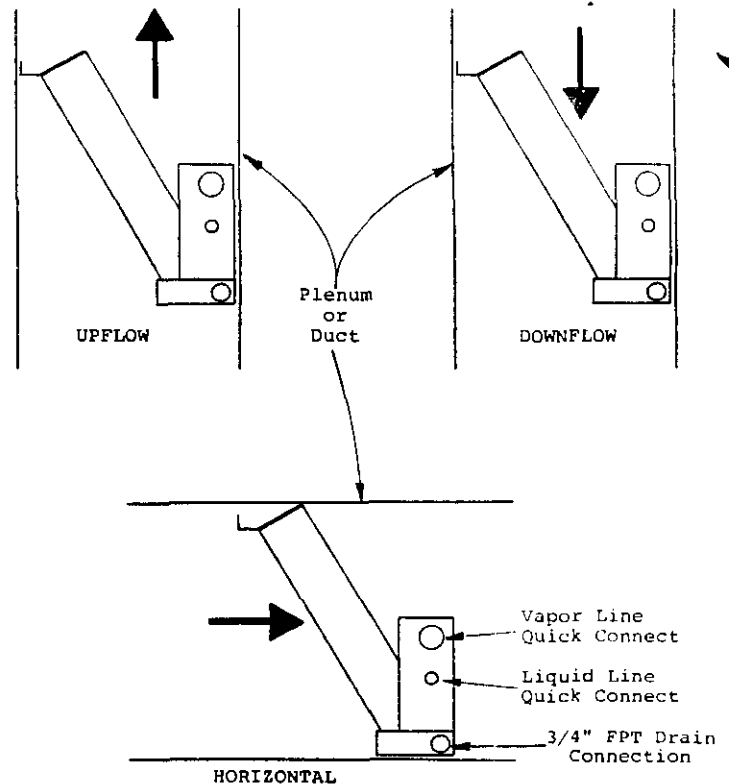

### AIRFLOW DIRECTION -- Models H3AQ1, H4AQ1, H5AQ1

Models H3AQ1, H4AQ1 and H5AQ1 are designed for two mounting positions with respect to airflow: Upflow and downflow. By using a\*DPH3 or DPH5 optional horizontal drain pan the coils are easily adapted to horizontal airflow installations.

The three mounting positions and correct airflow directions across the coil are shown in the following illustrations:

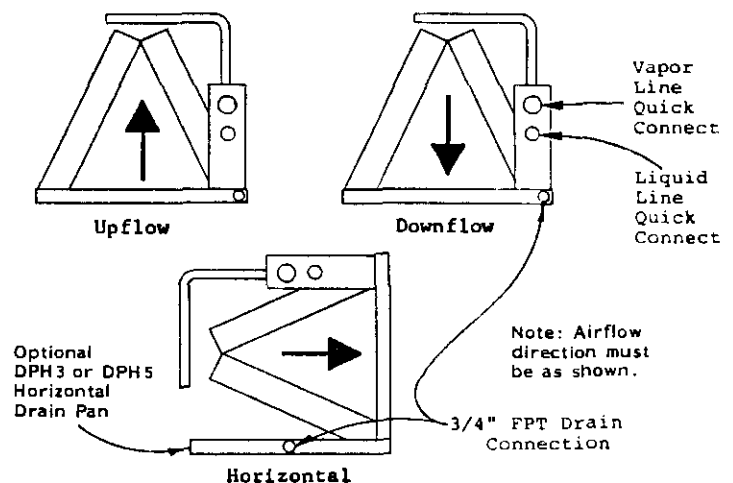

\* DPH3 - Use with H3AQ1 Coil  
DPH5 - Use with H4AQ1 or H5AQ1 Coil

## AIRFLOW RATINGS IN CFM

Listed below are the rated airflow and also minimum/maximum airflows for each system combination:

| System Combination | Rated Airflow | Airflow Range |
|--------------------|---------------|---------------|
| 18HPQ5 - H18QS1    | 625           | 550 - 675     |
| 18HPQ5 - H24QS1    | 635           | 550 - 700     |
| 24HPQ5 - H18QS1    | 730           | 625 - 800     |
| 24HPQ5 - H24QS1    | 800           | 650 - 880     |
| 30HPQ6 - H3AQ1     | 1070          | 875 - 1200    |
| 36HPQ7 - H3AQ1     | 1260          | 1050 - 1425   |
| 42HPQ4 - H4AQ1     | 1450          | 1160 - 1575   |
| 48HPQ5 - H4AQ1     | 1450          | 1160 - 1575   |
| 60HPQ5 - H5AQ1     | 1800          | 1600 - 1850   |
| WQS/WQSD30-H3AQ1   | 1150          | 980 - 1250    |
| WQS/WQSD36-H3AQ1   | 1250          | 1025 - 1375   |
| WQS/WQSD50-H4AQ1   | 1625          | 1500 - 1885   |

## CONDENSATE DRAIN

A single 3/4" FPT drain connection is supplied on all the add-on heat pump coil sections. The same drain connection is used regardless of installation position for coil models H18QS1 and H24QS1. Similarly the same drain connection is used for models H3AQ1, H4AQ1 and H5AQ1 except in the horizontal airflow position. For this application the drain connection on the optional horizontal drain pan is used.

## INSTALLATION ACCESSORIES

There are optional plenums and filter racks available for all the indoor coil sections. The optional filter racks as shown or some other means of air filtering are required on any application where the coil is installed upstream from the original filter location, which should be removed so excessive restriction is not placed on the system blower.

| Indoor Coil Model | Plenum | Filter Rack |
|-------------------|--------|-------------|
| H18QS1            | HP3 ①② | FR3 ②       |
| H24QS1            | HP2 ③① | FR3 ②       |
| H3AQ1             | HP3    | FR3         |
| H4AQ1             | HP5 ④  | FR5         |
| H5AQ1             | HP5 ④  | FR5         |

- ① Contains adapter plate for slant coils.
- ② HS152 plenum will also fit these coils. No filter rack is available. Desirable for use with H60-H80 series gas furnace.
- ③ HS20 plenum will also fit this coil for use with H60-H80 series gas furnaces.
- ④ Cannot be used with DPH5 drain pan for horizontal applications. A field fabricated plenum is required for horizontal application of these coils.

NOTE: The HP3 plenum and FR3 filter rack were designed to mate with the EFC series electric furnace. There are 3/4" flanges on both the top and bottom of the plenum which permit the plenum to fit on top (return air inlet) of an inverted EFC furnace for downflow application, or support an EFC furnace for upflow application. The FR3 filter rack mates with either end of HP3 plenum as required.

The HP5 plenum and FR5 filter rack are similar in design to the HP3 plenum and FR3 filter rack as described above, but are not designed to fit any particular furnace.

Both the HP3-FR3 combination or HP5-FR5 combination can be used for any application, as they have duct flanges on each end and existing ductwork can be adapted.

## ELECTRIC FURNACE APPLICATION--GENERAL

The only add-on heat pump coils generally considered for use with the EFC series electric furnaces are the H18QS1 (1-1/2 ton), H24QS1 (2 ton) and H3AQ1 (2-1/2 and 3 ton). This is because the standard indoor blower coil units available for these Btu size systems are not designed for downflow application. The EFC series furnace is designed for upflow, downflow and horizontal, and therefore a downflow installation can be achieved by using an EFC furnace in combination with either an H18QS1, H24QS1 or H3AQ1 coil section.

Since the BC48A (for use with 42HPQ4 and 48HPQ5 models) and the BC60A (for use with model 48HPQ5 and 60HPQ5) are designed for upflow, downflow and horizontal use, there should be no reason to attempt to match the H4AQ1 or H5AQ1 coil assemblies to an electric furnace. A possible exception to this would be an add-on to an existing electric furnace installation. If this is the case, there are a few important items for consideration.

1. Only the EFC25 and EFC30 should be considered for use. These are the only two furnace models with sufficient blower capacity to meet the airflow requirements for the heat pump system.
2. The HP5 plenum does not mate exactly with the EFC furnace cabinet, and a sheet metal transition would be required.

## ELECTRIC FURNACE APPLICATION--INSTALLATION

The heat pump A-coil must be installed on the return air side of any electric furnace application. This is mandatory so that the heat output from the electric strip heaters, energized at the lower outdoor temperatures, does not drive into the heat pump coil and cause the refrigerant condensing pressure and temperature to raise to points well beyond the design limitations of a heat pump system, and cause the compressor to be de-energized by the manual reset high pressure switch.

## CONTROL CIRCUIT WIRING--CONTROL CIRCUIT DIAGRAMS

Each different KW size EFC electric furnace requires some variations in wiring, because of the different amount of controls on the EFC. Listed below are the appropriate control circuit wiring diagrams based upon EFC size and also the number of field installed outdoor thermostats (ODT-070) recommended for each application.

| Heat Pump System   | Furnace Model      | Control Diagram | Quantity <sup>①</sup><br>of O.D. Stats |
|--|--------------------|-----------------|--|
| 18HPQ5-H18QS1<br>18HPQ5-H24QS1<br>24HPQ5-H18QS1<br>24HPQ5-H24QS1 | EFC10-1            | CDEF-1          | 1                                      |
| 30HPQ6-H3AQ1<br>36HPQ7-H3AQ1                                     | EFC10-1-B          | CDEF-2          | 1                                      |
| 30HPQ6-H3AQ1<br>36HPQ7-H3AQ1                                     | EFC15-1<br>EFC20-1 | CDEF-3          | 1                                      |
| 42HPQ4-H4AQ1<br>48HPQ5-H4AQ1<br>60HPQ5-H5AQ1                     | EFC25-1<br>EFC30-1 | CDEF-4          | 2                                      |

① Outdoor thermostats are optional. See notes on control diagrams.

The circuitry covered by the Control Diagrams allows for heat pump on 1st stage of wall thermostat, with option for compressor cut-off at 0°F or higher as field selected. It also allows for a maximum of 10Kw to be controlled by W2 (second stage) of the wall thermostat, any installed Kw over that amount being controlled by an O.D. stat acting as 3rd stage heat thermostat.

## GAS OR OIL FURNACE APPLICATION

Application of heat pump coil only sections to fossil fuel furnaces require certain special considerations. The first is that return air applications are generally termed unacceptable because of (a) local codes do not permit, (b) may void heat exchanger warranty of furnace manufacturer and, (c) past experience with return air applications generally very poor.

If we were concerned with heating cycle only, the reasons stated above would present no problems. However, during the cooling cycle the heat exchanger becomes chilled or cooled well below surrounding space temperatures due to the low air temperature coming off of the coil, and induces condensation to form on the heat exchanger.

As we consider placing the coil on the more traditional outlet (or leaving) air side of the furnace, we are faced with a new set of circumstances which must be considered.

**Thermal Balance Point.** The point at which the heat pump output capacity and the heat loss from the building being heated are equal is called the balance point, with the heat pump operating 100 per cent of the time. As the outdoor temperature goes down, the Btu capacity of the heat pump falls off while at the same time the heat loss from the structure increases. A means of placing the fossil fueled furnace in operation at outdoor temperatures below the balance point must be provided. In all instances, the gas or oil furnace must be of sufficient capacity to heat the building even under the most extreme outdoor temperature, without the aid of the heat pump.

There is no one given outdoor temperature at which the balance point will occur, it will be different for each application of heat pump to a building, and can even vary from day to day based upon cloud cover, relative humidity outdoors, and wind conditions. Of course, the design of the building (insulation, types of windows, doors, etc.), and other items that affect the heat loss) also determine where the balance point will occur for a given size heat pump system.

The Fuel Saver Module in conjunction with the wall thermostat will automatically sense and respond to all of the variable factors that influence the heating requirements for any given structure.

**Defrost Cycle.** Heat pumps operating during outdoor temperatures below the low 40°F range and colder will gradually accumulate a frost build-up on the outdoor coil. A defrost cycle control system is built into all outdoor heat pump sections that will periodically and automatically clear the outdoor coil of this frost accumulation. This is accomplished by the heat pump system temporarily reverting back to the cooling cycle, using the hot refrigerant gas flowing through the outdoor coil to melt the frost. The outdoor fan motor also stops during this period to speed up the process. During this time of defrost cycle operation, there will be a cooling effect taking place at the indoor coil section, the same as would occur during the summer cooling system.

It is desirable to supply supplemental heat during the defrost cycle period, so as to avoid the discharging of cool air into the building. Laboratory and field testing has shown that firing of the gas or oil furnace during the defrost cycle is permissible and can in fact even shorten the time required for defrosting the outdoor coil because of the introduction of heat immediately ahead of the indoor coil assembly.

**IMPORTANT:** Since the size of the fossil fueled furnace is known only to the installer of the system, it is possible that there would be an excessively large Btu capacity furnace involved, especially in an add-on situation (it is not uncommon for some fossil fueled furnaces, especially oil-fired, to be vastly oversized). Should this instance be encountered, it is possible that because of the furnace Btu output involved, an excessively fast temperature rise air temperature entering the refrigerant coil mounted on the furnace may result in higher discharge pressures and temperatures than the compressor protective devices will tolerate and cause tripping of these protective devices.

It is the responsibility of the installer to understand this operation of the system in detail, and should this occur, set the temperature of the changeover thermostat to a higher temperature. This will lessen the amount of frost accumulation, shorten the length of the actual defrost cycles and thus the time of simultaneous operation of heat pump and furnace.

An alternative to this is to not allow the furnace to cycle "on" during the defrost period. The Fuel Saver Module wiring diagram shows which 24V wiring connection is not to be made to defeat the supplemental heat during defrost.

**Economic Balance Point.** There is an "economic balance point" or "breakeven point" which can be calculated for all situations, based upon actual energy rates for the various fuels and the efficiency ratings of the add-on heat pump and the furnace involved.

Depending upon the local electrical rates and the cost of the other fuel involved, the use of an outdoor thermostat may be desirable to control the changeover from heat pump to furnace at the most cost effective outdoor temperature. The procedure to make this determination is quite simple and outlined below. The tables referenced are located later in this manual, and the same information is also shown in the Fuel Saver Module Installation Instructions. To determine the economic balance point using a module, do the following steps:

- Locate the table for fossil fuel used by furnace. (Table 1 - Natural Gas; Table 2 - Propane; and Table 3 - Fuel Oil).
- Now locate the furnace AFUE efficiency rating for the furnace on the bottom of table the heat pump is being matched with.
- Next draw a line straight up, until it intersects the fuel unit cost curve for the fuel in your area. (Fuel unit cost scale on right side of table).
- Then draw a horizontal line from the intersection point to the Btuh per \$1.00 column on left side of table. You now have determined the Btuh output of heating per one dollar of energy cost for that fuel.

### EXAMPLE 1: (Table 3)

An oil furnace with a 65% AFUE efficiency @ \$1.30 per gallon would equal 70,000 Btuh per dollar of energy (oil) cost.

- Now go to Table 4 (air source or water source heat pump) and locate the Btuh per dollar [step (d) above] on left side of table. Draw a horizontal line from the Btuh per \$1.00 until it intersects the cost per kWh in your locality.
- Then draw a vertical line down to the heat pump COP (Coefficient of Performance) scale at bottom of table. You now have found the lowest COP at which the heat pump should be operated economically.

### EXAMPLE 2: (Table 4)

A 65% AFUE efficient oil furnace will supply 70,000 Btuh per dollar of fuel cost, at a fuel cost of \$1.30 per gallon. A heat pump also will produce 70,000 Btuh output per dollar at an electric rate of \$.06 per Kw. The heat pump will produce this at a COP of 1.21.

- Refer to the "Heating Application Data" section of the heat pump specification sheet to determine at what outdoor temperature the heat pump will produce a 1.21 COP. This temperature is the "Economic Balance Point" at which the outdoor thermostat is set at to shut the heat pump off and operate entirely on the furnace.
- Now set the outdoor thermostat to turn off the compressor at the "Economic Balance Point" temperature determined in (step g) above.

### SEQUENCE OF OPERATION - Heat Pump/Fossil Fuel Furnace

- Fan AUTO-ON function and operation in cooling mode remain the same as in any air conditioning or heat pump system.
- When in heating mode, each initial call for heat will place heat pump in operation.
- If the heat pump cannot handle the heating requirements of the structure during any given cycle, the space temperature will begin to drop. If it drops approximately 1°F, the 2nd stage of the wall thermostat will activate the Fuel Saver Module, turning off the heat pump and starting the furnace.



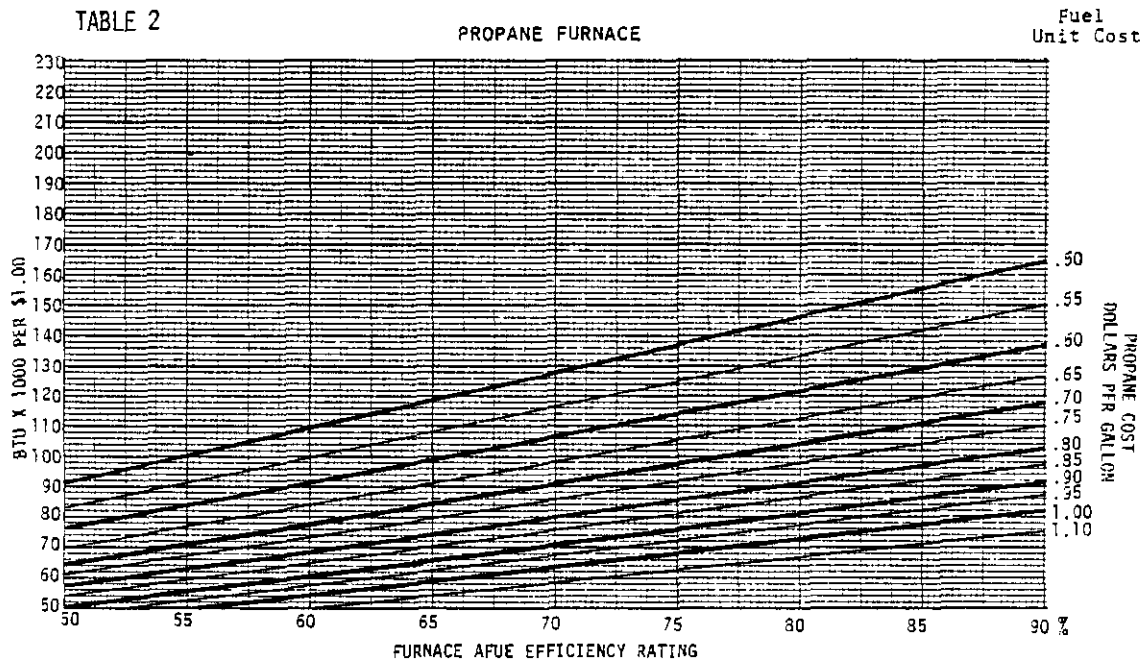


TABLE 3


## OIL FURNACE

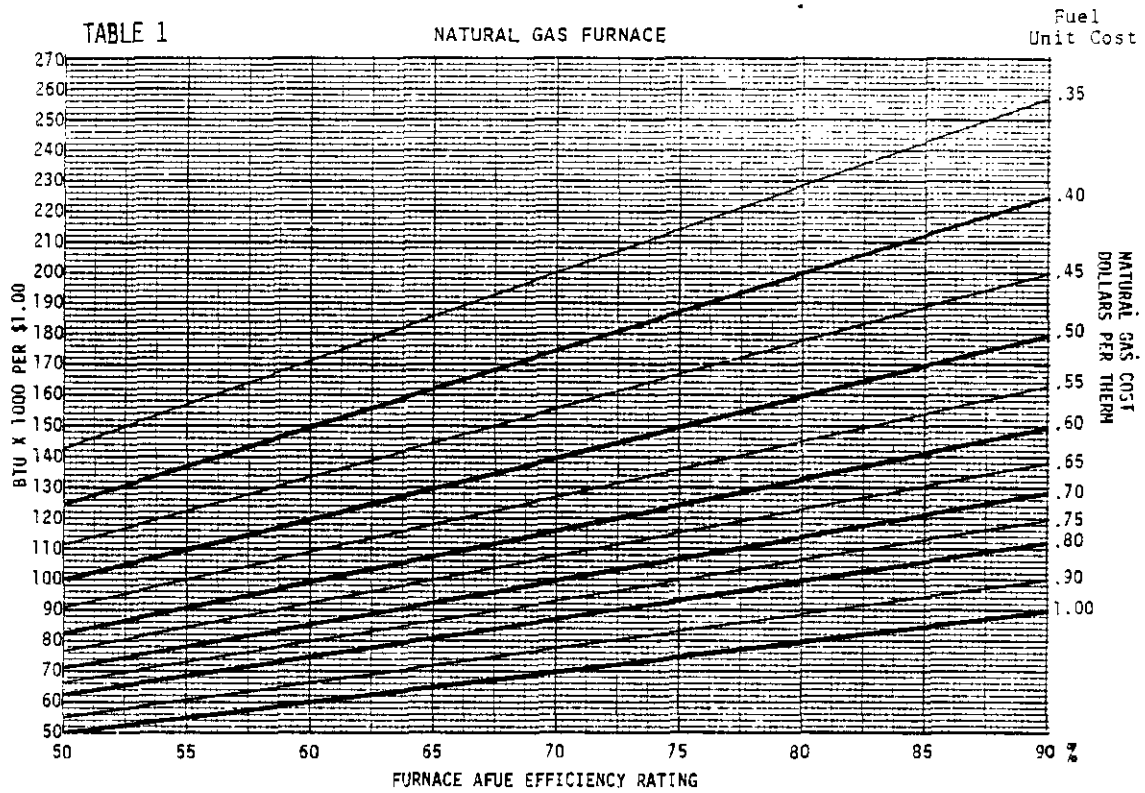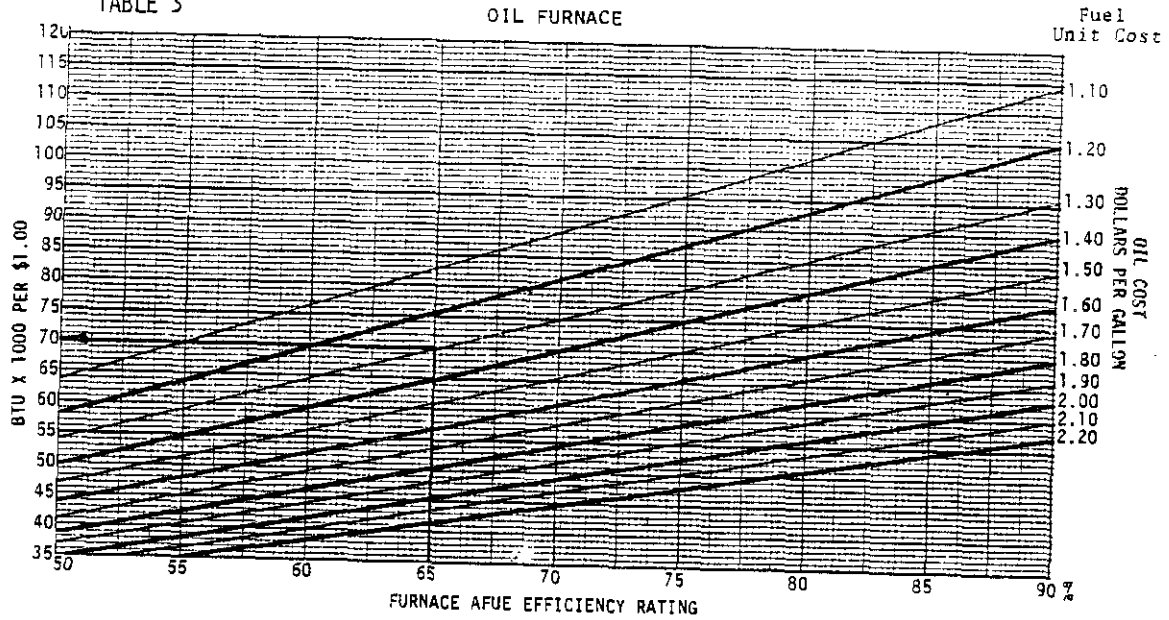

Example 1. Assume a 65% AFUE oil furnace at \$1.30 per gallon.

TABLE 4

## AIR SOURCE OR WATER SOURCE HEAT PUMP

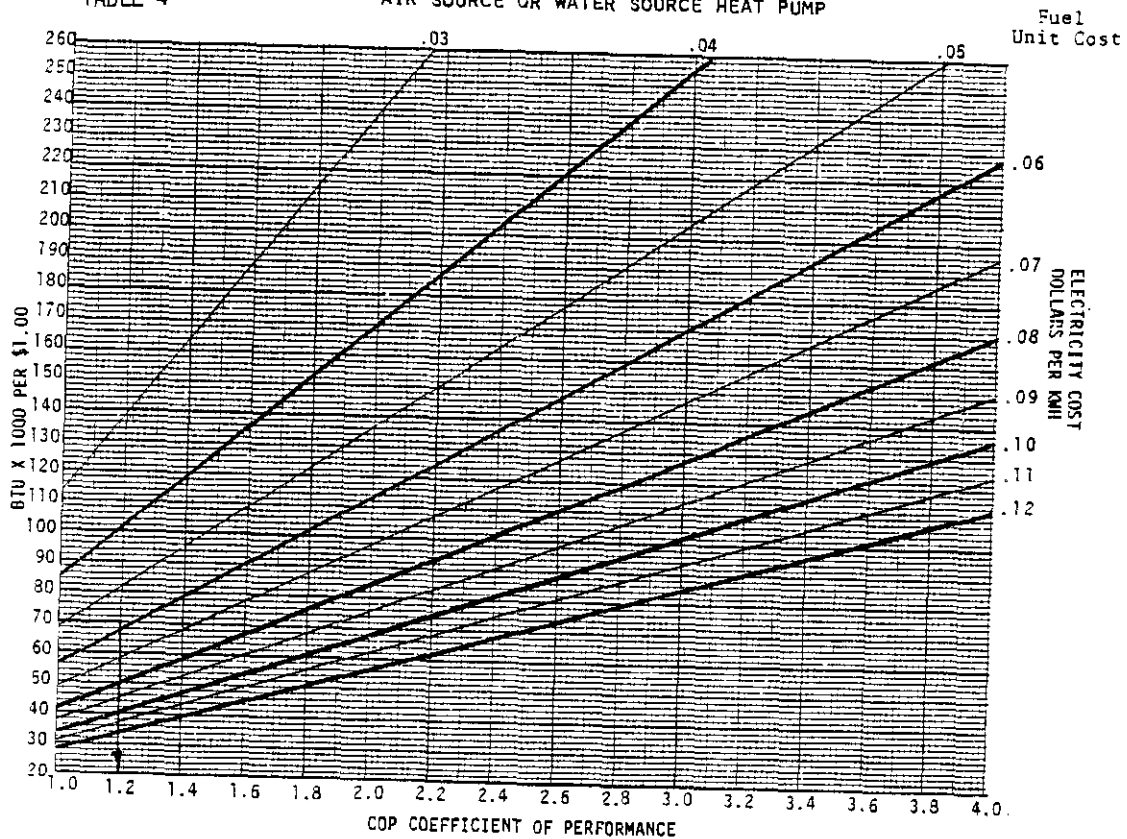

Example 2. Determine Economic Balance Point for Heat Pump when used with an oil furnace of 65% AFUE at \$1.30 per gallon for oil from example 1 (oil furnace 70,000 Btuh/\$) and electric rate of .06 kWh. A 1.21 COP, heat pump and oil is equal in operating cost.

- d) The furnace will continue to operate, supplying heat until the wall thermostat (both stages 1 and 2) are satisfied. When the thermostat is satisfied the module resets, and the next call for heat will start over with heat pump operating as the primary heating system and the furnace on standby as described above.
- e) The module allows for activation of the furnace during the defrost cycle of the heat pump "if desired." It is usually desirable to provide this supplemental heat during the brief defrost cycle period to avoid discharging cool air into the building. A complete discussion on this subject can be found in the Installation Instructions packaged with the Add-On Heat Pump Coil. Connection of a single 24V wire at the module will allow the furnace to cycle on during the defrost cycle. Refer to module wiring diagram.
- f) "Emergency heat" function is available on command from the wall thermostat. This locks out the heat pump from operating under any condition and allows furnace operation only. Only during "emergency heat" operation is the heating system under control of the 2nd stage of wall thermostat and in this mode of operation structure is controlled at 1°F below thermostat setpoint. **IMPORTANT:** Only in emergency heat mode does furnace blower operate from combination fan/limit switch in furnace. In all other modes, the furnace blower is controlled by the cooling blower relay and starts as soon as there is a call for heat or cool operation. There is additional information on "Indoor Blower Operation" contained in the Installation Instructions for the add-on heat pump coil.
- g) Any time the wall thermostat is set for heating and a large change to a higher temperature setting is made, or the system is turned on after being off and the actual space temperature is lower than the thermostat setpoint, the 2nd stage will be closed (calling for heat) and the control system will lock out the heat pump and activate the furnace until the desired space temperature is reached. At that time the control system will reset and the next call for heat will again be heat pump.

#### CONTROL CIRCUIT WIRING - FUEL SAVER MODULE

All wiring is 24V. An eight (8) wire color coded thermostat cable is recommended. The electrical connection to the module is quite easy. Simply cut the thermostat cable, with the wires coming from the furnace connected to the terminal block designated "FURNACE CONNECTIONS," and the wires from the heat pump to terminal block designated "HEAT PUMP CONNECTIONS." Refer to wiring diagram for complete details. The wiring diagram is attached to the cover of the module and a copy is included later in this manual as well as the module instructions.

#### CFM FOR ADD-ON HEAT PUMPS

The furnace that you are going to add a heat pump to must be able to deliver enough air to satisfy the heat pump's requirements, usually 400 CFM/Ton.

When the heat pump is in the heating mode, the indoor coil becomes the condensing coil, this is why the amount of air is so critical. Not enough air results in too high of high side pressures and temperatures. The furnace CFM can be calculated by using the following formula:

$$CFM = \frac{\text{Output (Btu/h)}}{1.08 \times \text{Temp. Rise}}$$

When adding a heat pump to an existing GAS FURNACE, proceed as follows to determine the gas input to the furnace. Shut off all other gas appliances in the home, then set the indoor wall thermostat to call for heat. Go to the gas meter and clock the fastest moving dial, then refer to the chart below.

**EXAMPLE:** Most gas utilities use 1000 Btu per cubic foot of gas. If you were to clock the 1 cubic foot dial and found it took 36 seconds for one revolution, then in one hour the furnace would use 100,000 Btu, but we all know that no furnace is 100% efficient, so suppose we assume this furnace to be 70% efficient, then we should have approximately 70,000 Btu per hour output. Using that figure our formula would look like this:

$$CFM = \frac{70,000}{1.08 \times T.R.} \quad \text{or} \quad CFM = \frac{70,000}{1.08 \times ?}$$

We must still obtain a temperature rise through the furnace. This is done by measuring the return air temperature and the supply air temperature. Let's again assume we were able to measure a 60°F temperature rise through the furnace. Now we can complete our formula.

$$CFM = \frac{70,000}{1.08 \times 60} \quad \text{or} \quad CFM = \frac{70,000}{65}$$

Then, our CFM for this furnace would be 1076 CFM.

| SIZE OF TEST DIAL          |             |             |             |             |             | SIZE OF TEST DIAL          |             |             |             |             |             |
|----------------------------|-------------|-------------|-------------|-------------|-------------|----------------------------|-------------|-------------|-------------|-------------|-------------|
| Seconds<br>for one<br>Rev. | %<br>cu.ft. | %<br>cu.ft. | 1<br>cu.ft. | 2<br>cu.ft. | 5<br>cu.ft. | Seconds<br>for one<br>Rev. | %<br>cu.ft. | %<br>cu.ft. | 1<br>cu.ft. | 2<br>cu.ft. | 5<br>cu.ft. |
| 10                         | 90          | 180         | 360         | 720         | 1800        | 36                         | 25          | 50          | 100         | 200         | 500         |
| 11                         | 82          | 164         | 327         | 655         | 1636        | 37                         | —           | —           | 97          | 195         | 486         |
| 12                         | 75          | 150         | 300         | 600         | 1500        | 38                         | 23          | 47          | 95          | 189         | 474         |
| 13                         | 69          | 138         | 277         | 555         | 1385        | 39                         | —           | —           | 92          | 185         | 462         |
| 14                         | 64          | 129         | 257         | 514         | 1286        | 40                         | 22          | 45          | 90          | 180         | 450         |
| 15                         | 60          | 120         | 240         | 480         | 1200        | 41                         | —           | —           | —           | 176         | 439         |
| 16                         | 56          | 113         | 225         | 450         | 1125        | 42                         | 21          | 43          | 86          | 172         | 429         |
| 17                         | 53          | 106         | 212         | 424         | 1059        | 43                         | —           | —           | —           | 167         | 419         |
| 18                         | 50          | 100         | 200         | 400         | 1000        | 44                         | —           | 41          | 82          | 164         | 409         |
| 19                         | 47          | 95          | 189         | 379         | 947         | 45                         | 20          | 40          | 80          | 160         | 400         |
| 20                         | 45          | 90          | 180         | 360         | 900         | 46                         | —           | —           | 78          | 157         | 391         |
| 21                         | 43          | 86          | 171         | 343         | 857         | 47                         | 19          | 38          | 76          | 153         | 383         |
| 22                         | 41          | 82          | 164         | 327         | 818         | 48                         | —           | —           | 75          | 150         | 375         |
| 23                         | 39          | 78          | 157         | 313         | 783         | 49                         | —           | —           | —           | 147         | 367         |
| 24                         | 37          | 75          | 150         | 300         | 750         | 50                         | 18          | 36          | 72          | 144         | 360         |
| 25                         | 36          | 72          | 144         | 288         | 720         | 51                         | —           | —           | —           | 141         | 355         |
| 26                         | 34          | 69          | 138         | 277         | 692         | 52                         | —           | —           | 69          | 138         | 346         |
| 27                         | 33          | 67          | 133         | 267         | 667         | 53                         | 17          | 34          | —           | 136         | 340         |
| 28                         | 32          | 64          | 129         | 257         | 643         | 54                         | —           | —           | 67          | 133         | 333         |
| 29                         | 31          | 62          | 124         | 248         | 621         | 55                         | —           | —           | —           | 131         | 327         |
| 30                         | 30          | 60          | 120         | 240         | 600         | 56                         | 16          | 32          | 64          | 129         | 321         |
| 31                         | —           | —           | 116         | 232         | 581         | 57                         | —           | —           | —           | 126         | 316         |
| 32                         | 28          | 58          | 113         | 225         | 563         | 58                         | —           | 31          | 62          | 124         | 310         |
| 33                         | —           | —           | 109         | 218         | 545         | 59                         | —           | —           | —           | 122         | 305         |
| 34                         | 26          | 53          | 106         | 212         | 529         | 60                         | 15          | 30          | 60          | 120         | 300         |
| 35                         | —           | —           | 103         | 206         | 514         |                            |             |             |             |             |             |

If the furnace is equipped with a direct drive motor, make sure you have it wired to the high speed tap. If it is a belt drive motor, then read the motor's nameplate amps. Then, hook on an amp probe and see if it is possible to speed the blower up by adjusting the variable pulley.

If you are at the limits of the motor, then check with the furnace manufacturer to see if a larger horsepower motor can be installed and also if the blower will give you the needed CFM with a larger motor.

When you have determined that your furnace can handle the required CFM for your heat pump, the indoor coil must be installed and your CFM calculation must be rechecked with the coil in place.

When adding to an OIL FURNACE, you must determine what size nozzle the unit has in the burner and then install a pressure gauge in the oil delivery pumps discharge port and set the pressure at 100 psig. An example might be that we find the burner equipped with a one gallon per hour nozzle, operating at 100 psi. This nozzle will deliver one G.P.H. and a gallon of #2 fuel oil has approximately 140,000 Btu of heat.

The 140,000 Btu is our input and again let us assume that this furnace is operating at 70% efficiency. Then our Btu output is 98,000 Btu, and if we use the rule of thumb that an oil furnace should operate with an 85°F temperature rise, then our formula would look like this:

$$\text{CFM} = \frac{98,000 \text{ Btu/h}}{1.08 \times 85^\circ\text{F}} \quad \text{or} \quad \frac{98,000 \text{ Btu/h}}{92} = 1065 \text{ CFM}$$

When adding on to an electric furnace we must also take one more thing into consideration and that is the heat pump coil must be installed on the return side of the electric furnace. To find out what CFM the electric furnace can deliver, we must measure the voltage and amperage of each heating element or Volts x Amp = Watts. The total Watts x 3.4 Btu = Btu Output. An example might look like this with a 15Kw electric furnace.

$$\begin{aligned} 240 \text{ Volts} \times 21 \text{ Amps} &= 5040 \text{ Watts} \\ 5040 \text{ Watts} \times 3 \text{ Elements} &= 15120 \text{ Watts} \\ 15120 \text{ Watts} \times 3.4 \text{ Btu/Watt} &= 51408 \text{ Btu} \end{aligned}$$


One word of caution, never go by nameplate rating. Always measure volts and amps.

One more item that is different with an electric furnace and that is, never obtain a supply air temperature reading in sight of the electric element (because of the radiant effect). Now our formula looks like this again:

$$\text{CFM} = \frac{51408 \text{ Btu/h}}{1.08 \times 44^\circ\text{F}} \quad \text{or} \quad \frac{51408 \text{ Btu/h}}{48} = 1071 \text{ CFM}$$

# FSM-1A FUEL SAVER MODULE


## WIRING DIAGRAM

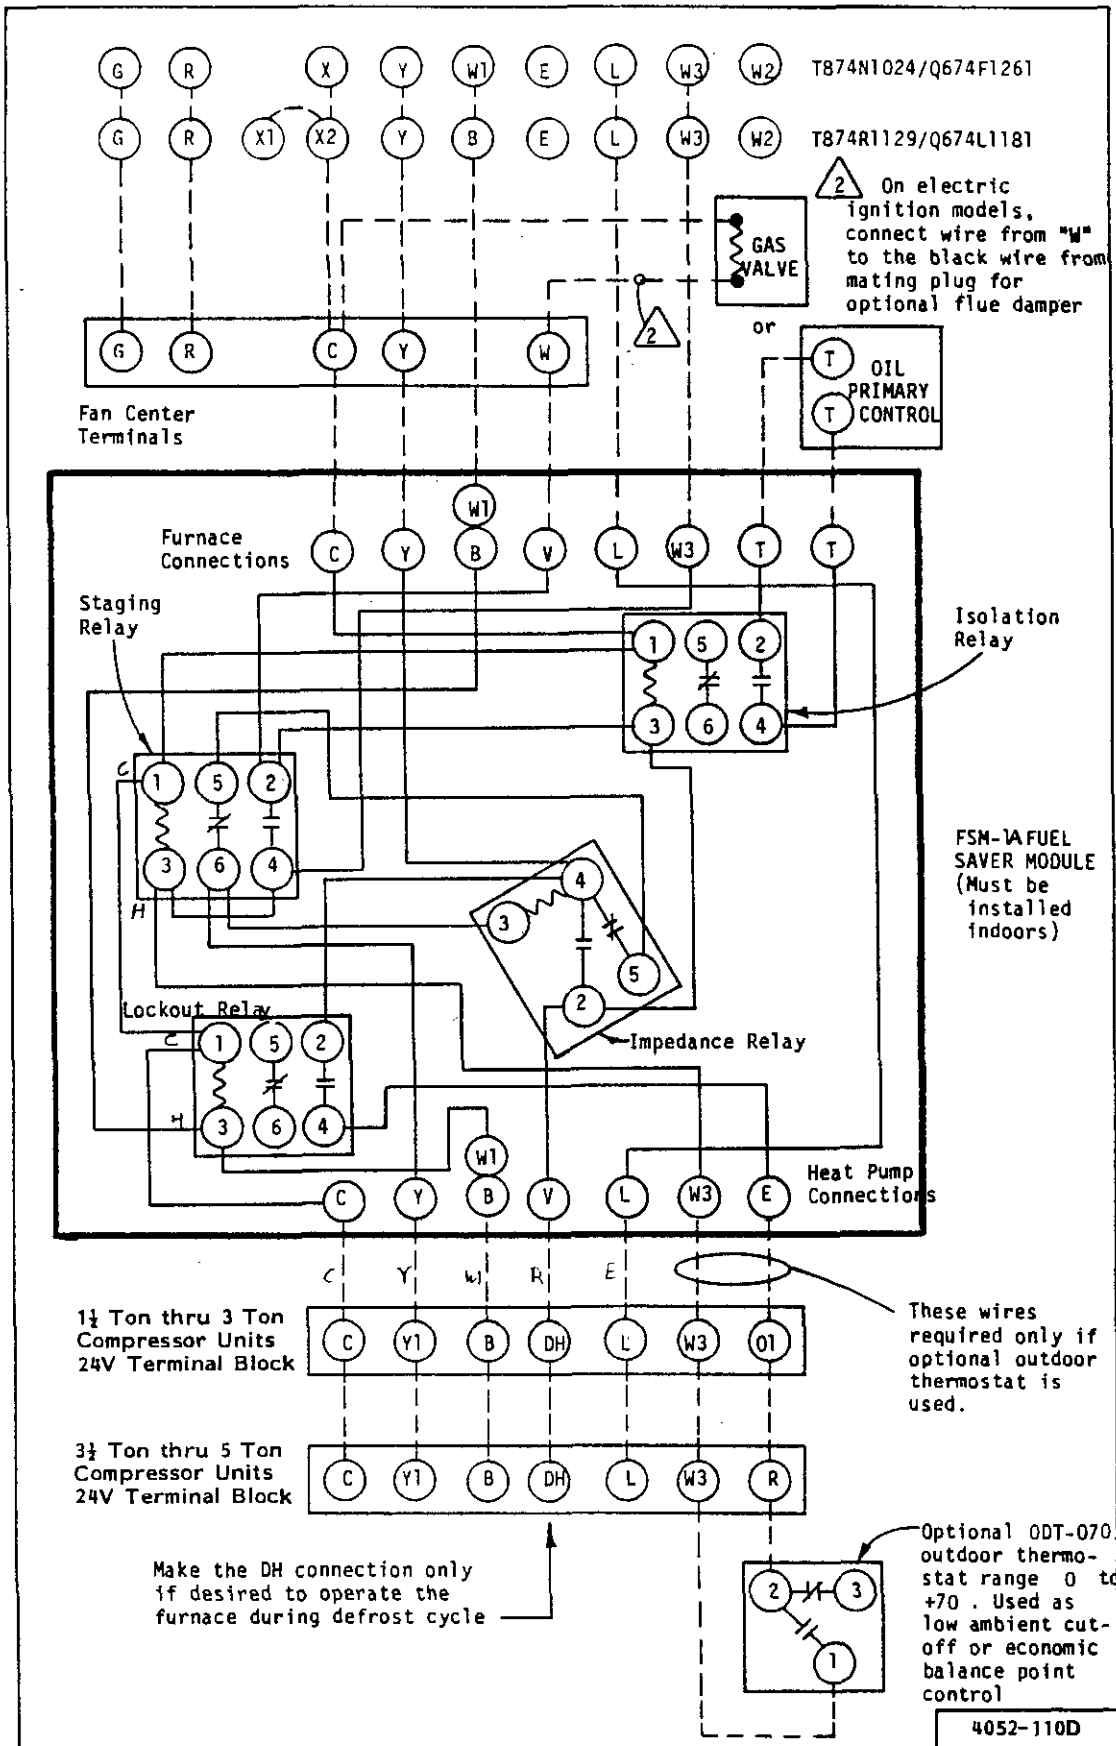

# HEAT PUMPS WITH ELECTRIC FURNACES


## CONTROL DIAGRAM CDEF-1

HEAT PUMP MODELS  
18HPQ5/H18QS1  
18HPQ5/H24QS1  
24HPQ5/H18QS1  
24HPQ5/H24QS1  
Matched with EFC10-1

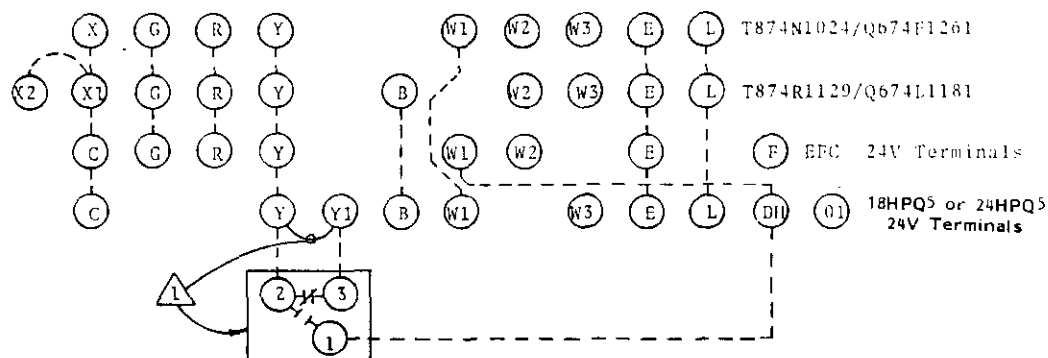


## CONTROL DIAGRAM CDEF-2

HEAT PUMP MODELS  
30HPQ6/H3AQ1  
36HPQ7/H3AQ1  
Matched with EFC10-1-B

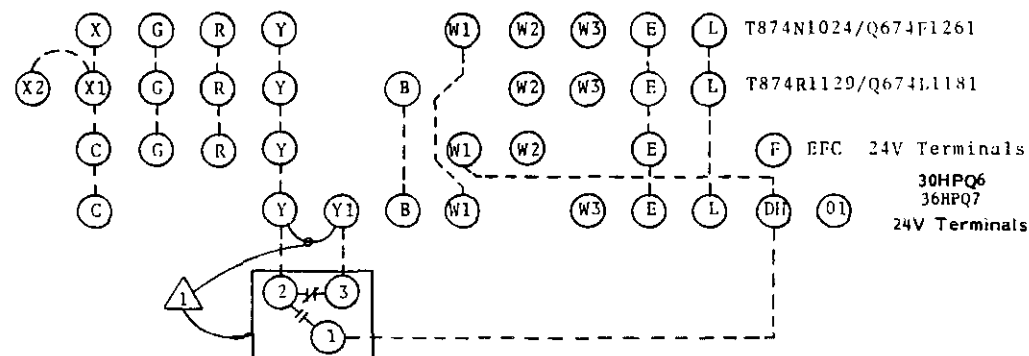


## CONTROL DIAGRAM CDEF-3

HEAT PUMP MODELS  
30HPQ6/H3AQ1  
36HPQ7/H3AQ1  
Matched with  
EFC15-1 or EFC20-1

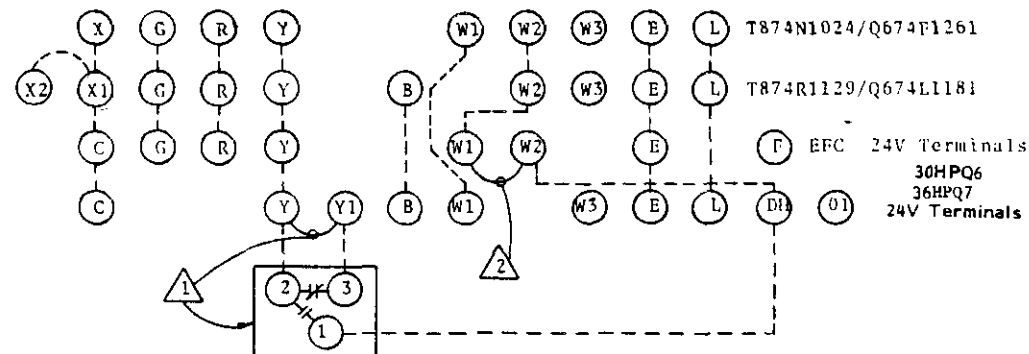

## CONTROL DIAGRAM CDEF-4

HEAT PUMP MODELS  
42HPQ4/H4AQ1  
48HPQ5/H4AQ1  
60HPQ5/H5AQ1  
Matched with EFC25-1  
or EFC30-1

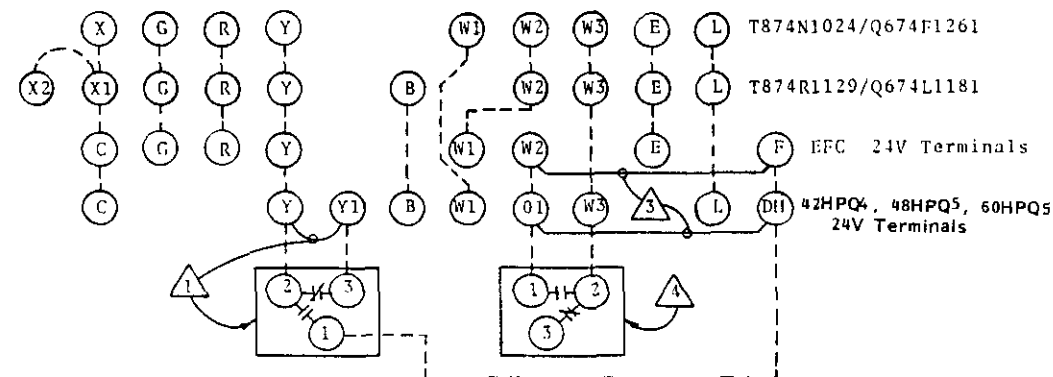

1

If optional compressor cut-off, ODT-070 is used, remove jumper Y-Y1.

2

Remove jumper W1-W2 to allow last 5 or 10Kw to operate only during defrost or during compressor cut-off. If jumper is left in place, all 15 or 20Kw will operate from 2nd stage of wall stat.

3

Remove jumper W2-F and 01-DH to allow last 5 or 10Kw to operate only during defrost or during compressor cut-off. If jumper is left in place, 15 or 20Kw will operate from 3rd stage ODT. See note 3.

4

3rd stage ODT wired as shown will allow 2nd 10Kw stage to be controlled by 2nd stage of wall stat and ODT. If not used, W3 from stat must be connected to W2 at EFC 24V terminals. First 20Kw now controlled as one stage of wall stat. Note 2 still applies.

## ALTERNATE WIRING FOR HEAT PUMPS NOT USING FUEL SAVER MODULE

A less economical alternative (from the energy cost standpoint) to the Fuel Saver Module is to use the individual components as shown below and to field install and wire using wire and necessary materials supplied by the installer.

This concept allows for a "fixed" changeover from heat pump to backup furnace system at a single, pre-selected outdoor temperature. Since this temperature setting must be calculated and the changeover control set high enough to compensate for all occupant and weather related variables, it is not as energy conscious as the Fuel Saver Module.

Listed below are the components required to make the necessary electrical connections when the Fuel Saver Module is not used.

| "ADD-ON" APPROVED MATCHING COMBINATIONS |                  |
|---|------------------|
| Outdoor Section                         | Indoor Section   |
| 18HPQ5                                  | H18QS1 or H24QS1 |
| 24HPQ5                                  | H18QS1 or H24QS1 |
| 30HPQ6                                  | H3AQ1            |
| 36HPQ7                                  | H3AQ1            |
| 42HPQ4                                  | H4AQ1            |
| 48HPQ5                                  | H4AQ1            |
| 60HPQ5                                  | H5AQ1            |

### CONTROL CIRCUIT WIRING

There are four (4) separate control diagrams for fossil fuel furnaces with heat pumps. One each for gas and oil furnaces with 18HPQ5/H18QS1, 18HPQ5/H24QS1, 24HPQ5/H18QS1, 24HPQ5/H24QS1, 30HPQ6/H3AQ1, 36HPQ7/H3AQ1, and one each for 42HPQ4/H4AQ1, 48HPQ5/H4AQ1, 60HPQ5/H5AQ1.

| Heat Pump System   | Gas Furnace Control Diagram | Oil Furnace Control Diagram |
|--|-----------------------------|-----------------------------|
| 18HPQ5/H18QS1<br>18HPQ5/H24QS1<br>24HPQ5/H18QS1<br>24HPQ5/H24QS1<br>30HPQ6/H3AQ1<br>36HPQ7/H3AQ1 | CDG-1                       | CDO-1                       |
| 42HPQ4/H4AQ1<br>48HPQ5/H4AQ1<br>60HPQ5/H5AQ1   | CDG-2                       | CDO-2                       |

| REQUIRED HOOK-UP COMPONENTS          |                     |      |   |                     |      |   |
|--------------------------------------|---------------------|------|---|---------------------|------|---|
| H/P Systems                          | GAS FURNACE HOOK-UP |      |   | OIL FURNACE HOOK-UP |      |   |
|                                      | Part No.            | Qty. | Description                               | Part No.            | Qty. | Description                               |
| 18HPQ5<br>24HPQ5<br>30HPQ6<br>36HPQ7 | 8403-017            | 1    | T874R1129 Thermostat ①                    | 8403-017            | 1    | T874R1129 Thermostat ①                    |
|                                      | 8404-009            | 1    | Q674L1181 Subbase ①                       | 8404-009            | 1    | Q674L1181 Subbase ①                       |
|                                      | ODT-070             | 1    | Outdoor Thermostat                        | 8201-007<br>③       | 1    | R8239C1009 or<br>175-210304-10 Fan Center |
|                                      | 8201-007<br>② ③     | 1    | R8239C1009 or<br>175-210304-10 Fan Center | 8201-015            | 1    | 184-50114-406 Relay                       |
| 42HPQ4<br>48HPQ5<br>60HPQ5           | 8403-017            | 1    | T874R1129 Thermostat                      | 8403-017            | 1    | T874R1129 Thermostat                      |
|                                      | 8404-009            | 1    | Q674L1181 Subbase ①                       | 8404-009            | 1    | Q674L1181 Subbase ①                       |
|                                      | ODT-070             | 1    | Outdoor Thermostat                        | ODT-070             | 1    | Outdoor Thermostat                        |
|                                      | 8201-007<br>③       | 1    | R8239C1009 or<br>175-210304-10 Fan Center | 8201-007            | 1    | R8239C1009 or<br>175-210304-10 Fan Center |
|                                      | 8201-015            | 1    | 184-50114-406 Relay                       | 8201-015            | 2    | 184-50114-406 Relay                       |

① This stat and subbase combination are manual changeover from heat to cool, and incorporate a non-cycling reversing valve circuit. Alternate parts are 8403-018, T874N1024 thermostat and 8404-010, Q674F1261 subbase which allows automatic changeover from heat to cool and has cycling reversing valve operation.

**IMPORTANT:** Which ever type of operation is desired, the stat and subbase must be matched as shown above.

② Not required for gas furnaces factory built with heating/cooling blower relay.

|  |                     |           |           |           |
|--|---------------------|-----------|-----------|-----------|
| H80D36A, H80D36B, EH80D36A, EH80D36B     | C105D42A, EC105D42A | IH60D36A  | IC60Q36A  | IL84D48A  |
| H105D48A, H105D48B, EH105D48A, EH105D48B | C120D42A, EC120D42A | IH85D48A  | IC85D42A  | IL115D48A |
| H120D48A, H120D48B, EH120D48A, EH120D48B | C140D48A, EC140D48A | IH115D48A | IC115D48A | IL145D60A |
| H140D48A, H160D48A, EH140D48A, EH160D48B | C160D48A, EC160D48A |           |           |           |


③ Typical wiring for the 115V connections into the gas or oil furnace are shown on pages titled "Typical Fan Center Wiring."

# ALTERNATE WIRING FOR HEAT PUMPS NOT USING FUEL SAVER MODULE

CONTROL DIAGRAM CDG-1

HEAT PUMP MODELS


18HPQ5/H18QS1  
18HPQ5/H24QS1  
24HPQ5/H18QS1  
24HPQ5/H24QS1  
30HPQ6/H3AQ1  
36HPQ7/H3AQ1  
Matched with Gas Furnace

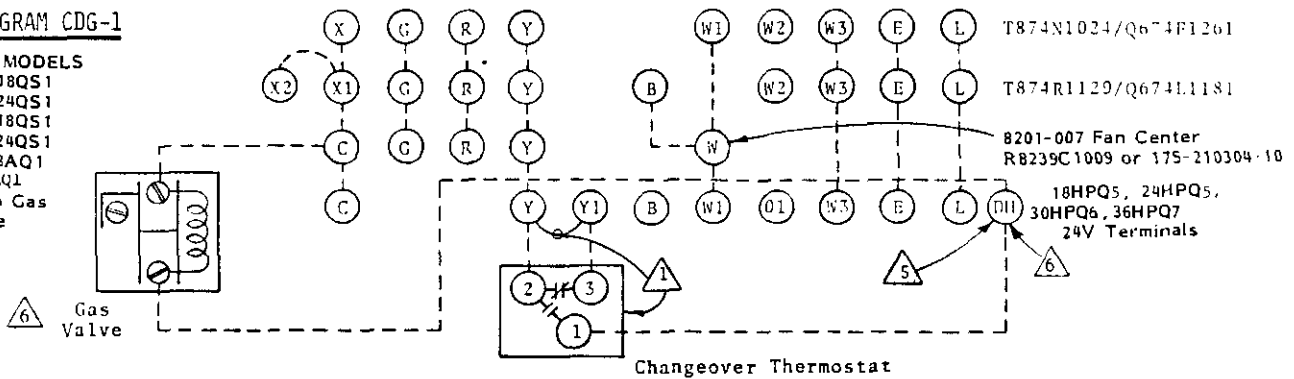

CONTROL DIAGRAM CDO-1

HEAT PUMP MODELS


18HPQ5/H18QS1  
18HPQ5/H24QS1  
24HPQ5/H18QS1  
24HPQ5/H24QS1  
30HPQ6/H3AQ1  
36HPQ7/H3AQ1  
Matched with Oil Furnace

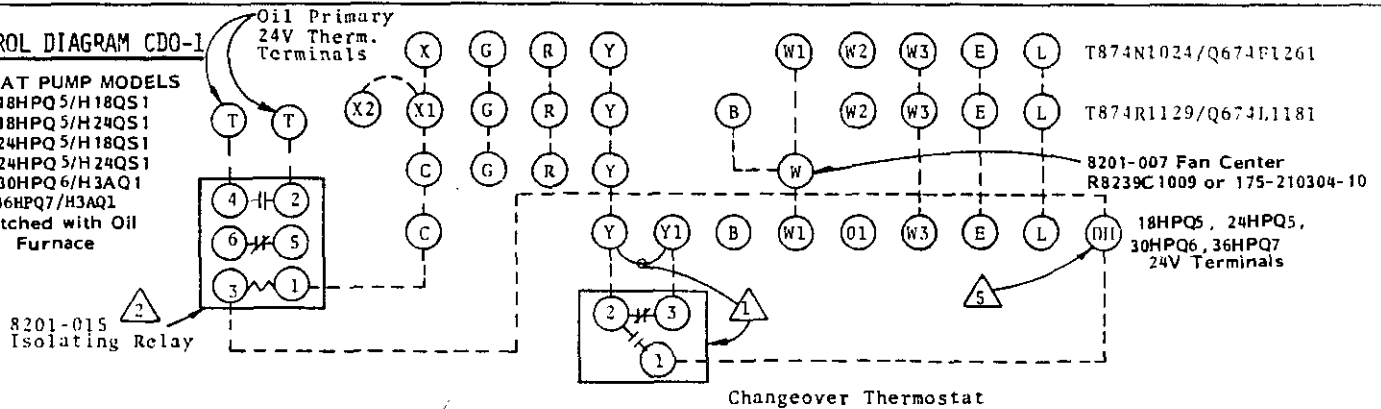

CONTROL DIAGRAM CDG-2

HEAT PUMP MODELS


42HPQ4/H4AQ1  
48HPQ5/H4AQ1  
60HPQ5/H5AQ1  
Matched With Gas Furnace

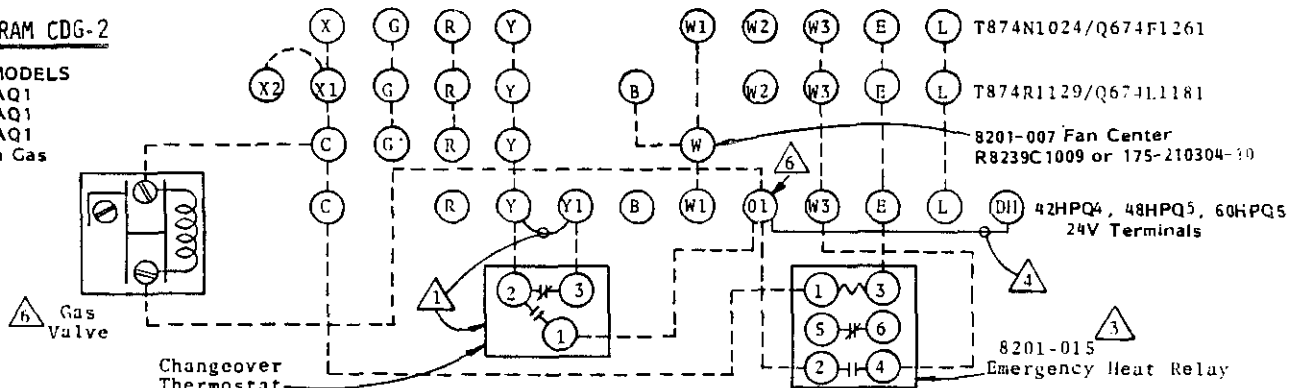

CONTROL DIAGRAM CDO-2

HEAT PUMP MODELS

42HPQ4/H4AQ1  
48HPQ5/H4AQ1  
60HPQ5/H5AQ1  
Matched With Oil Furnace

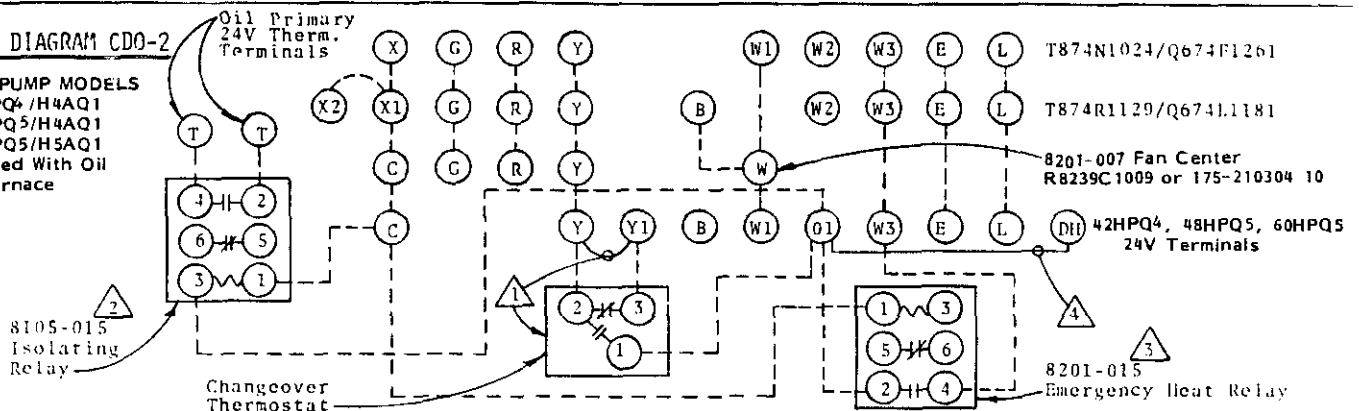

⚠ Outdoor thermostat range 0 to 70°F. Normally set at 40-45°F. Changes operation from heat pump to fossil fuel furnace as outdoor temperature falls below setpoint. Cut-in approximately 5°F differential (switches on temperature rise approximately 5°F above setpoint). Locate in outdoor unit control box. See section "Gas or Oil Furnace Applications" before any other setting is used. Remove jumper Y-Y1.


⚠ 8201-015 relay used as isolating relay. Necessary to separate 24V power supply of heat pump from 24V supply built into oil burner primary control. Locate in outdoor unit control box.

⚠ 8201-015 relay used as emergency heat relay. Locate in outdoor unit control box.


⚠ Remove this wire if it is desired NOT to allow furnace to cycle "on" during defrost cycles. See section in manual on "Defrost Cycles."

⚠ If it is desired to NOT allow furnace to cycle "on" during defrost, a 24V factory wire between terminal 3 of defrost relay and terminal 4 on emergency heat relay must be removed. See section in manual on defrost cycles.

⚠ Gas valve shown is standing pilot. For electric ignition models, make this connection to black wire from mating plug for optional flue damper.

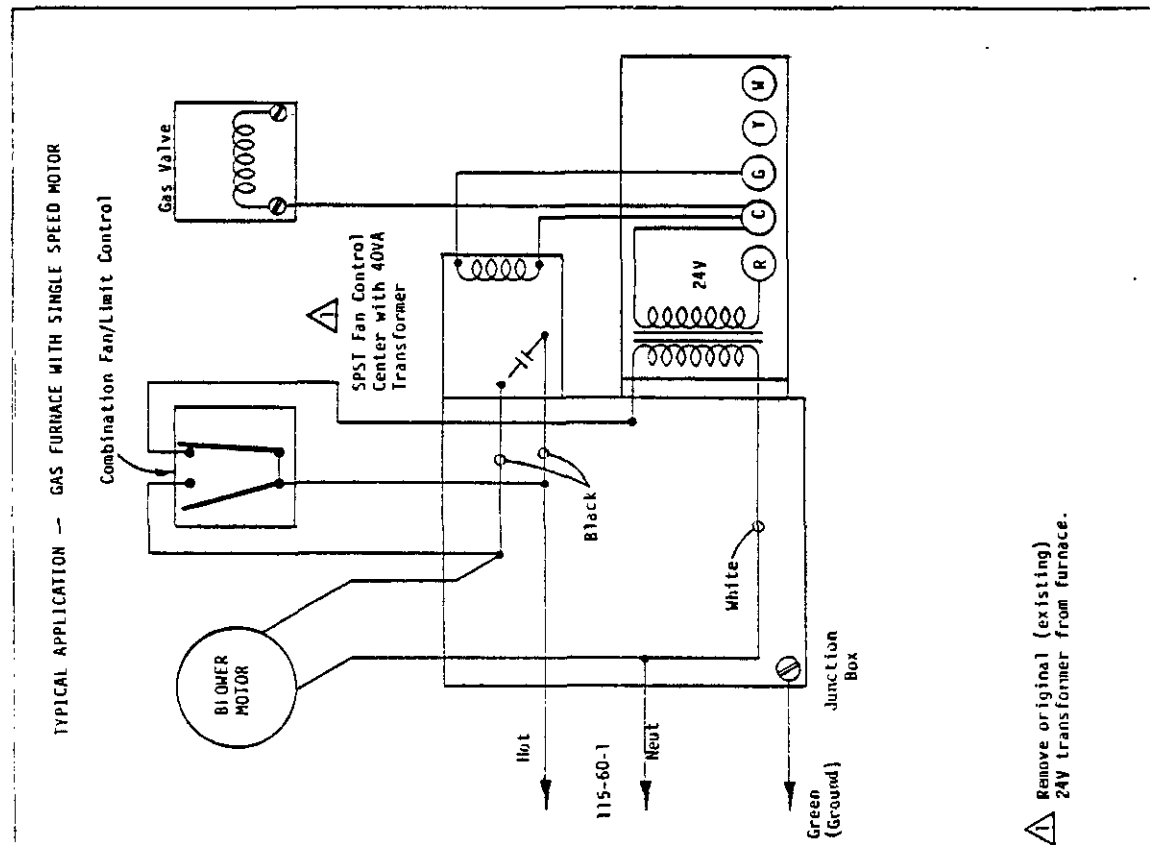

⚠ Remove original (existing) 24V transformer from furnace.

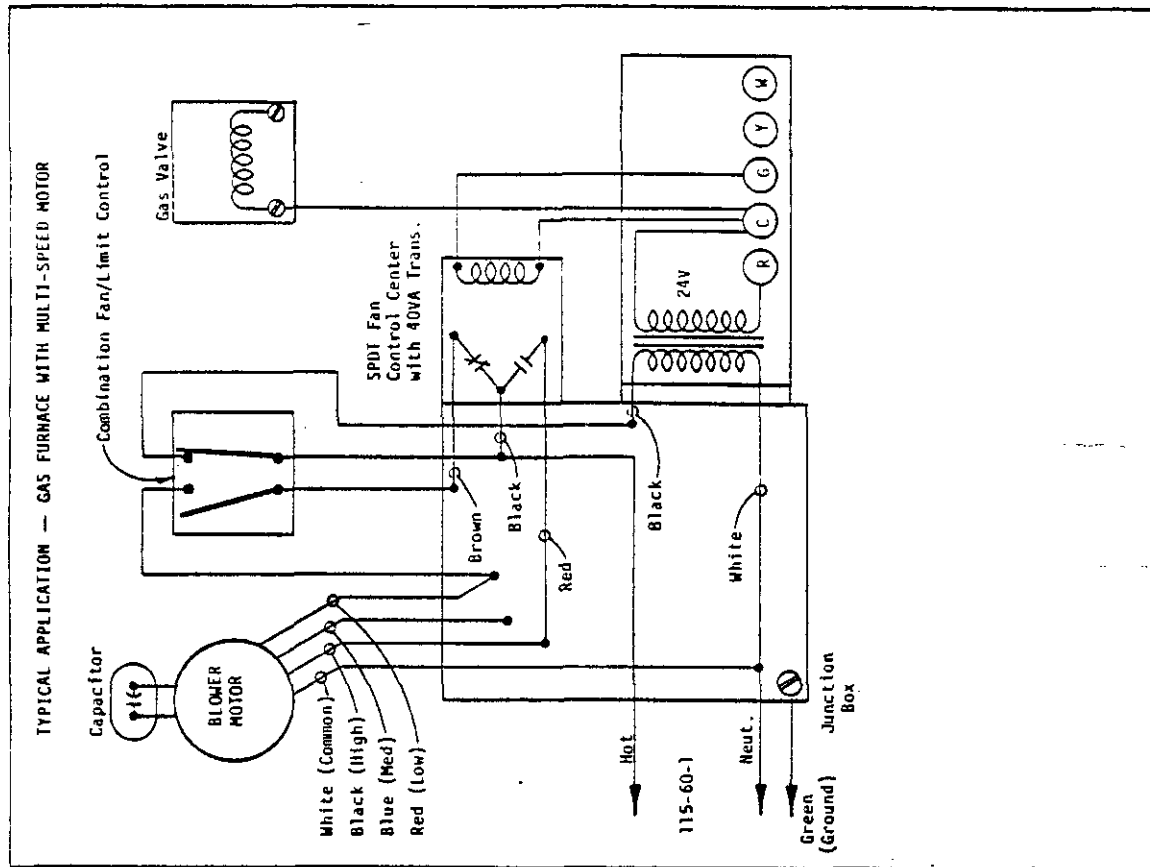

## TYPICAL APPLICATION -- OIL FURNACE

